



DETAIL A  
SCALE 0.250



DETAIL B  
SCALE 0.250

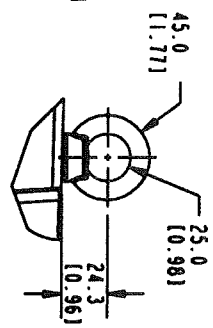

DETAIL C  
SCALE 0.250

FRAME SIZE C2			
VOLTAGE	HP	KW	
208/230	50-60	37-45	
460/600	100-125	75-90	

**UNIT COOLING:**

THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM FREE SPACE. ALL IP21/UL NEMA TYPE 1 AND IP54/NEMA TYPE 12 UNITS MAY BE MOUNTED SIDE BY SIDE WITH NO MINIMUM CLEARANCE.

- 1) PLACE CONDUITS IN MARKED AREA.
- 2) FOR NEMA TYPE 12 UNIT USE NEMA TYPE 12 CONDUITS AND HUBS.

**-NOTICE-**  
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF THE TRANE COMPANY

LATEST E.C.N. NO.:		E.C.N. PROJ. ENTRY BY/DATE:		PROJ. ENTRY BY/DATE:		DESIGNED BY/DATE:		CHANGED BY/DATE:		TITLE:	
				MN 10/20/08		MN 10/20/08		01/05/09		DWG. REF. SUBMITTAL, C2-TIER 1	
				NONE		NONE		NONE		AMERICAN DIVISION OF INC.	
				NONE		NONE		NONE		174N3469	