
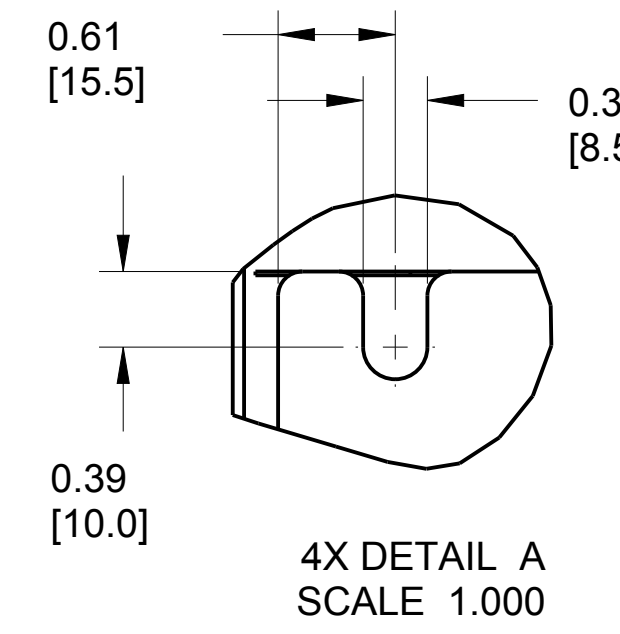
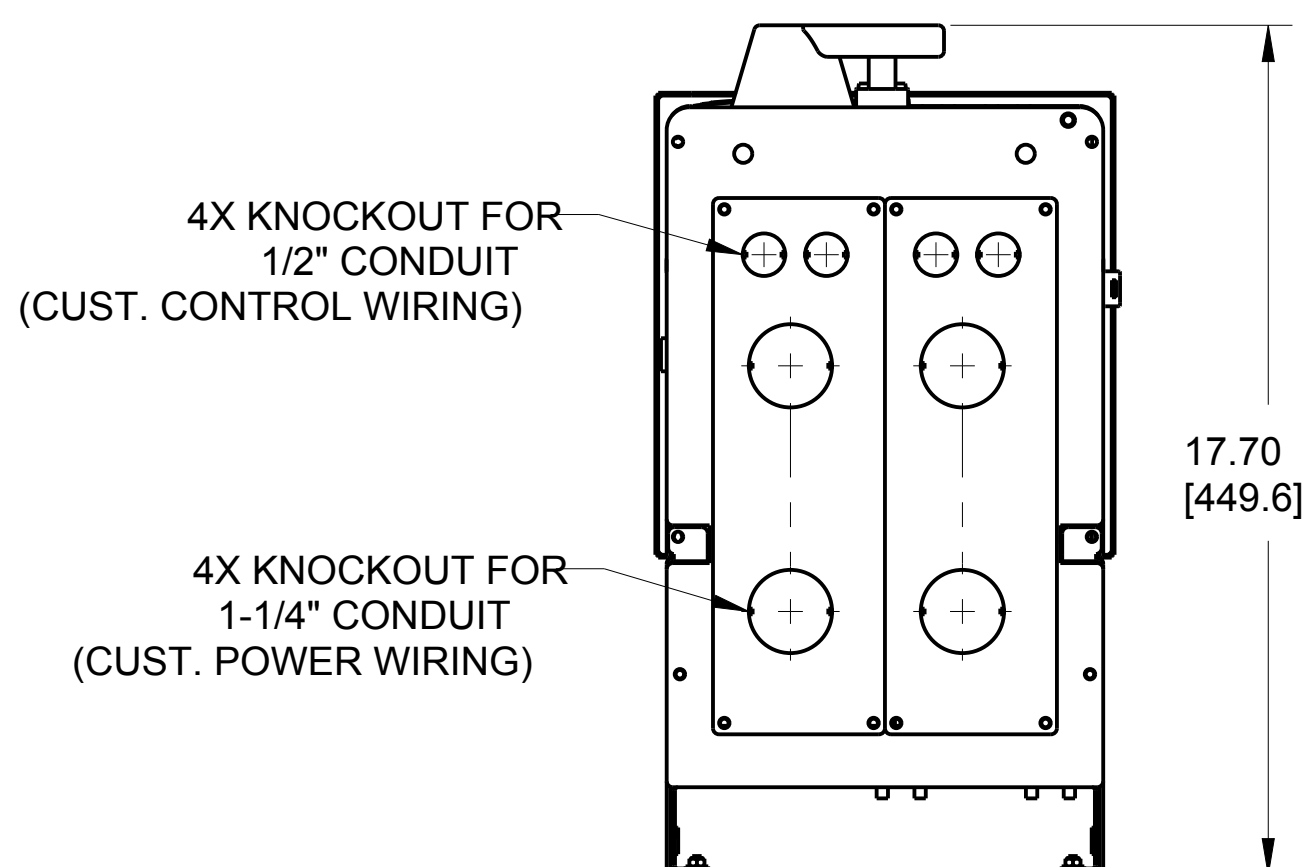
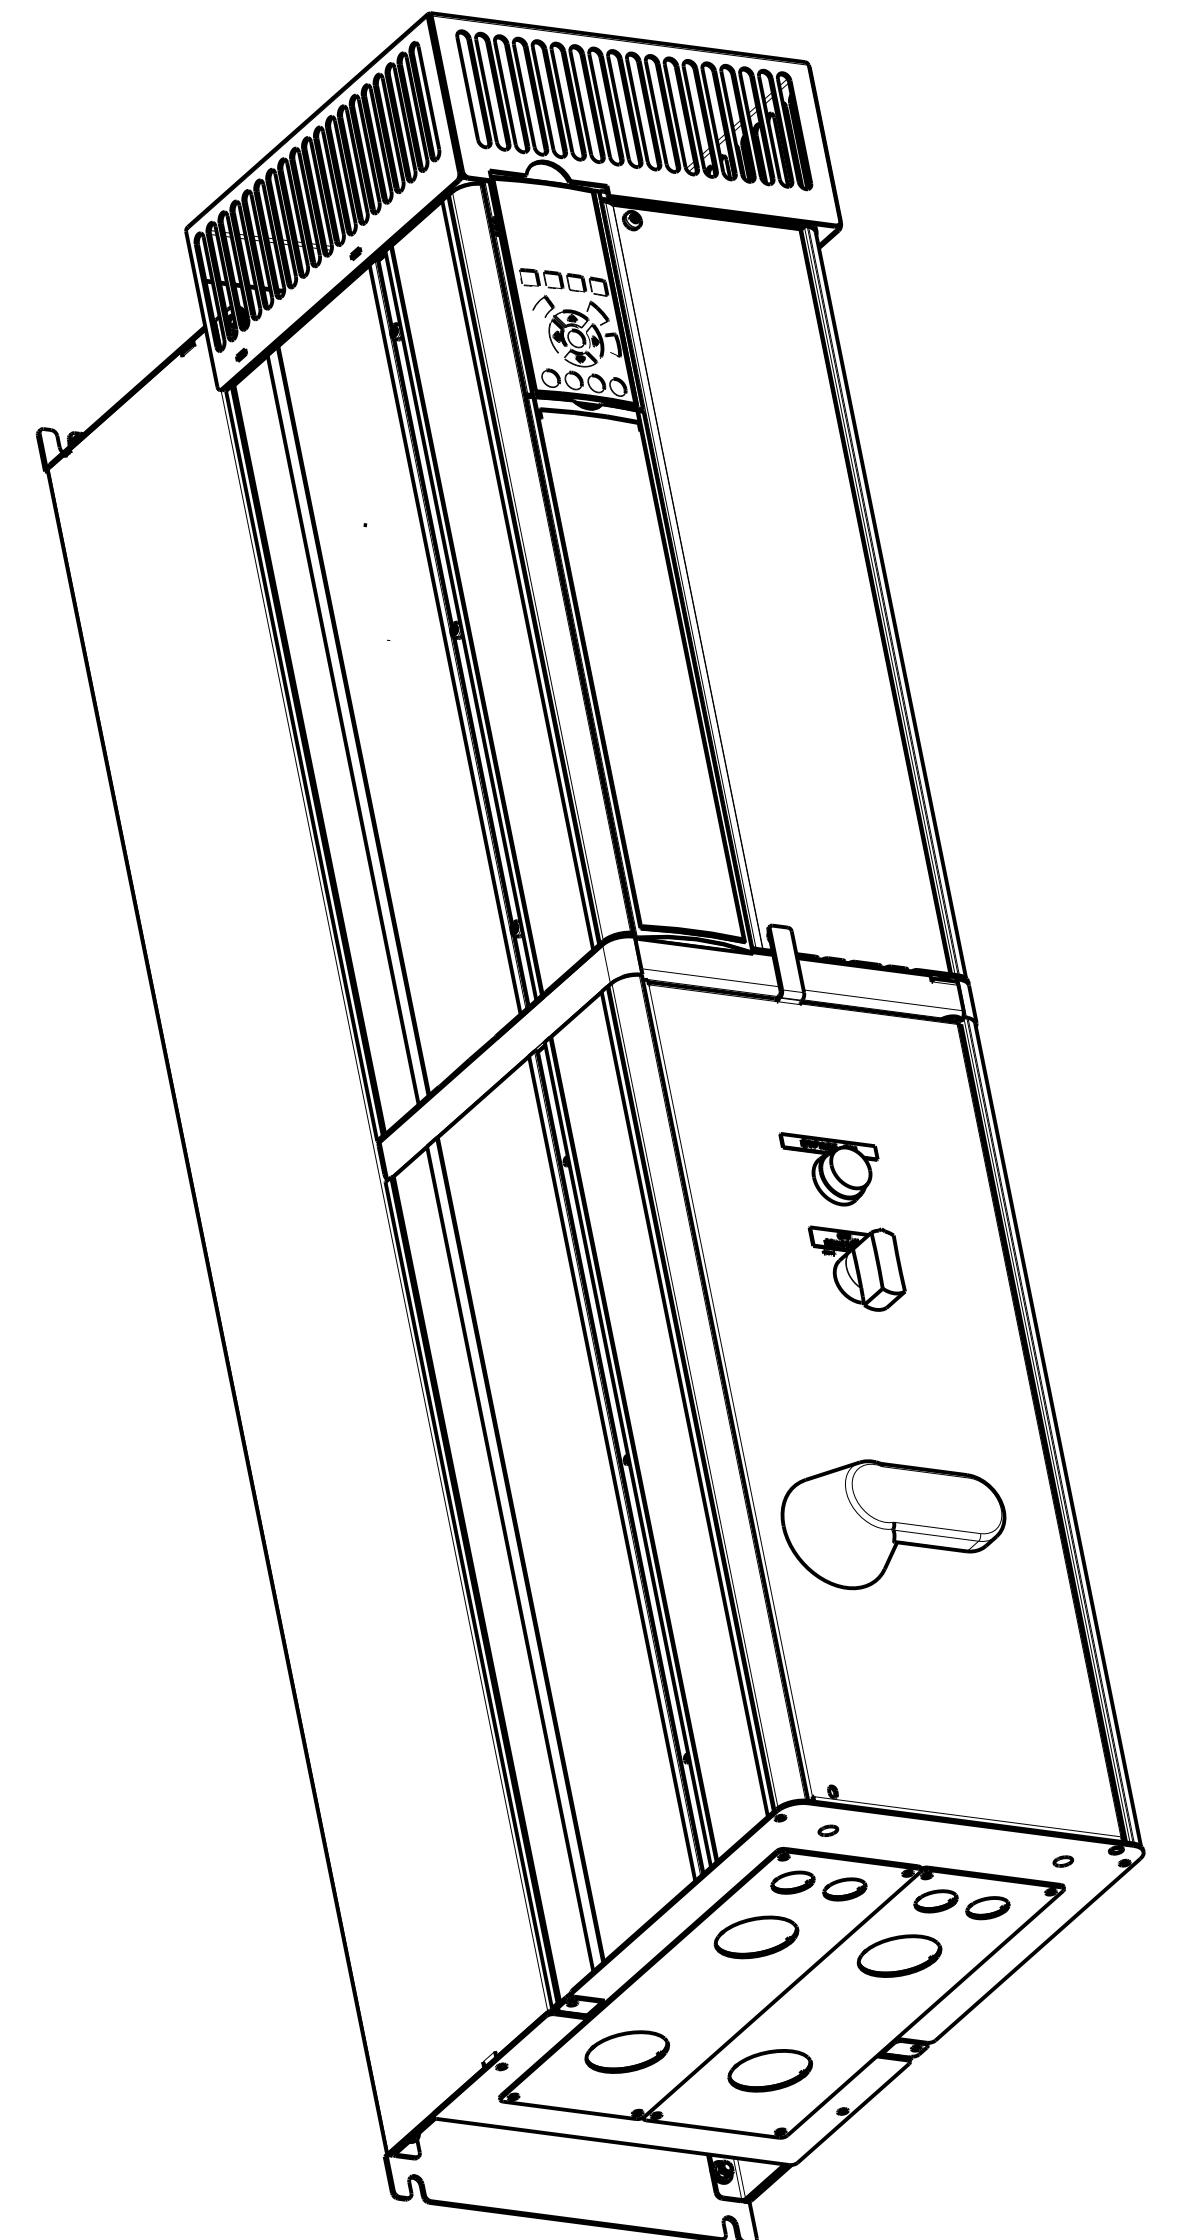
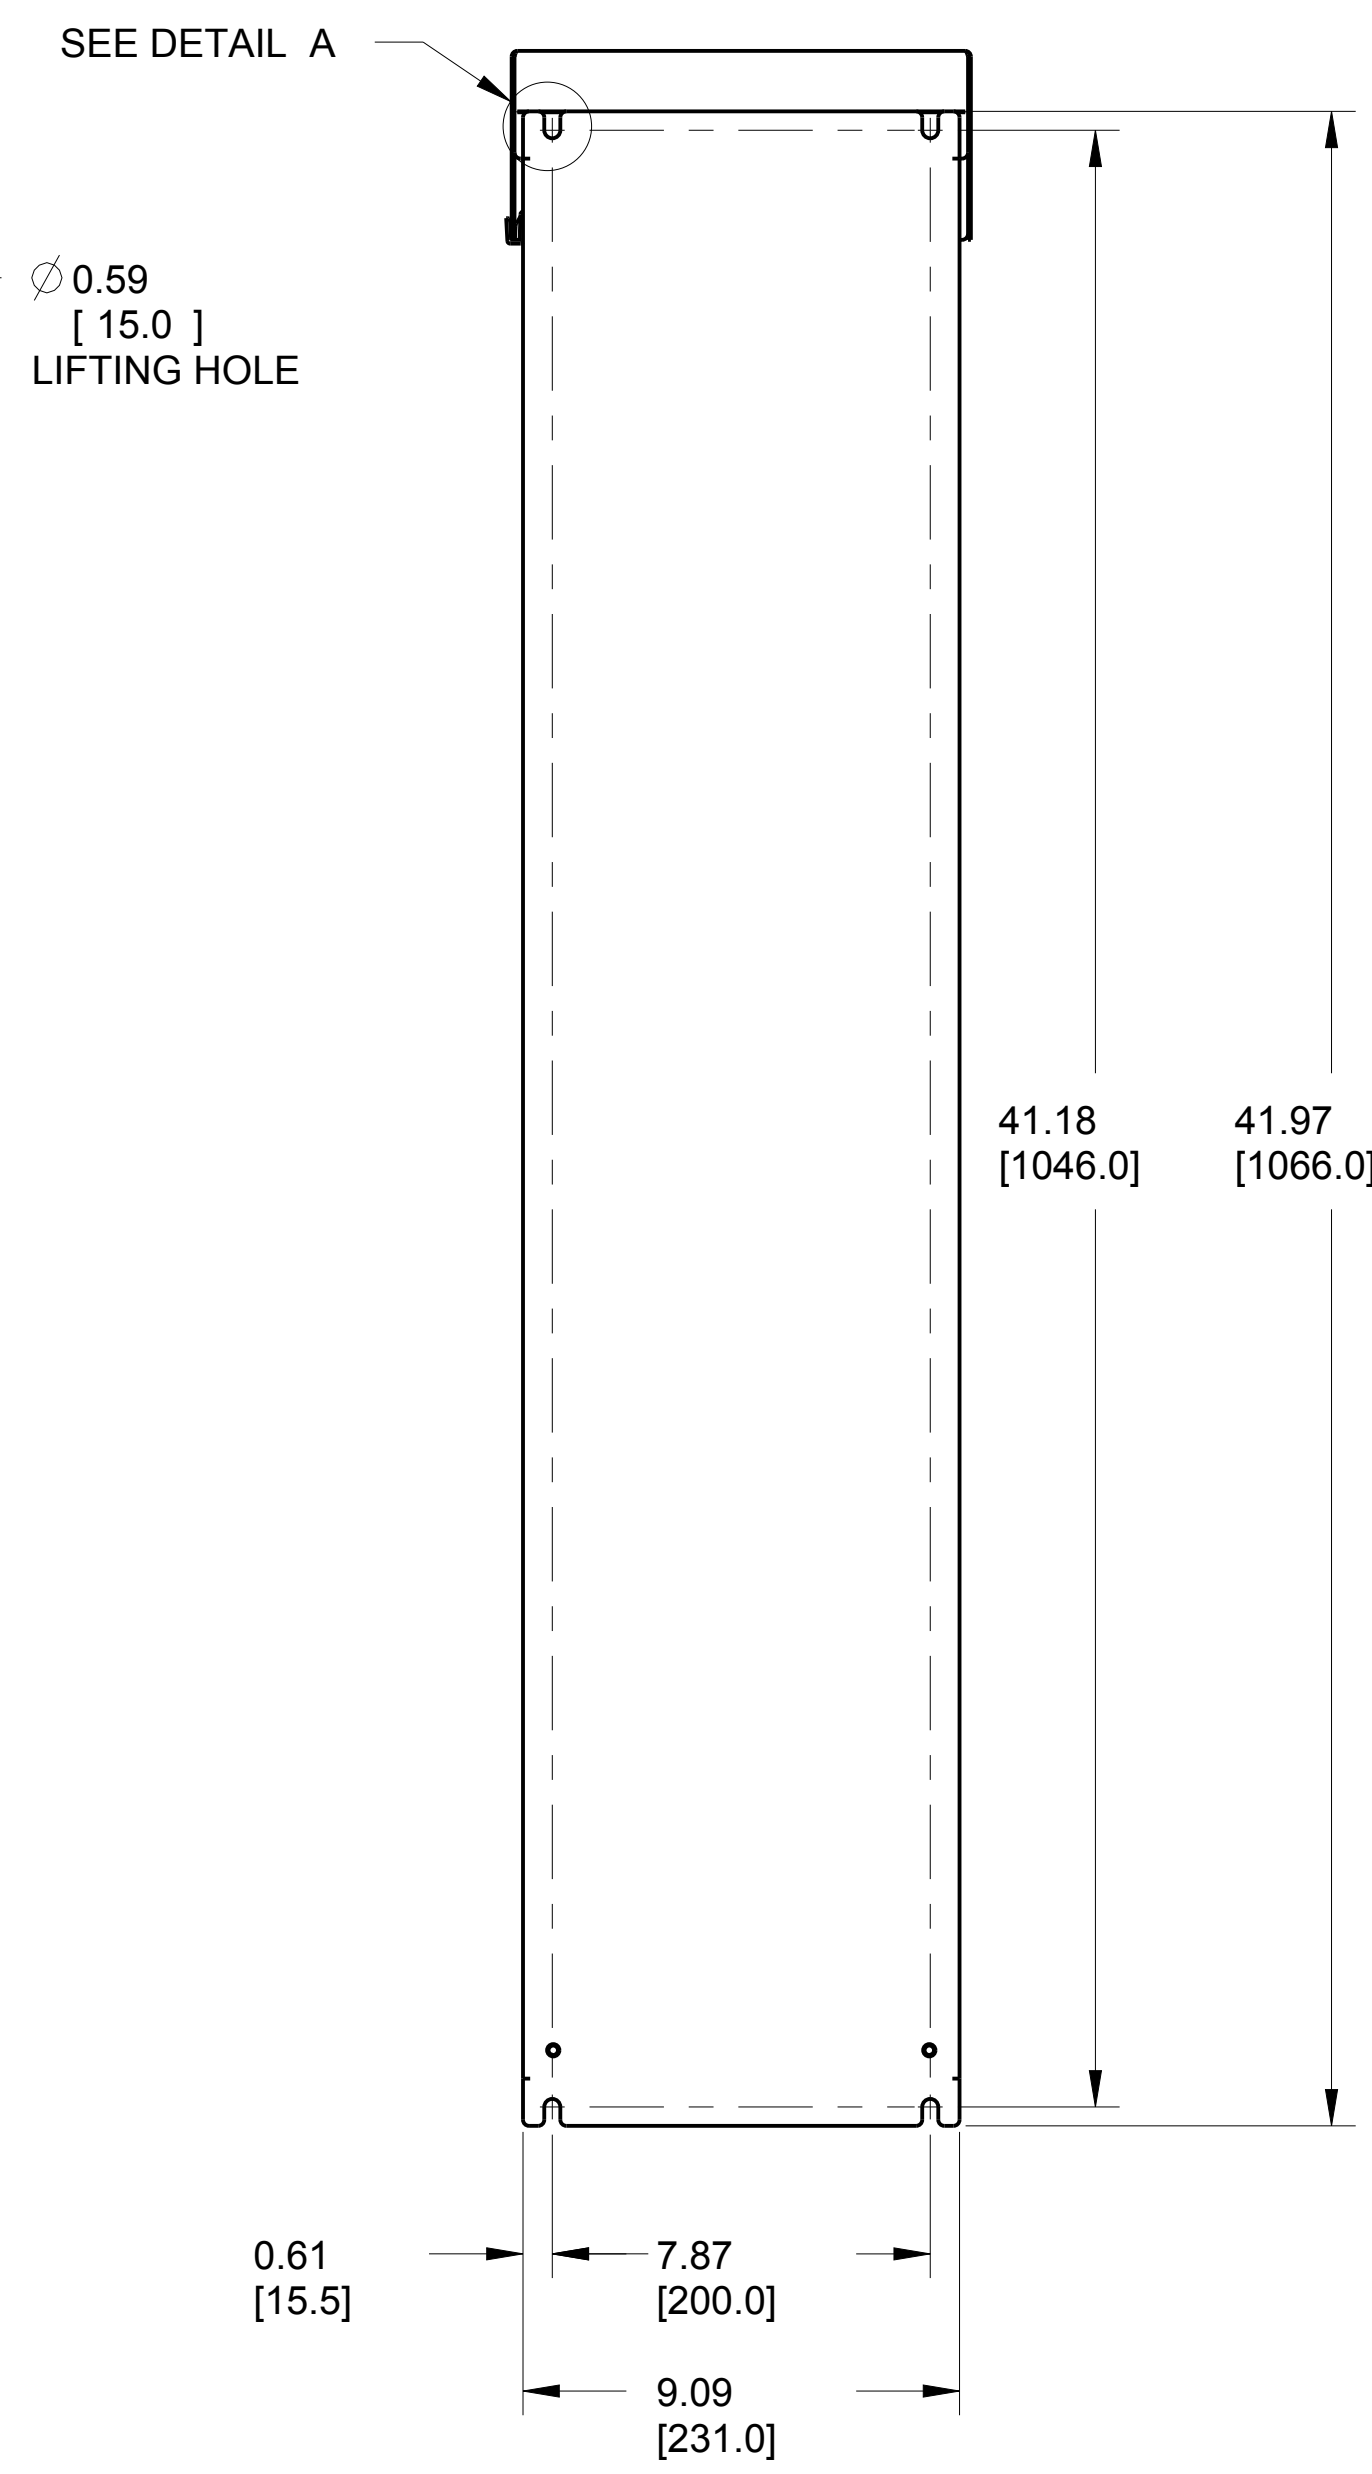
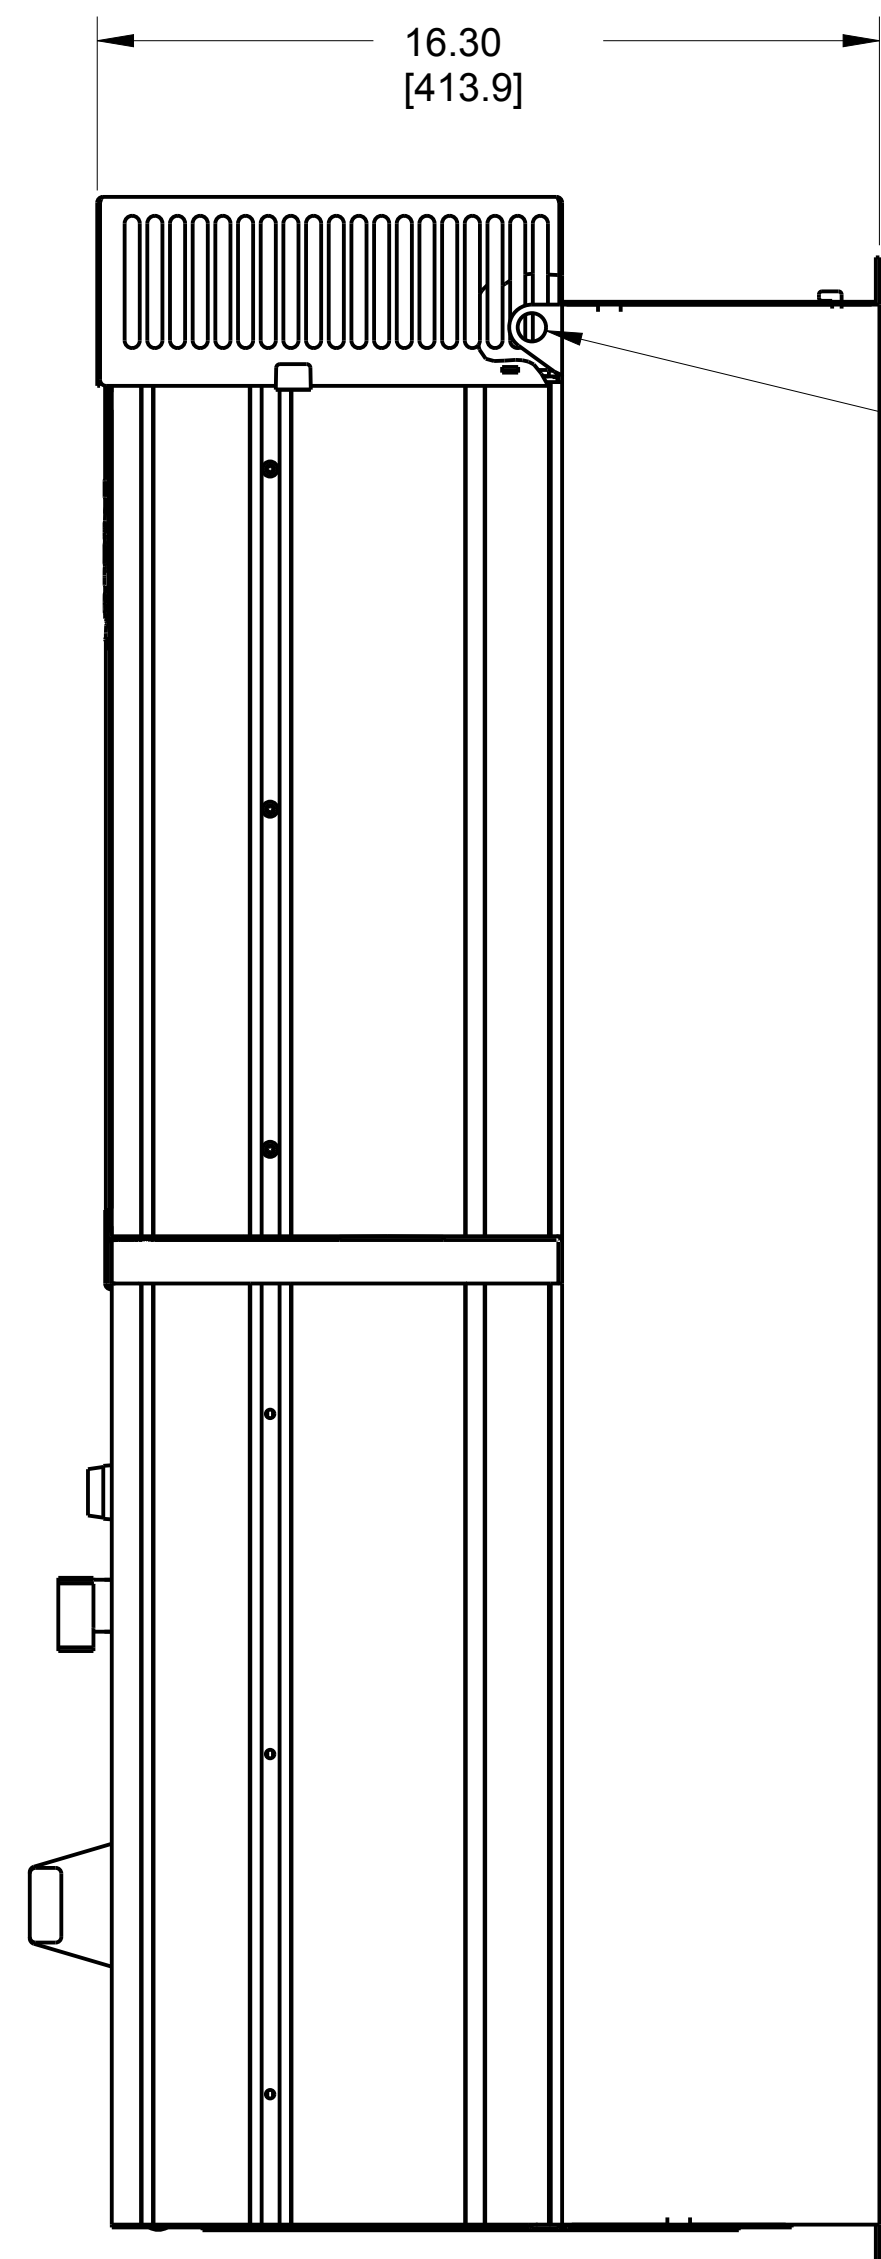


- NOTICE -
 THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF DANFOSS DRIVES. IT IS LOANED BY DANFOSS DRIVES SUBJECT TO THE CONDITIONS THAT IT AND THE INFORMATION EMBODIED THEREIN SHALL BE USED ONLY FOR RECORD AND REFERENCE PURPOSES. SHALL NOT BE USED OR CAUSED TO BE USED IN ANY WAY PREJUDICIAL TO THE INTERESTS OF DANFOSS DRIVES. SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART OR DISCLOSED TO ANYONE WITHOUT THE DIRECT WRITTEN PERMISSION OF DANFOSS DRIVES, AND SHALL BE RETURNED UPON REQUEST.

REVISION HISTORY			
REV	ECN NUMBER	ENTRY BY	DATE
003	LP11031	JMH	6/6/2011

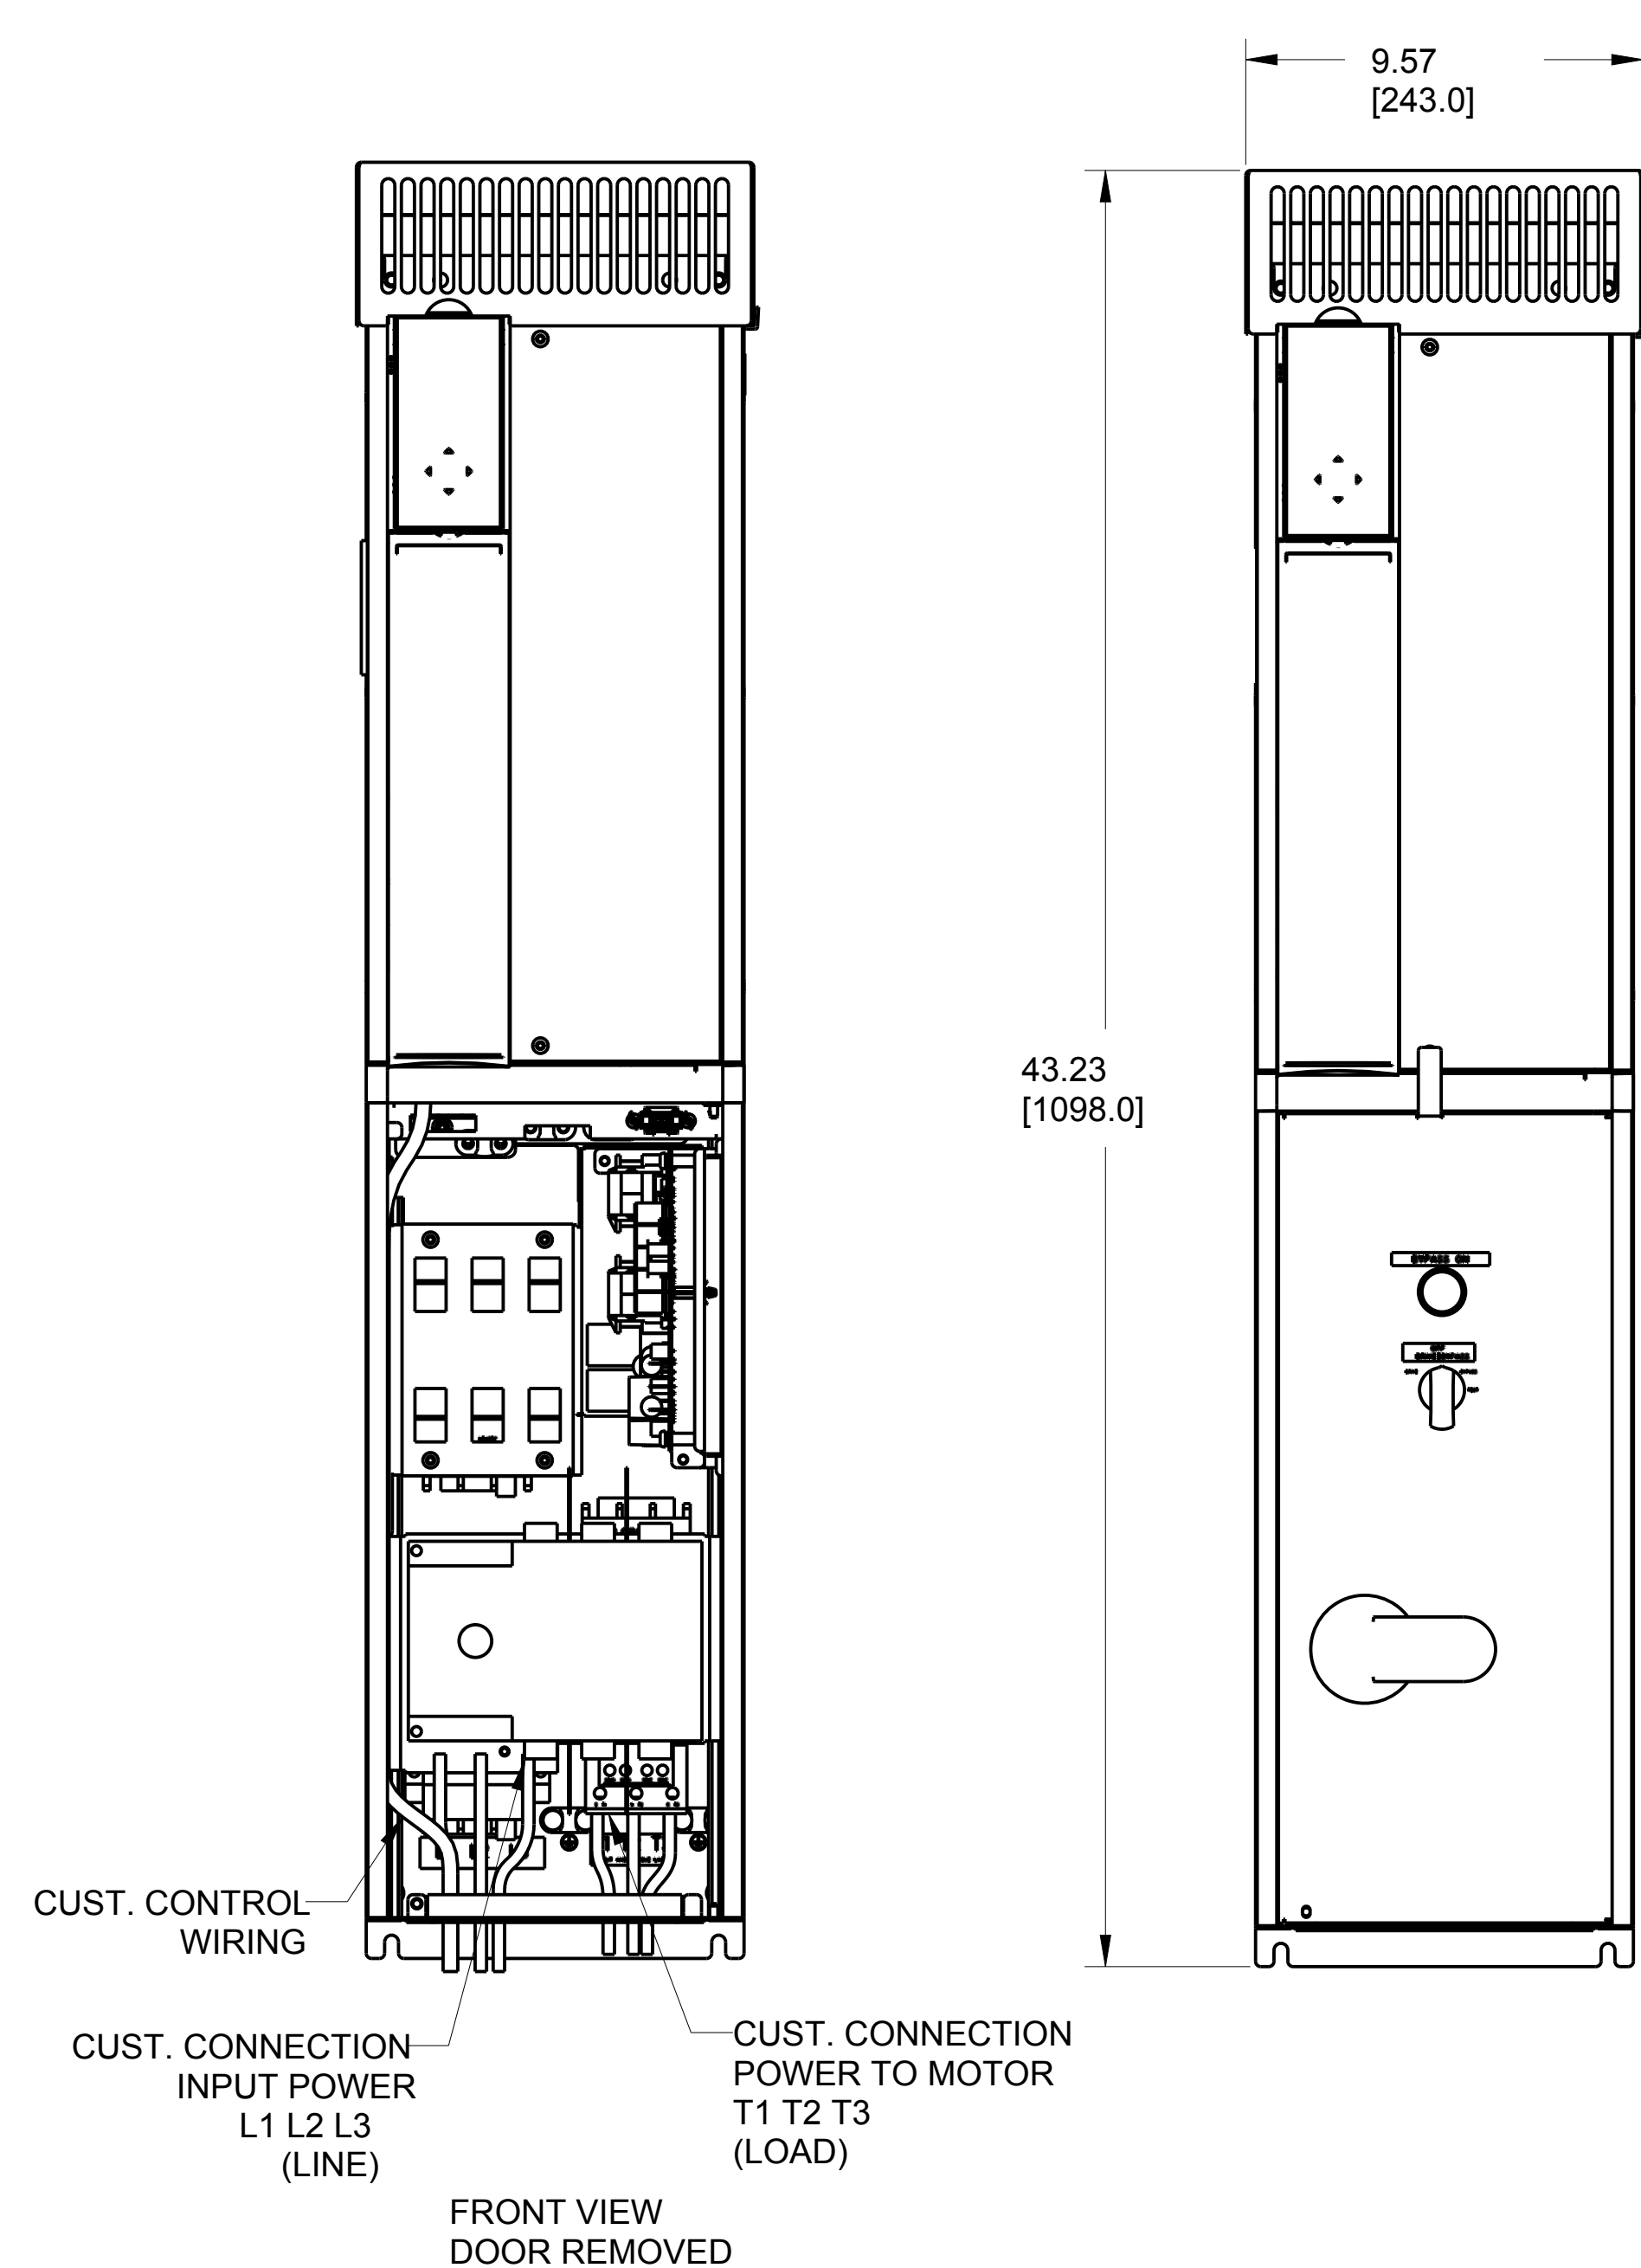

FRAME SIZE P3		
VOLTAGE	HP	KW
208	20	15
	20	15
230	25	18.5
	30	22
460	40	30
	50	37
575	30	22
	40	30
	50	37

CLEARANCE REQUIREMENT FOR AIR FLOW COOLING:
 THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM CLEARANCE OF 7.87" [200mm] ON THE BOTTOM AND 2.00" [50.8 mm] ON THE TOP FOR UNIT COOLING.

UNLESS OTHERWISE SPECIFIED INTERPRET DIM. AND TOL. PER ASME Y14.5M-1994 .X± 0.1 .XX± 0.01 ∠ ± 0.5 DIM. ARE IN MILLIMETERS WEIGHTS ARE IN KILOGRAMS THIRD ANGLE PROJECTION	PROPERTIES			 4401 N. BELL SCHOOL RD. LOVES PARK, ILLINOIS 61111 USA (815) 636-6600 FAX (815) 636-9000
	MATERIAL			
	FINISH			
	THICKNESS			
EST. WEIGHT	106.0 Lbs [48.1 Kg]	TITLE		
APPROVALS	INITIALS	DATE	DWG. SUBMITTAL, P3, BYPASS, P656	
DRAWN	DK	08/20/10	SIZE	D
CHECKED			SCALE	0.250
ENGR			MODEL	177R0233
			DRAWING NO.	177R0203
			REV	003
			SHEET	1 OF 1