

DRAWING	REVISION	VERSION

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES. TOLERANCE:

.X = ± 0.1
 .XX = ± 0.03
 .XXX = ± 0.005

ANGLES = ± 2.0° HOLE DIA = ∅

CONFORMS TO ASME Y14.5M-1994.

TRANE

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE

DRAWN BY: DK
 DATE: 03/25/11

DO NOT SCALE PRINT

THIRD ANGLE PROJECTION

177R0341

SHEET 1 OF 1 REV 003





DWG. SUBMITTAL, P2, NON-BYPASS, TRANE

D


C

B

A

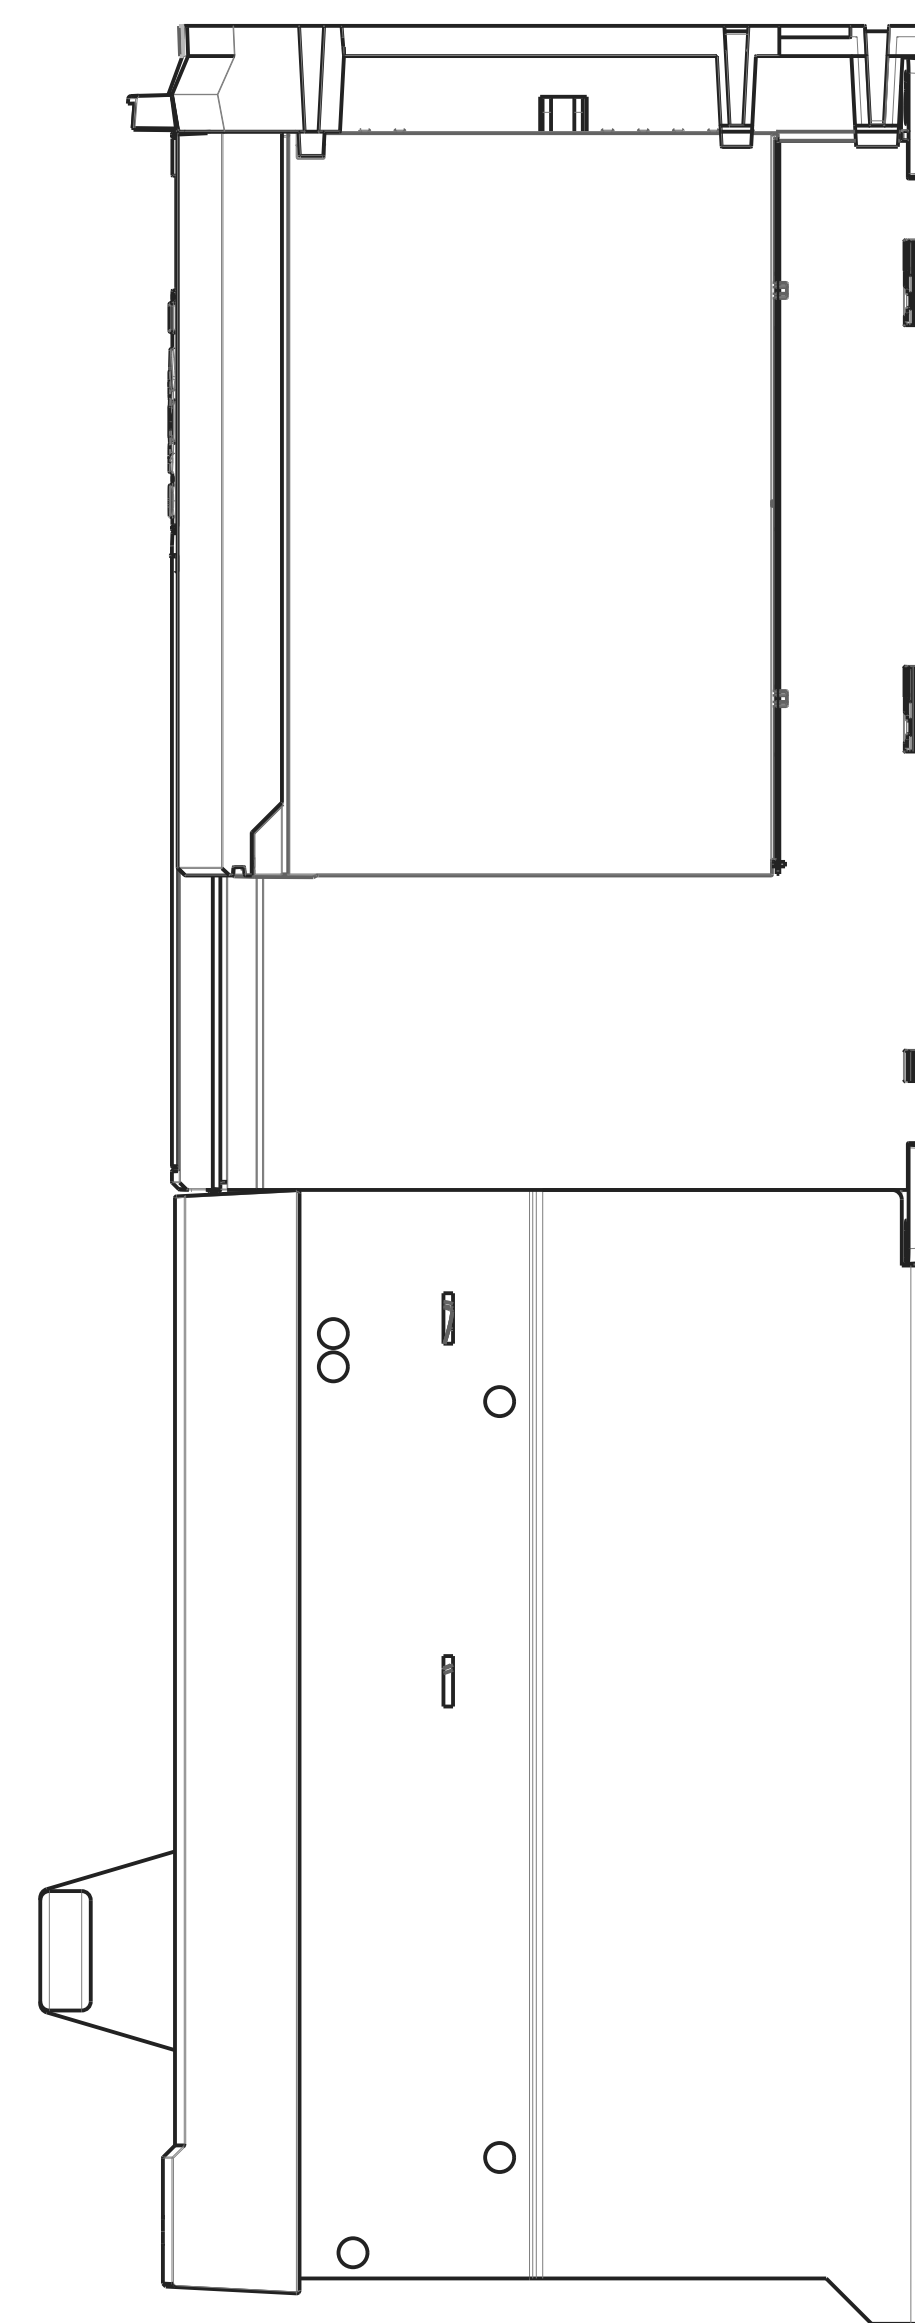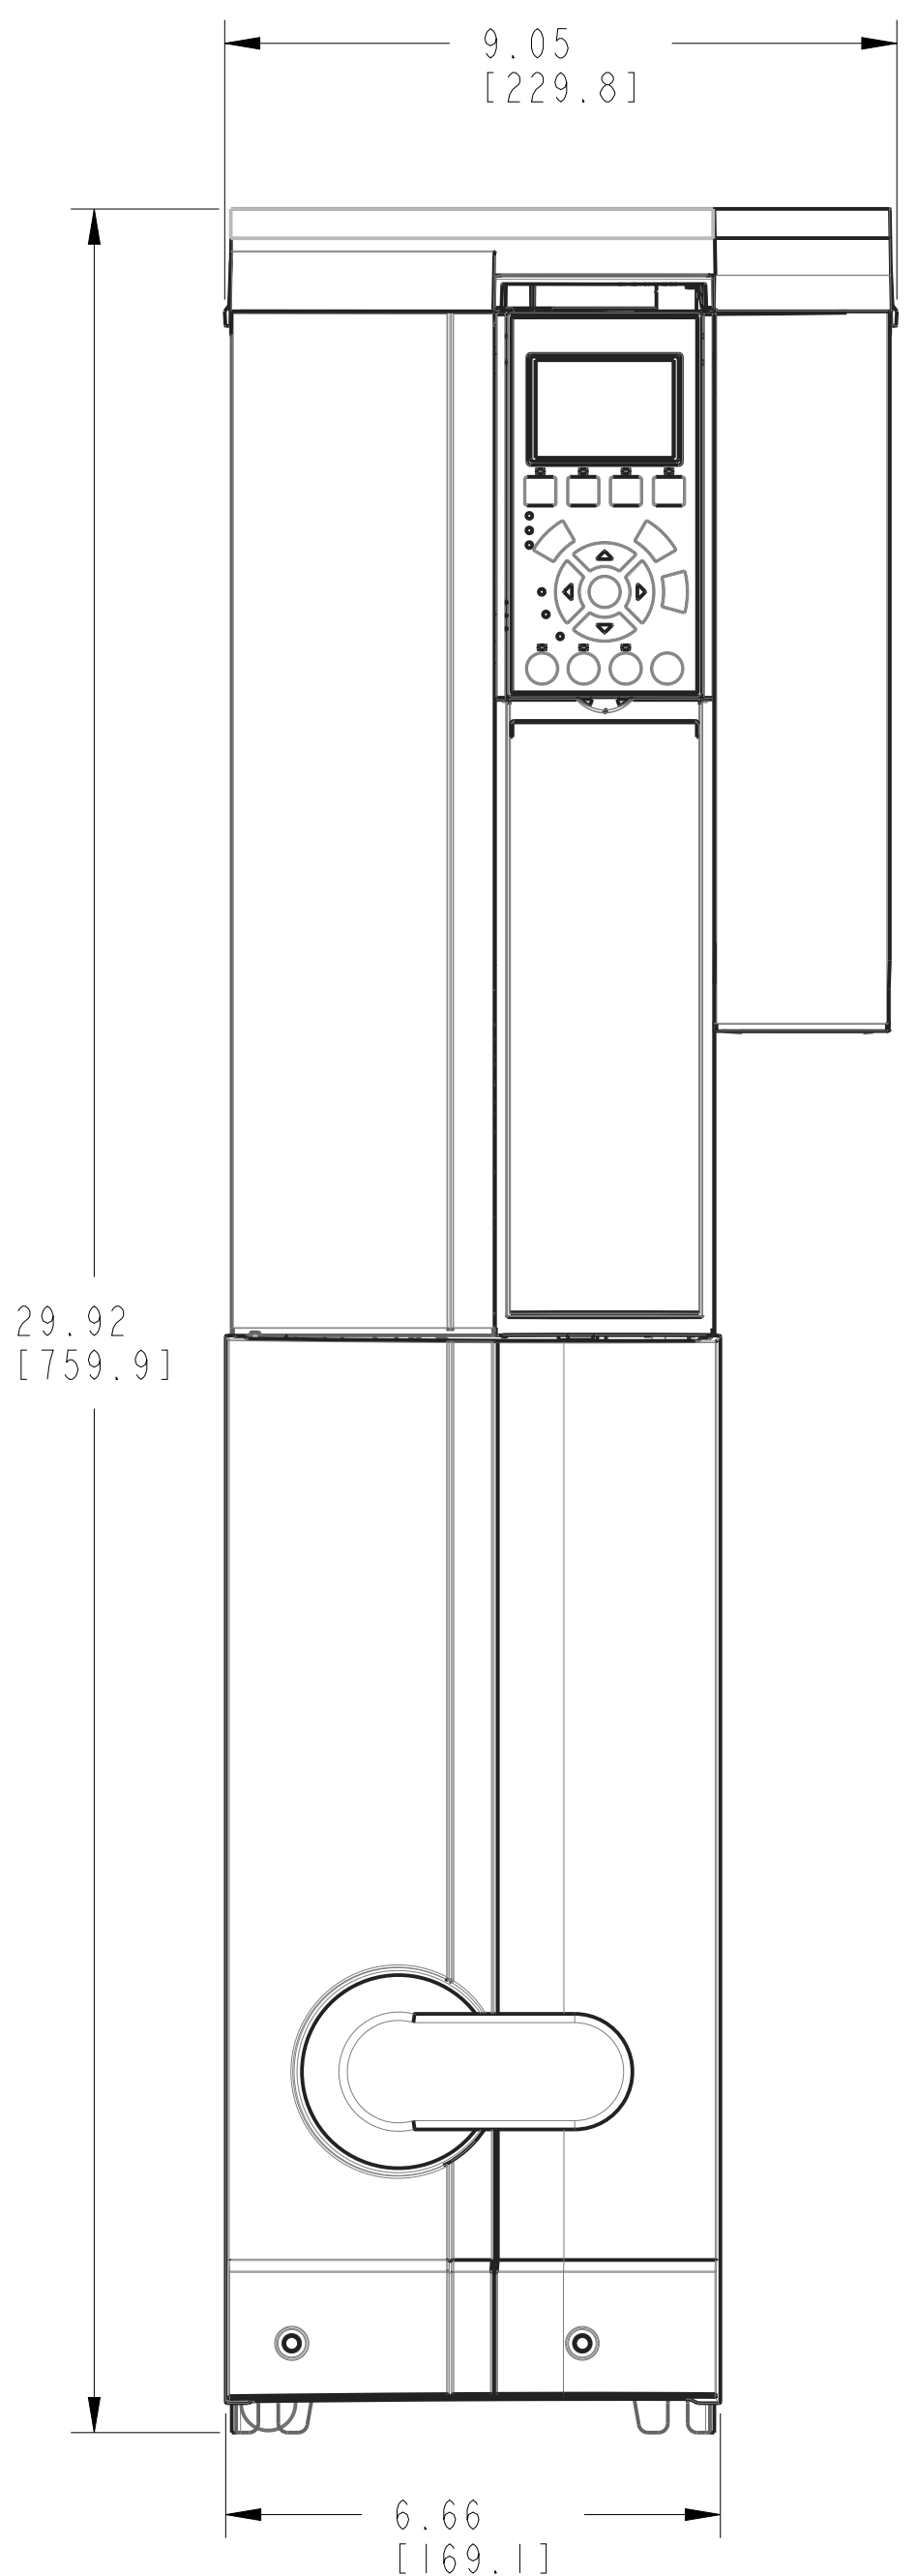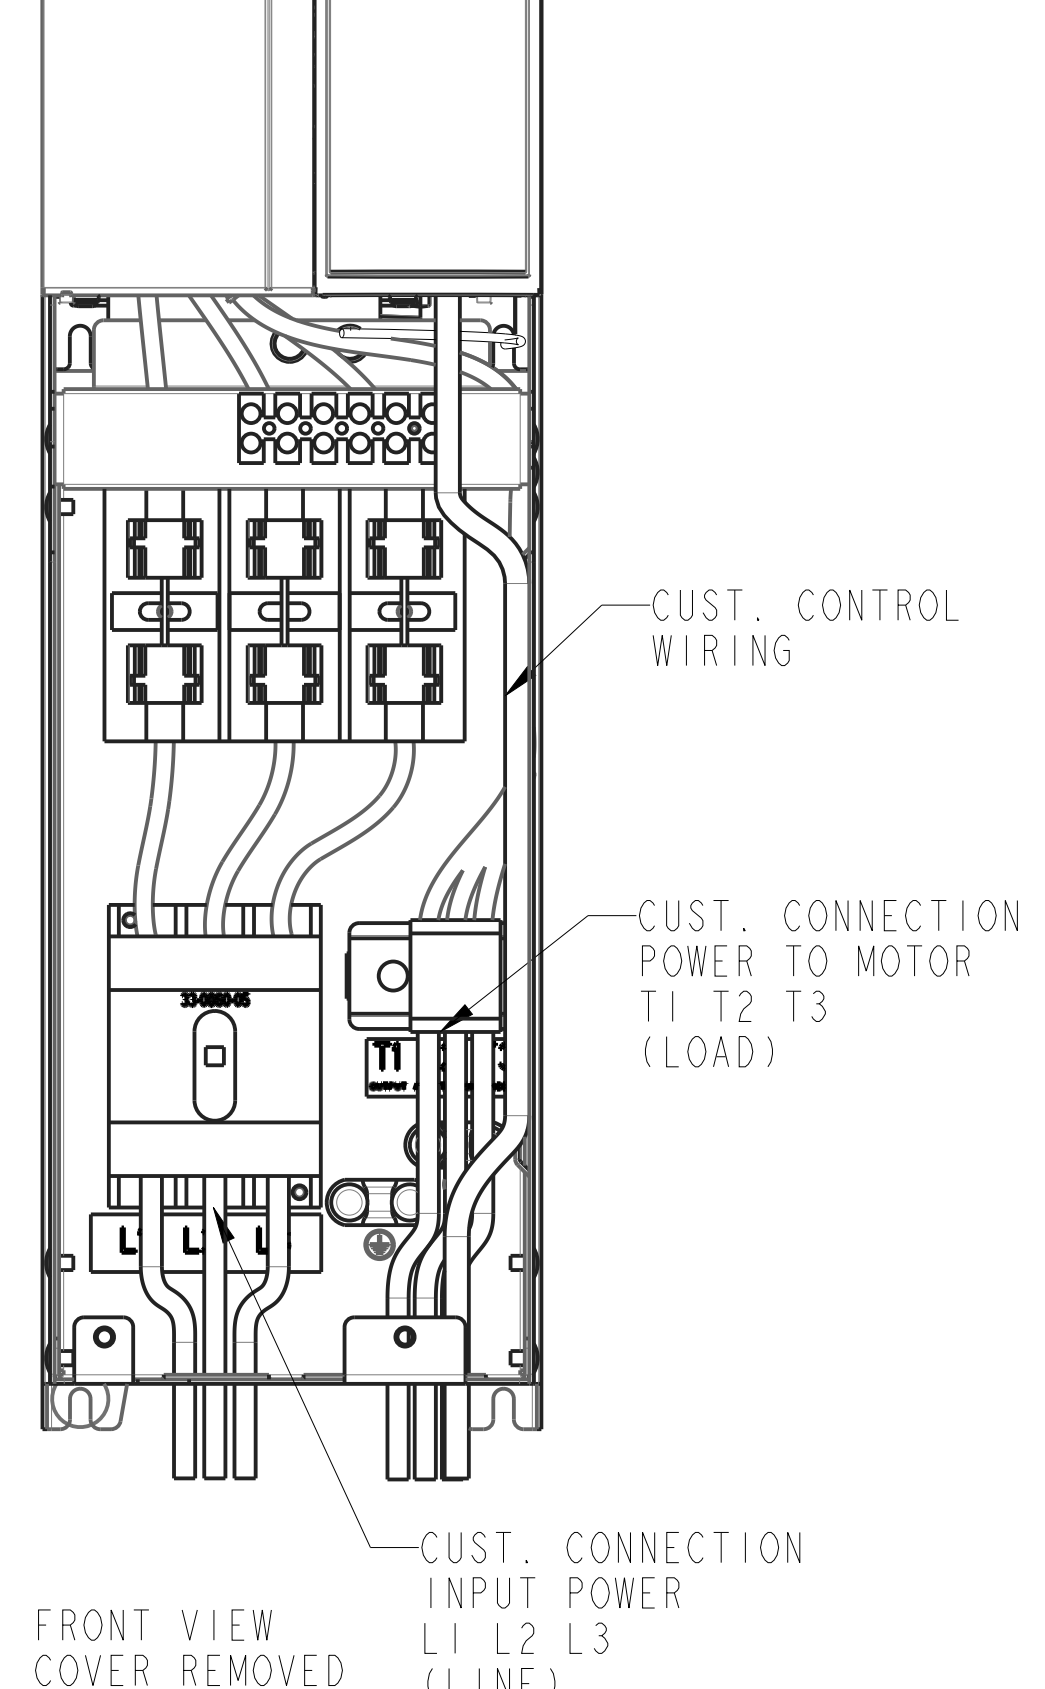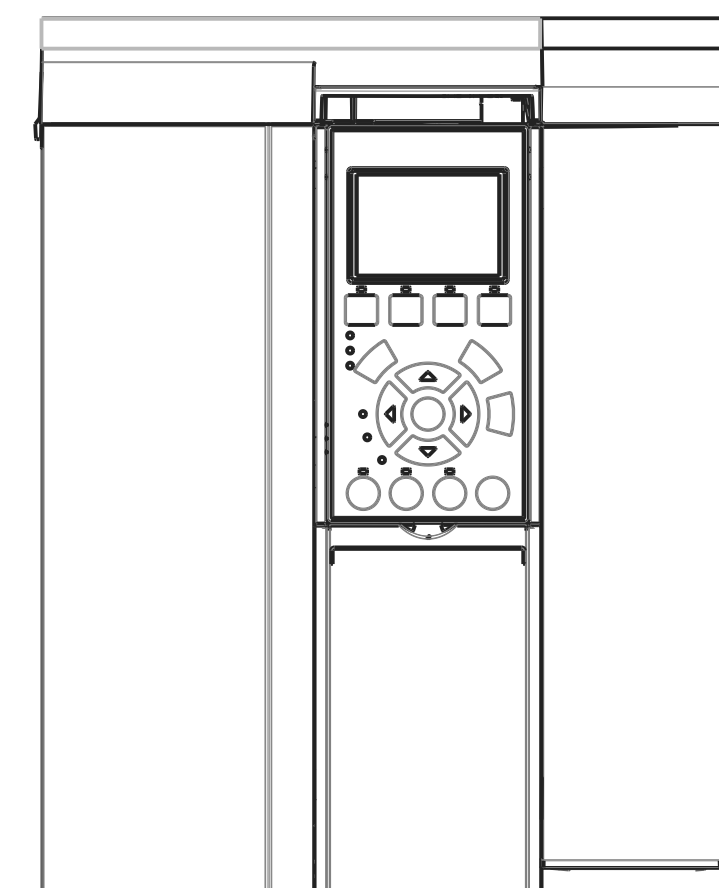

SEE DETAIL A

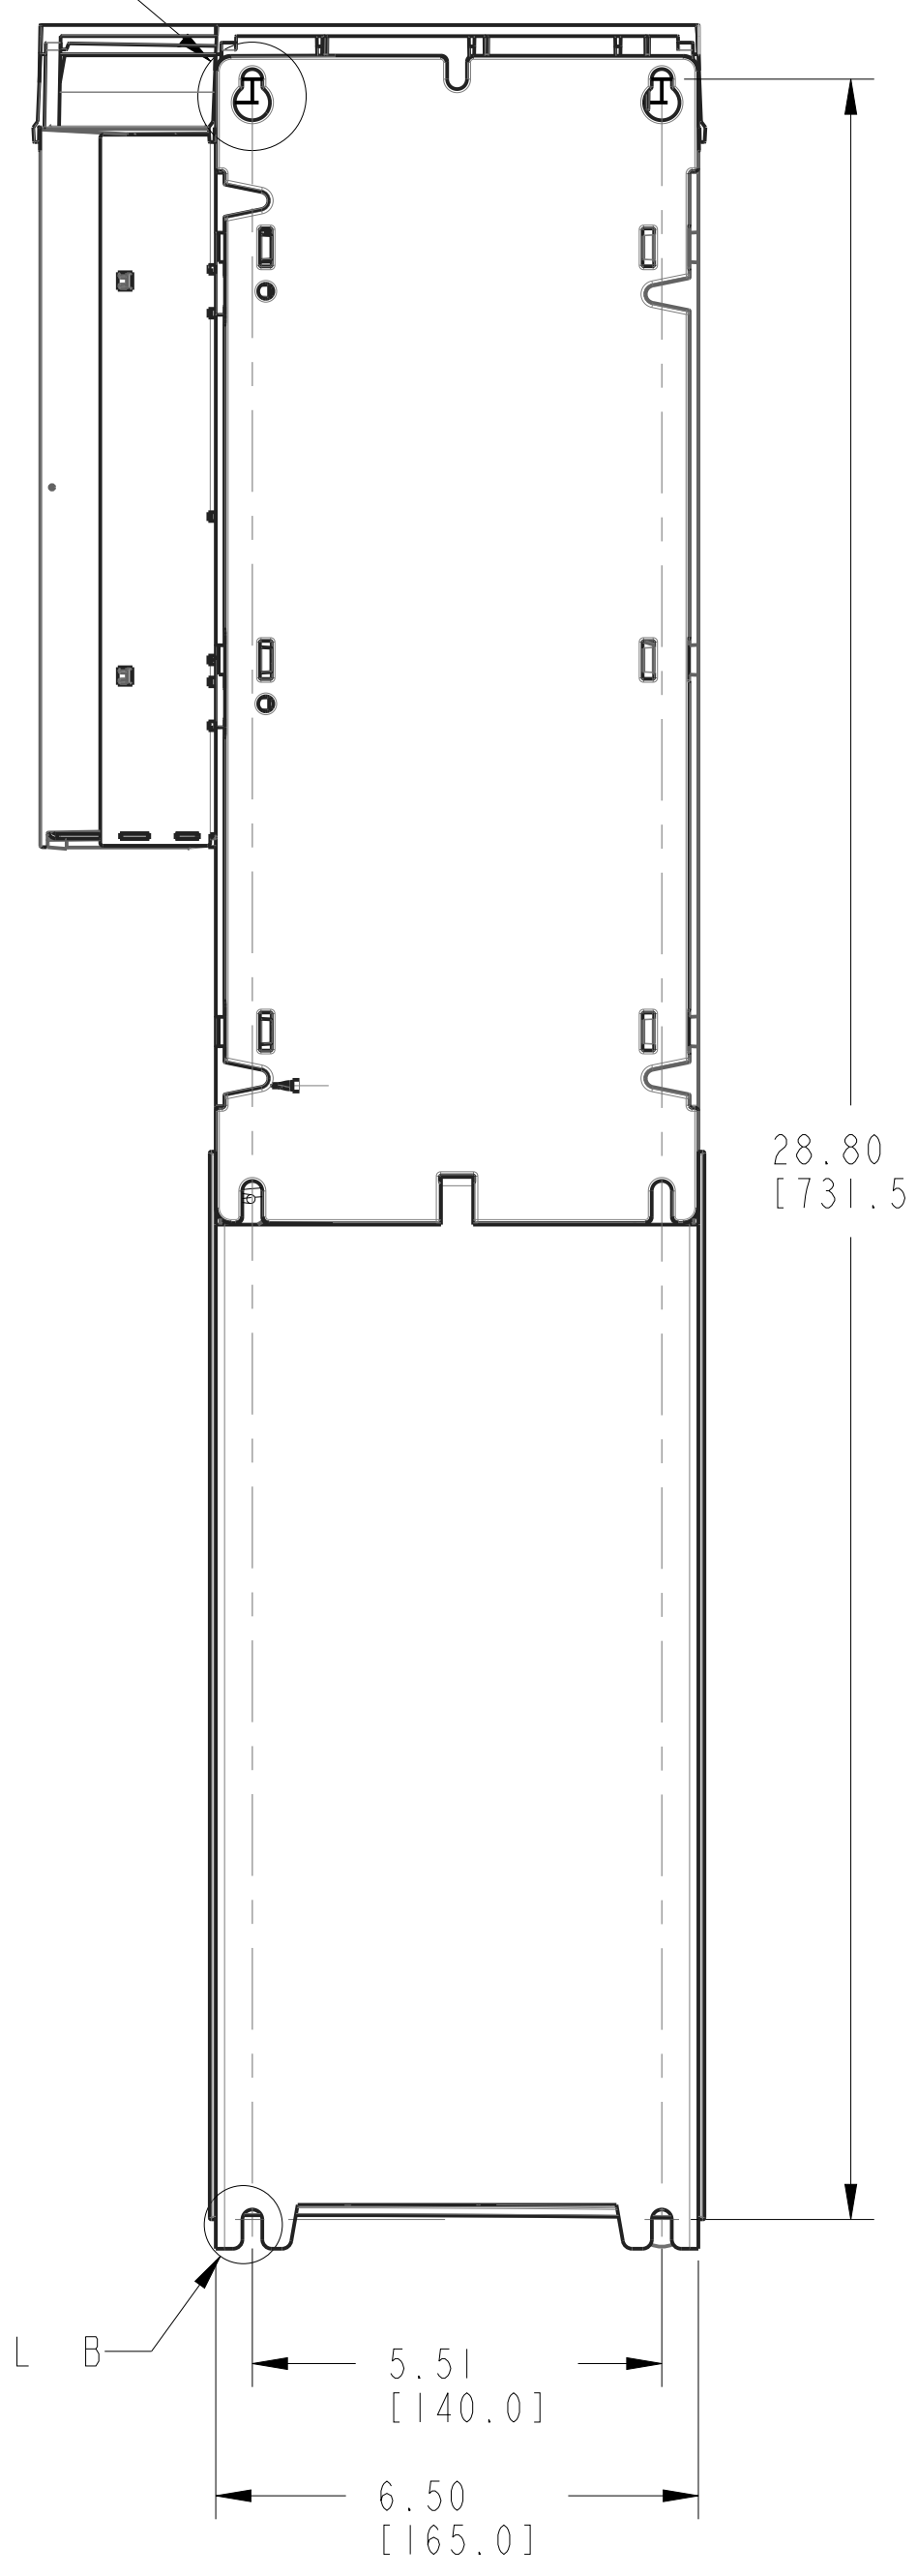

CLEARANCE REQUIREMENT FOR AIR FLOW COOLING:

THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM CLEARANCE OF 7.87" [200mm] ON THE BOTTOM, 2.00" [50.8 mm] ON THE TOP AND 1.50" [38.1mm] ON EITHER SIDE FOR UNIT COOLING.

FRAME SIZE P2		
VOLTAGE	HP	KW
208	7.5	5.5
	10	7.5
	15	11
230	7.5	5.5
	10	7.5
	15	11
460	20	15
	25	18
575	15	11
	20	15
	25	18

