

DRAWING	REVISION	VERSION

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES. TOLERANCE:
.X = ± 0.1
.XX = ± 0.03
.XXX = ± 0.005
FINISH ✓
ANGLES = ± 2.0° HOLE DIA = :
CONFORMS TO ASME Y14.5M-1994.

TRANE
THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE
DRAWN BY: DK
DATE: 03/25/11
DO NOT SCALE PRINT
THIRD ANGLE PROJECTION

177R0343
SHEET 1 OF 1
REV 003








CLEARANCE REQUIREMENT FOR AIR FLOW COOLING:
THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM CLEARANCE OF 7.87" [200 mm] ON THE BOTTOM AND 1.50" [38.1 mm] ON EITHER SIDE FOR UNIT COOLING.

D

C

B

A

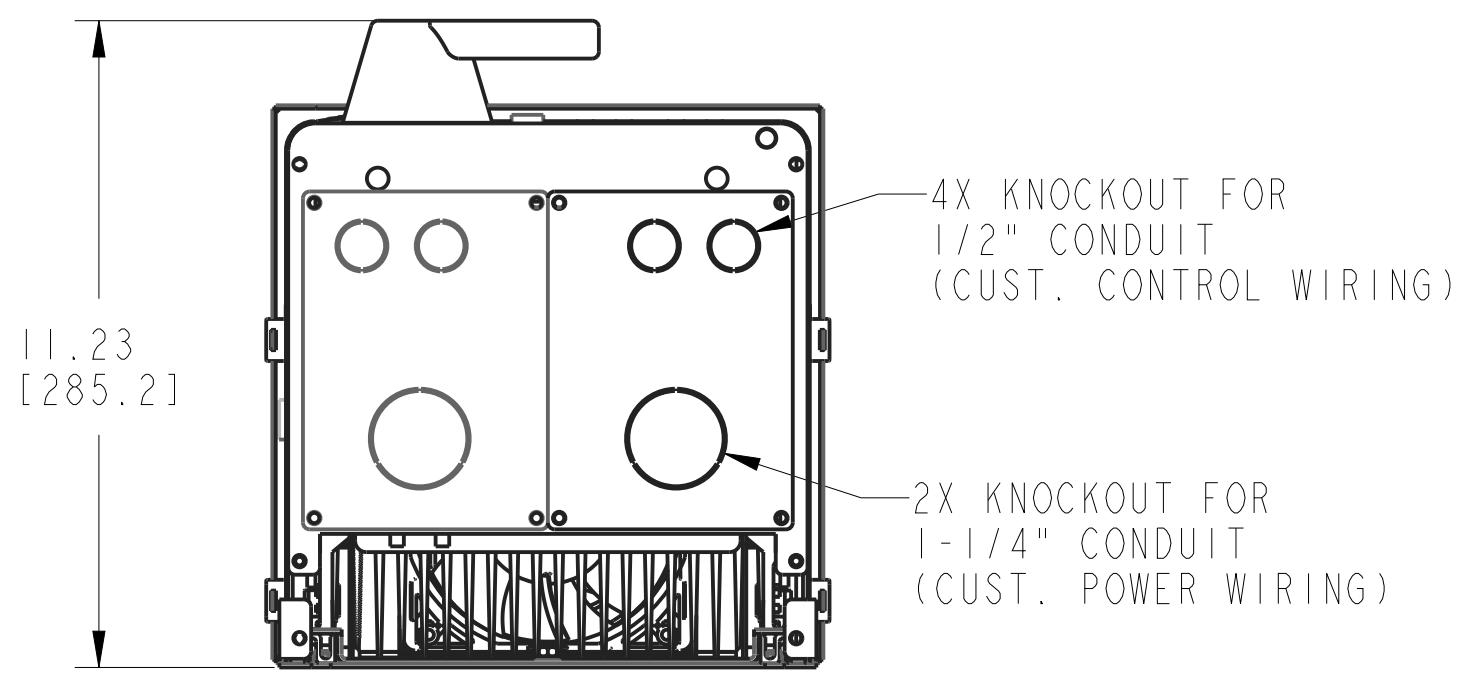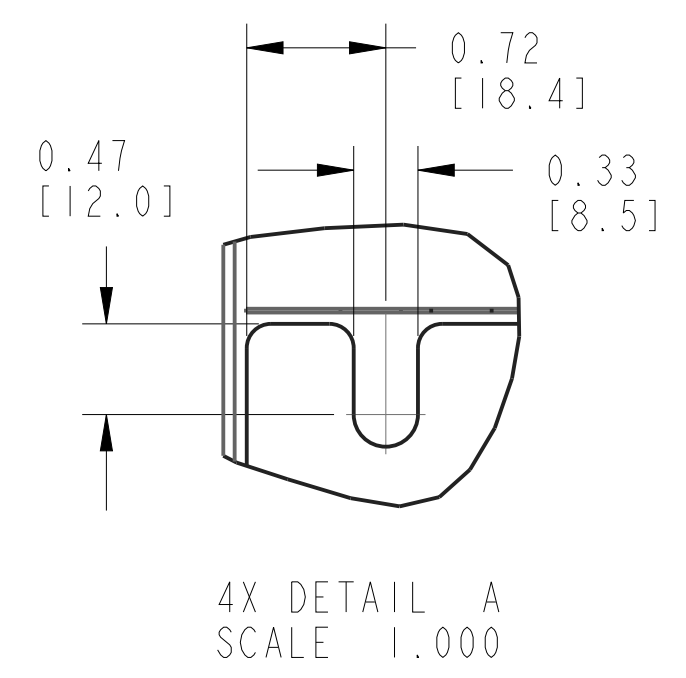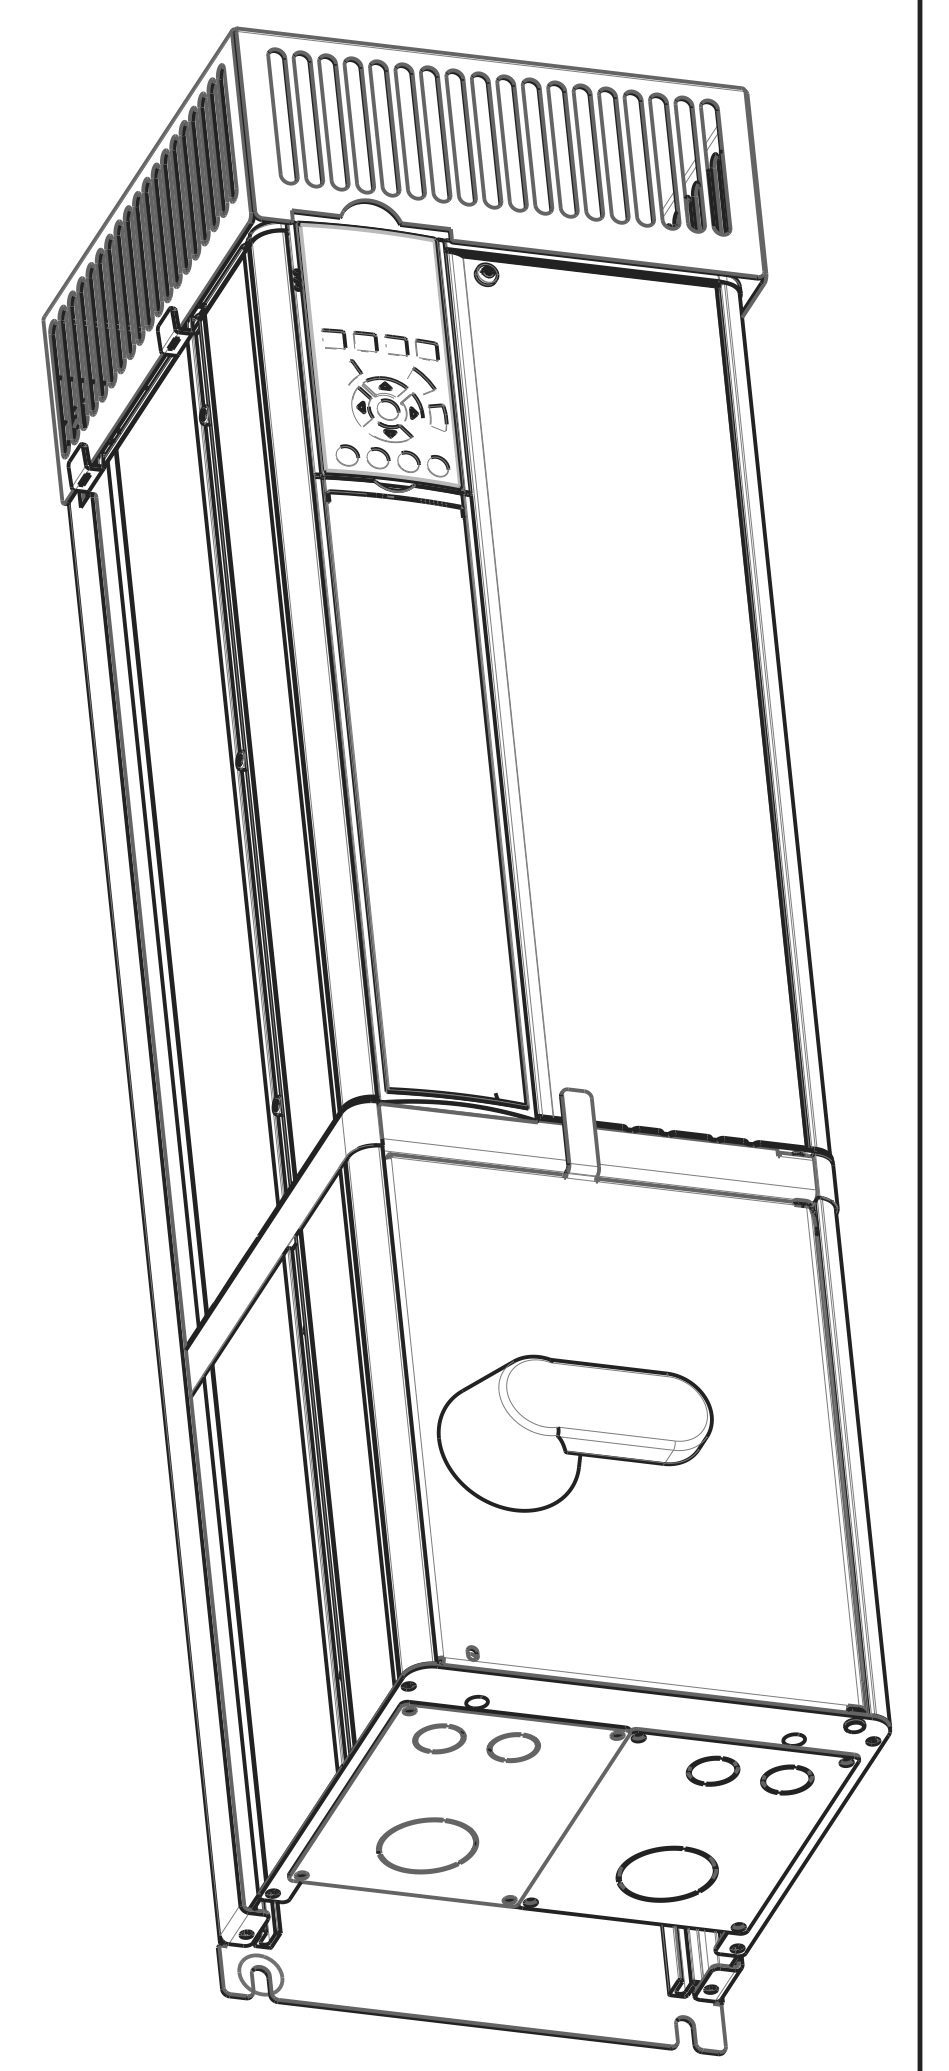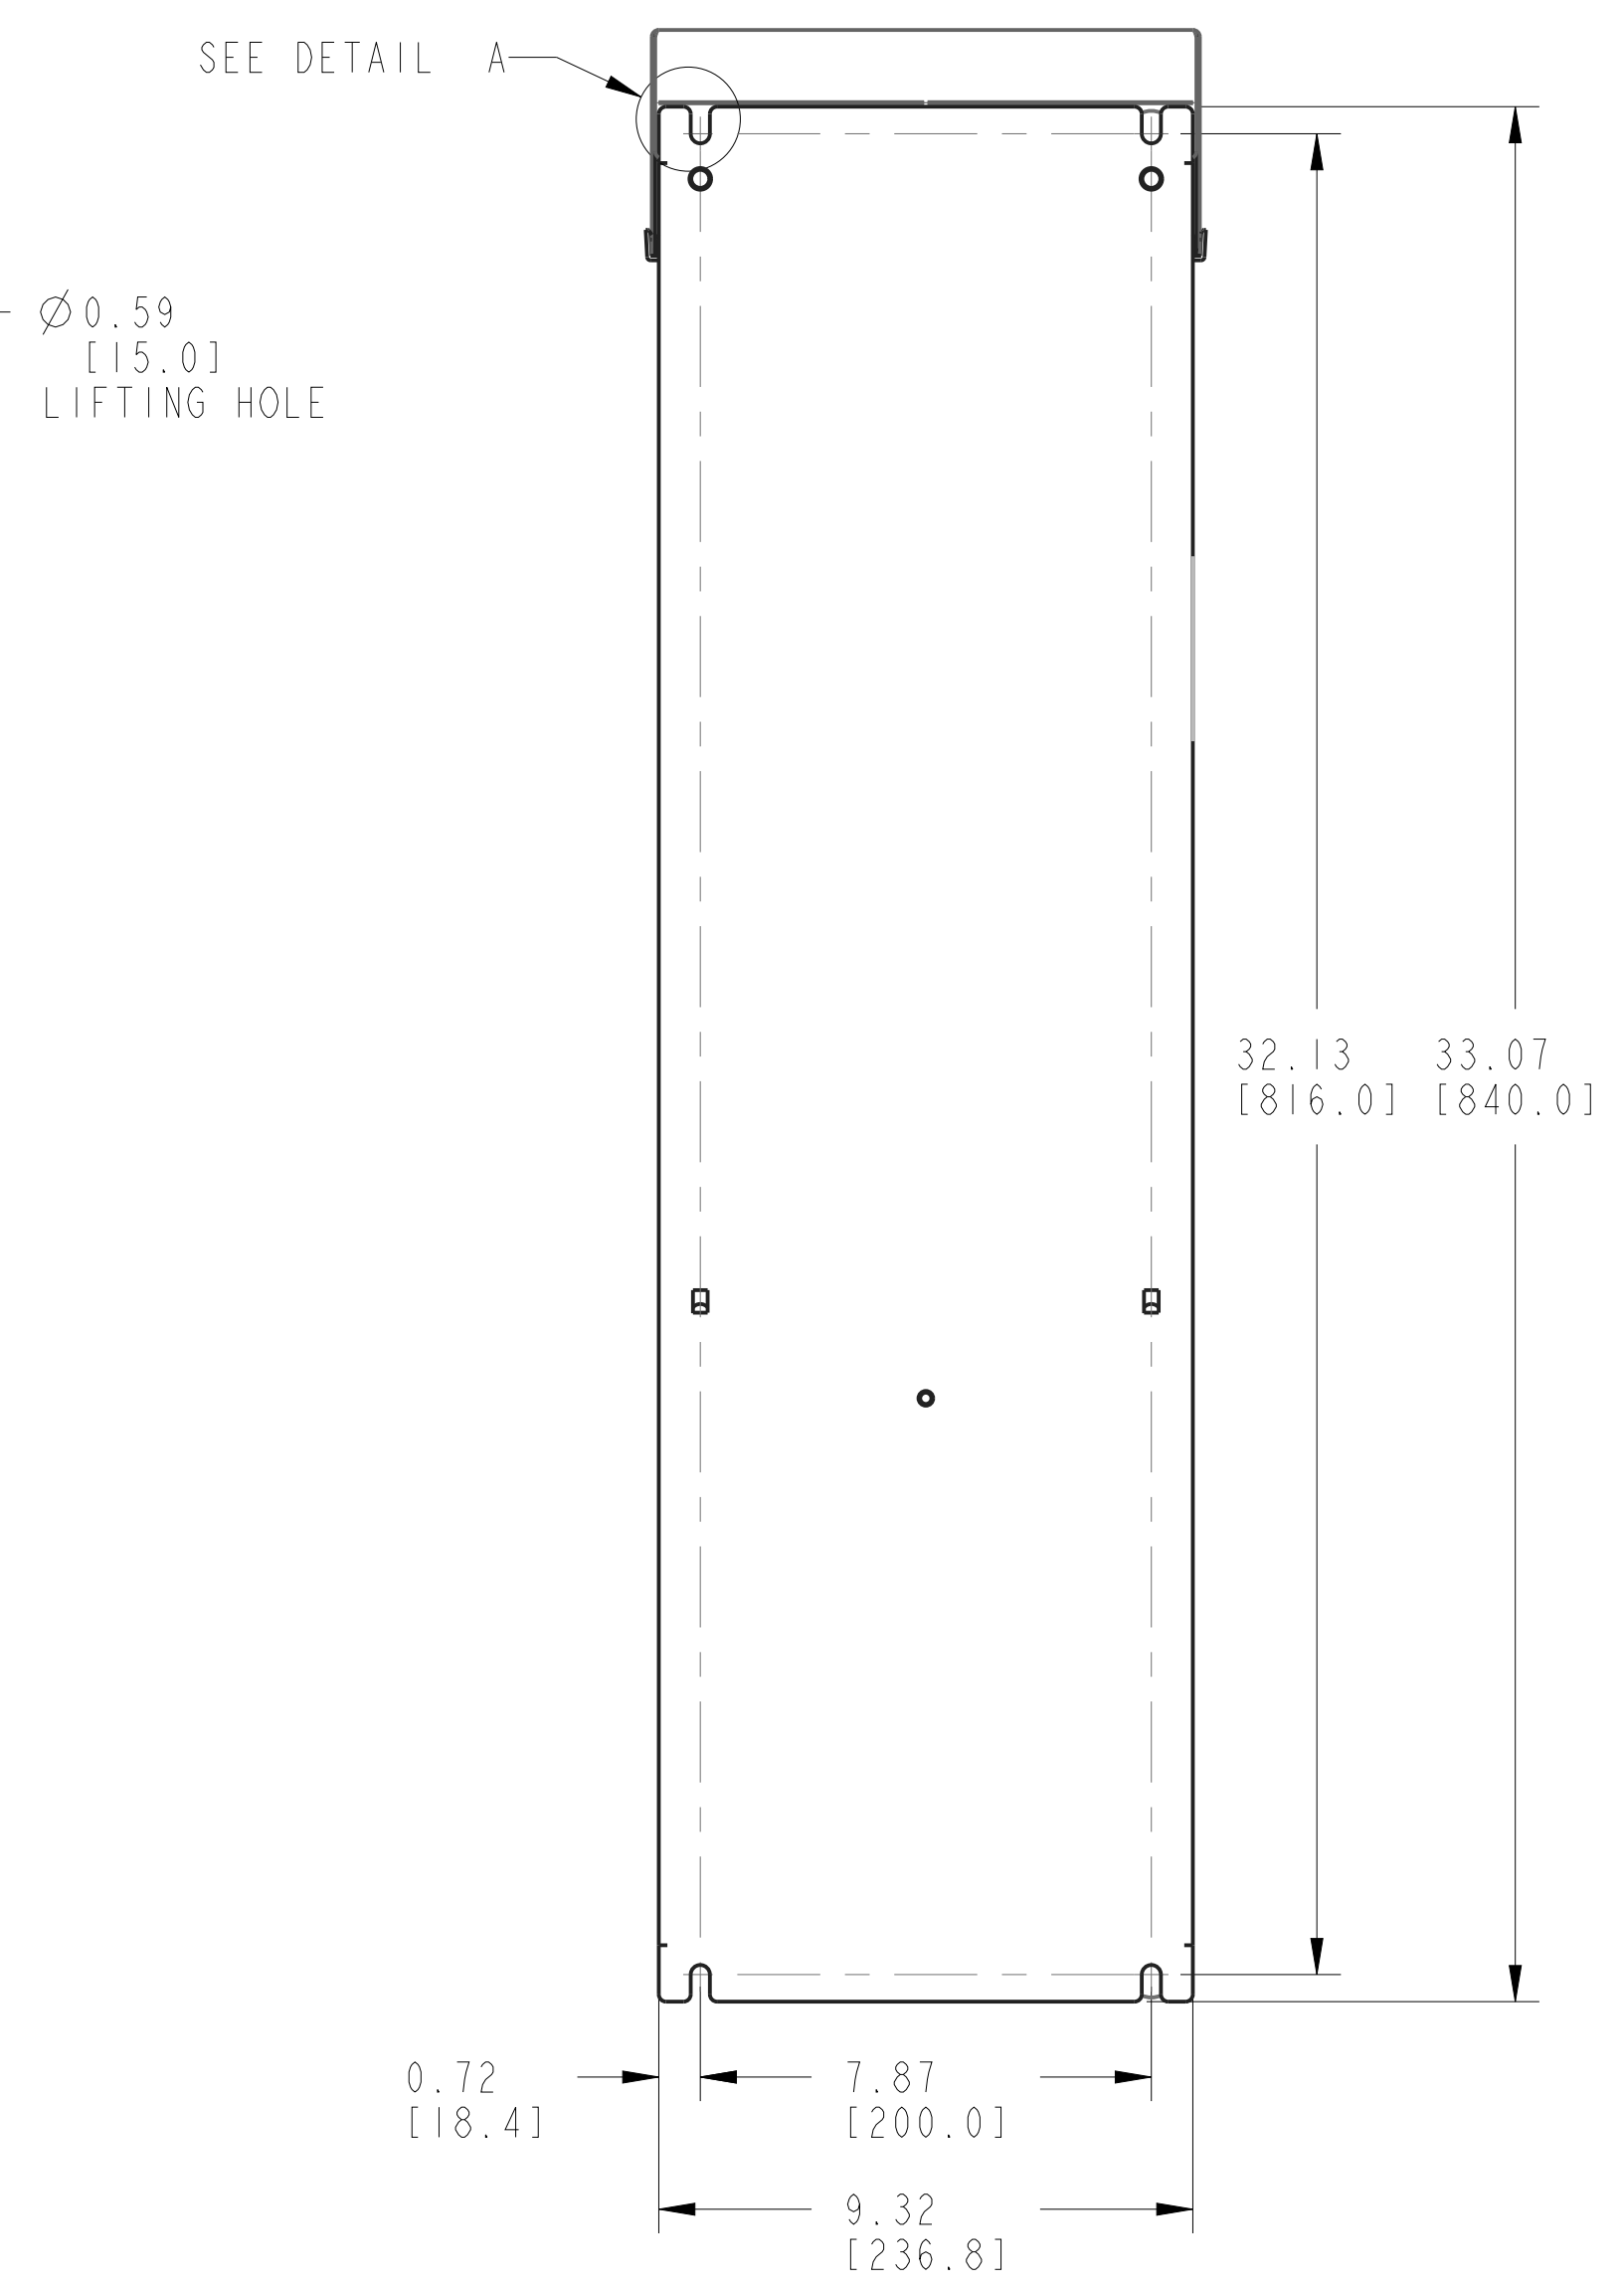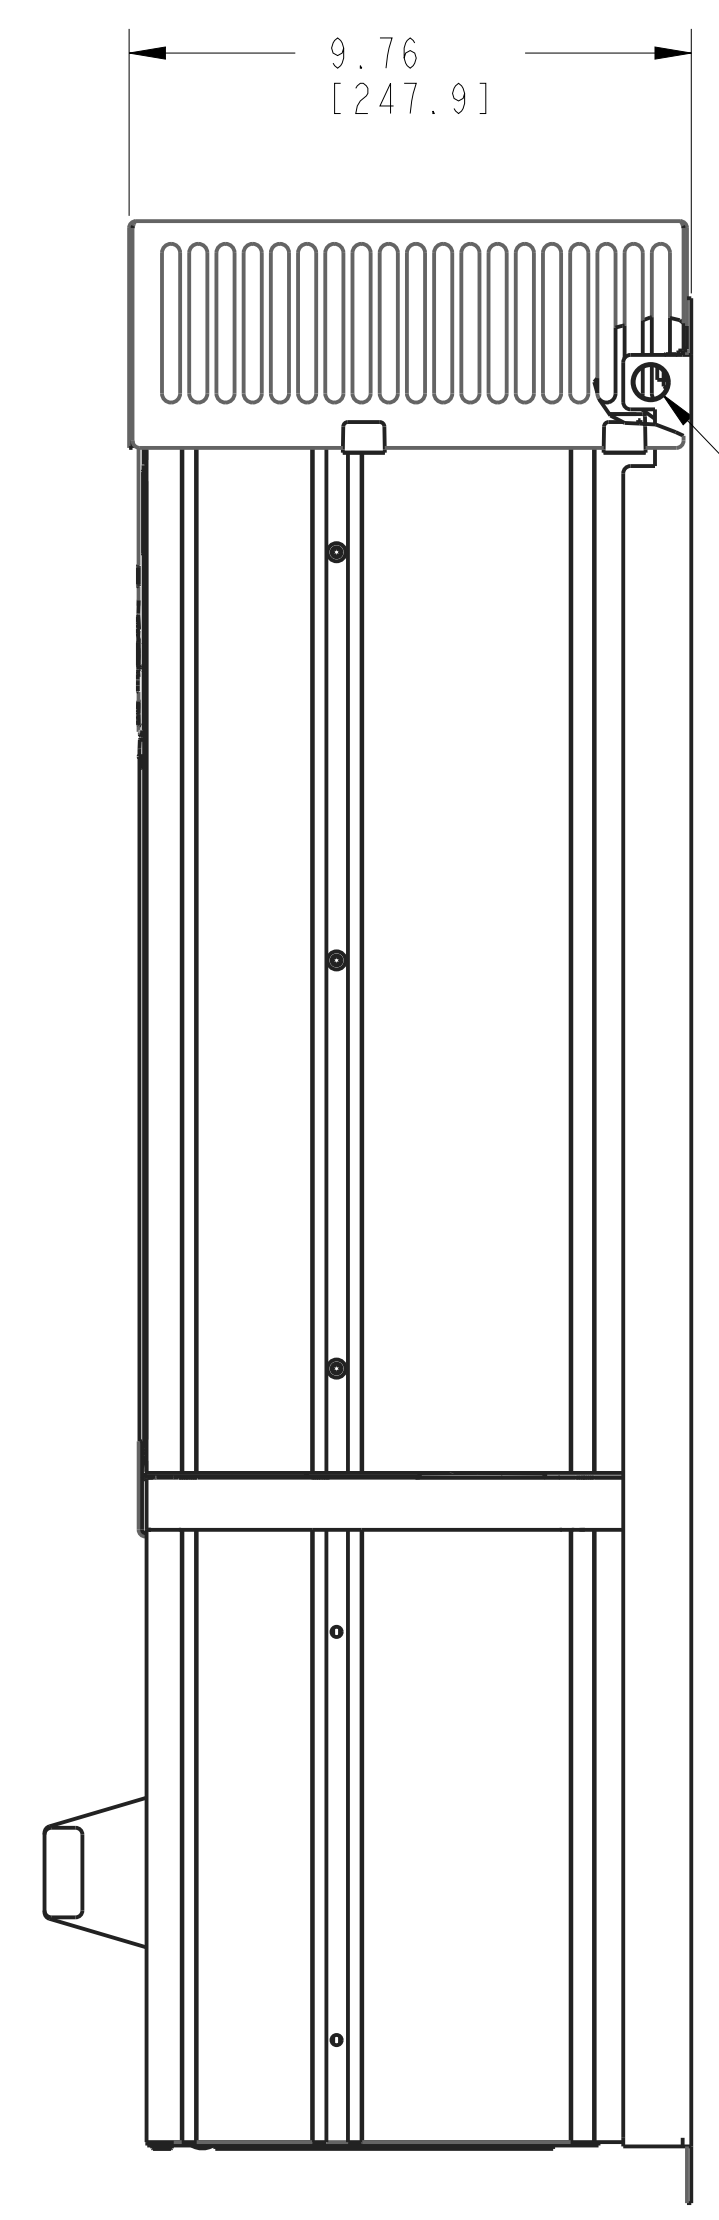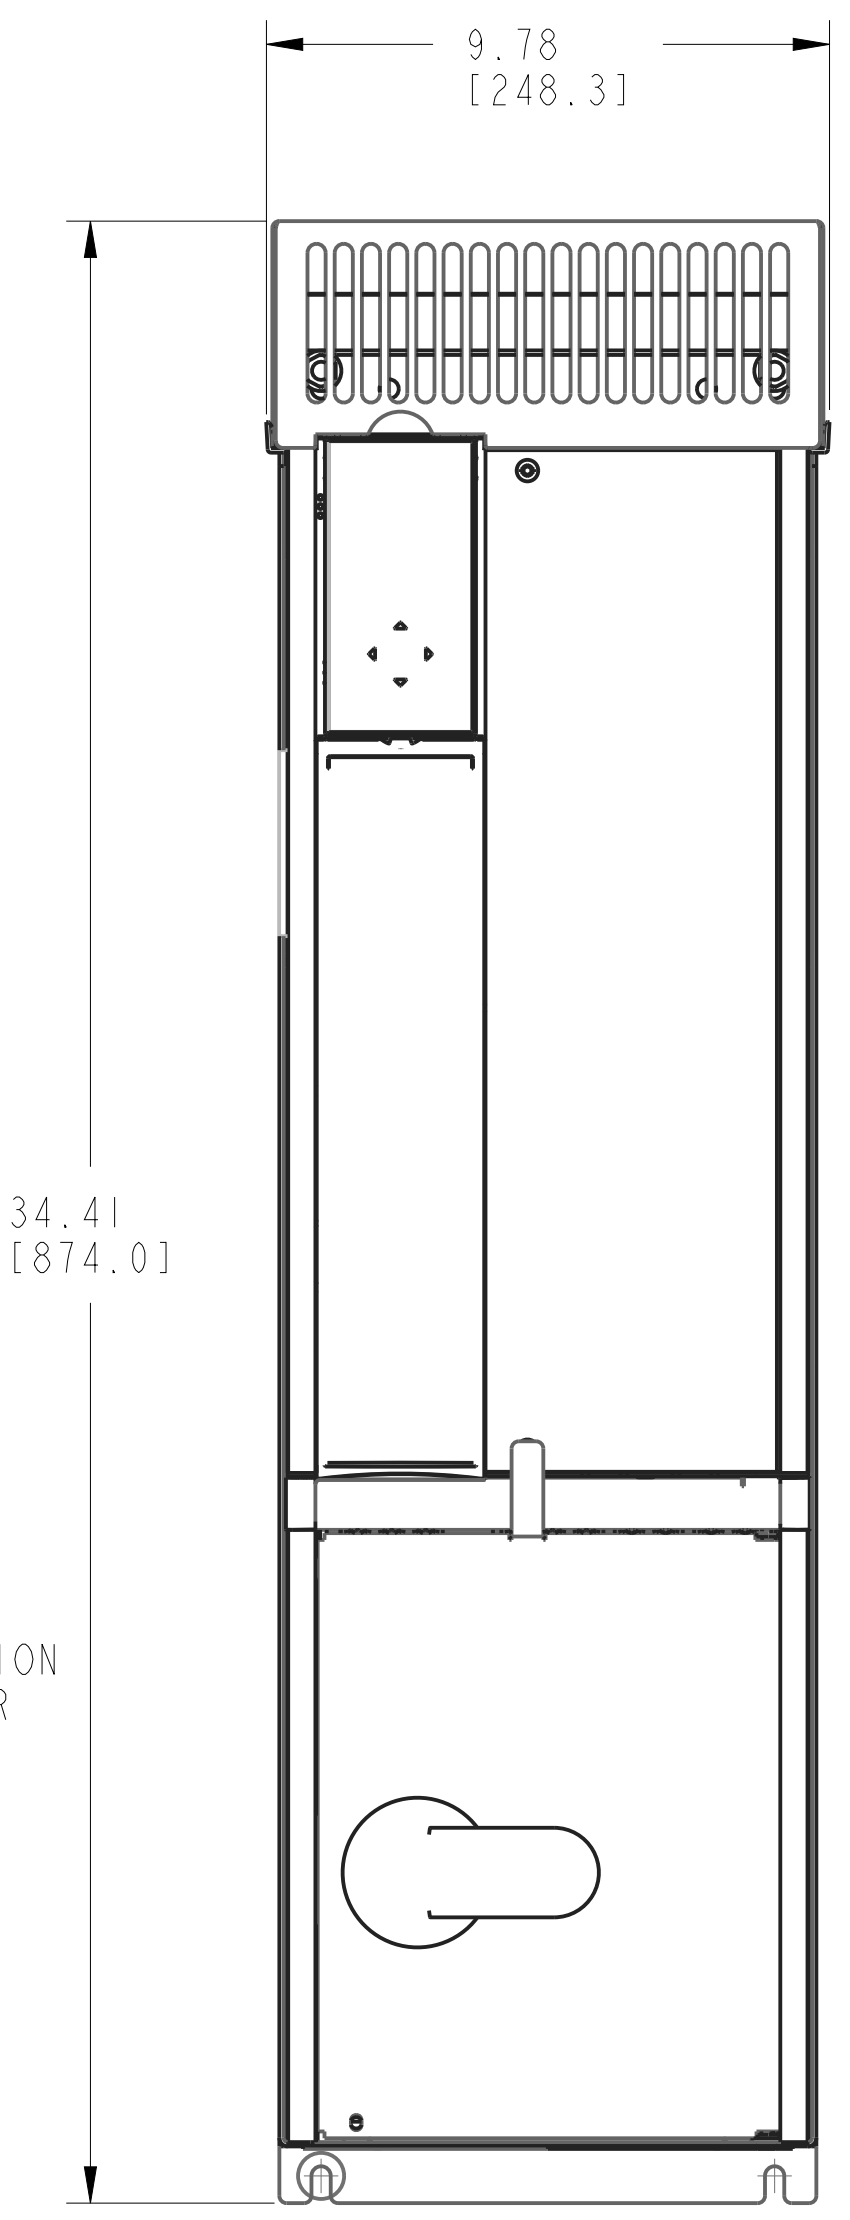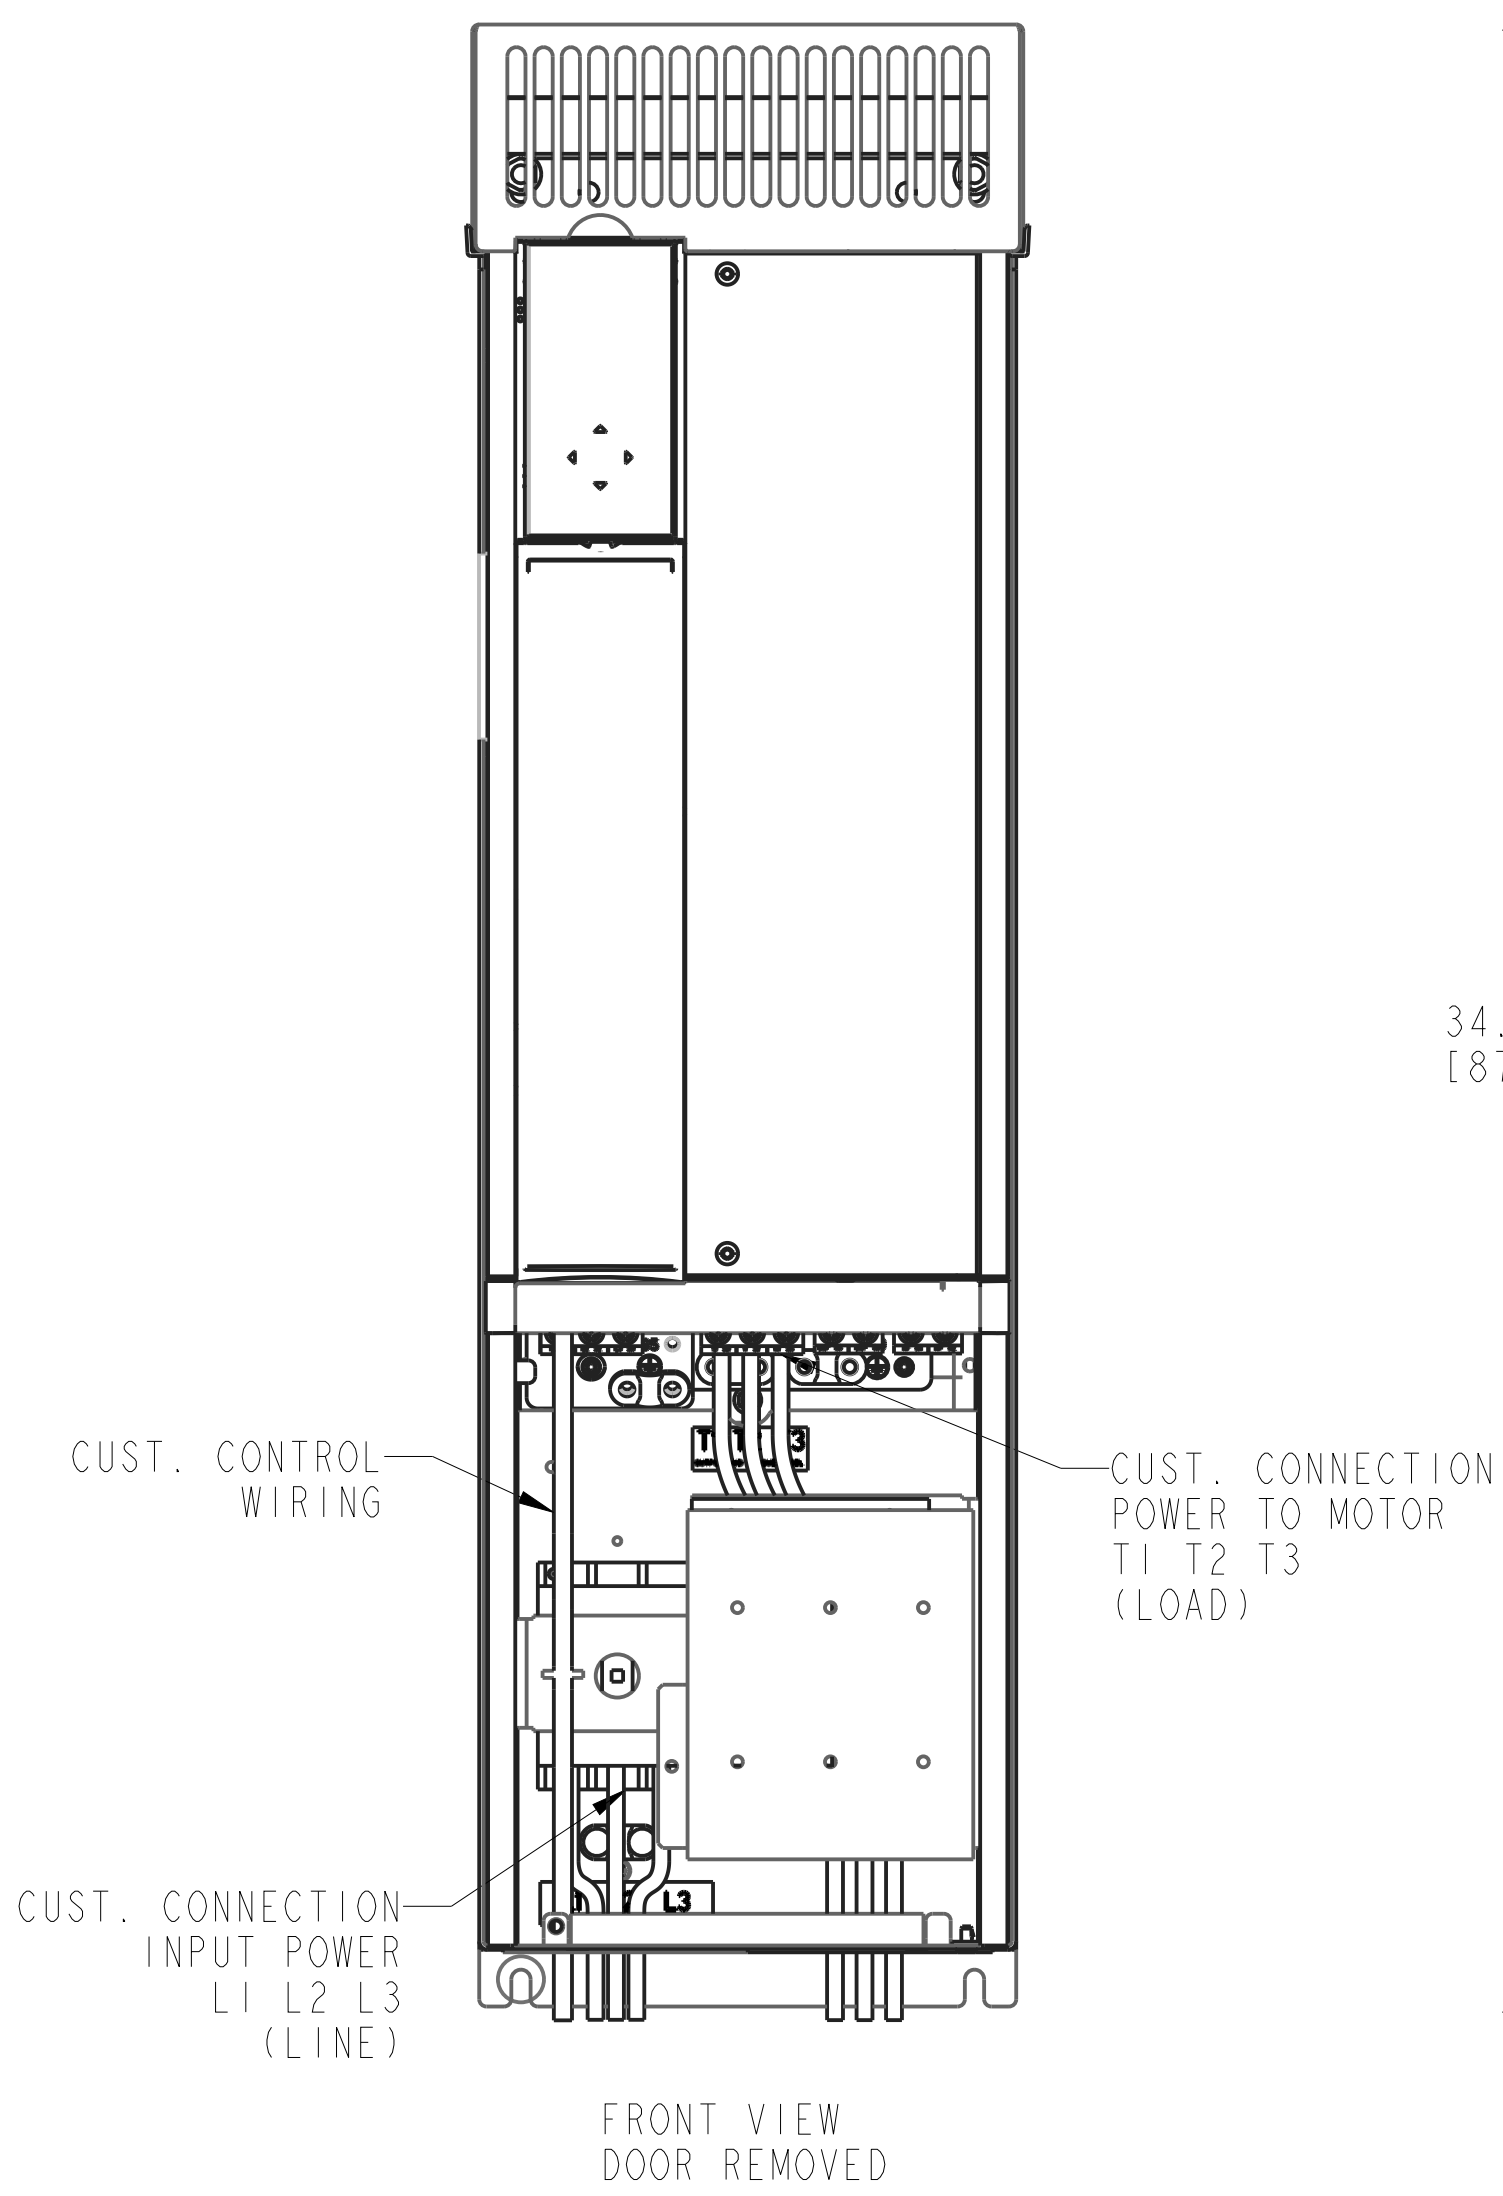

FRAME SIZE P3		
VOLTAGE	HP	KW
208	20	15
	25	18.5
230	20	15
	25	18.5
460	30	22
	40	30
	50	37
575	30	22
	40	30
	50	37