

DRAWING	REVISION	VERSION

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES. TOLERANCE:

.X = ± 0.1
 .XX = ± 0.03
 .XXX = ± 0.005

ANGLES = ± 2.0° HOLE DIA = :
 CONFORMS TO ASME Y14.5M-1994.

FINISH ✓

TRANE

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE

DRAWN BY: DK
 DATE: 03/28/11

DO NOT SCALE PRINT

THIRD ANGLE PROJECTION

177R0344

SHEET 1 OF 1 REV 004

DWG, SUBMITTAL, P3, BYPASS, TRANE







CLEARANCE REQUIREMENT FOR AIR FLOW COOLING:
 THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM CLEARANCE OF 7.87" [200mm] ON THE BOTTOM AND 2.00" [50.8 mm] ON THE TOP FOR UNIT COOLING.

D

C

B

A

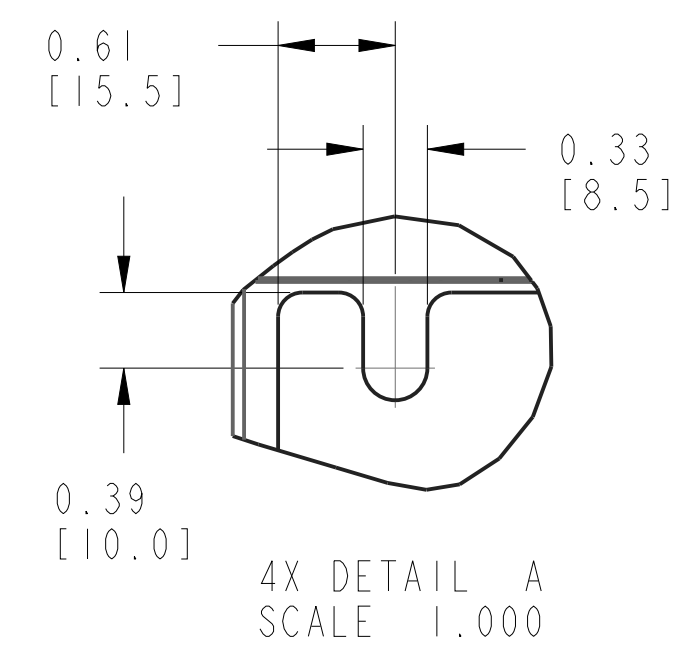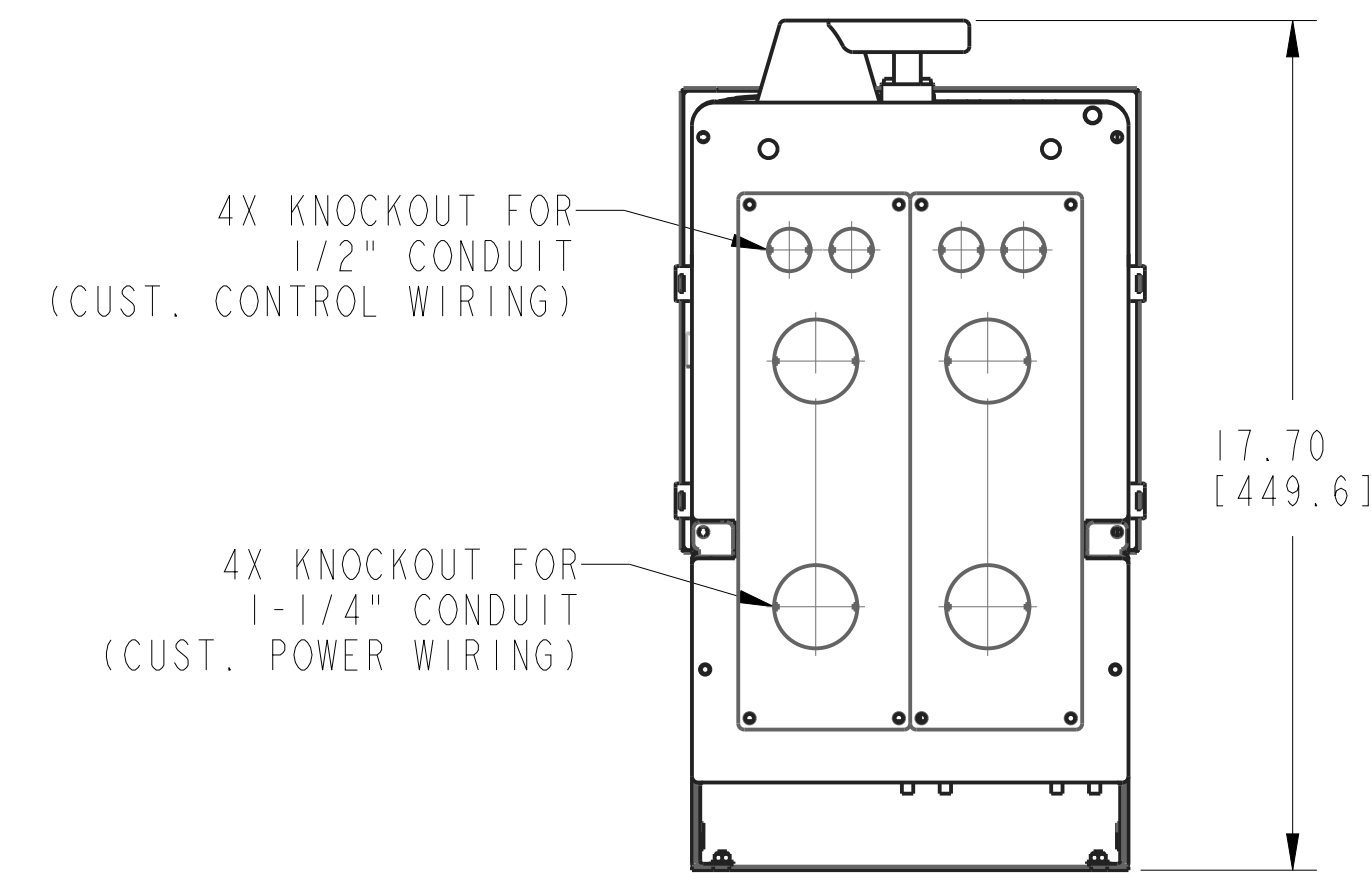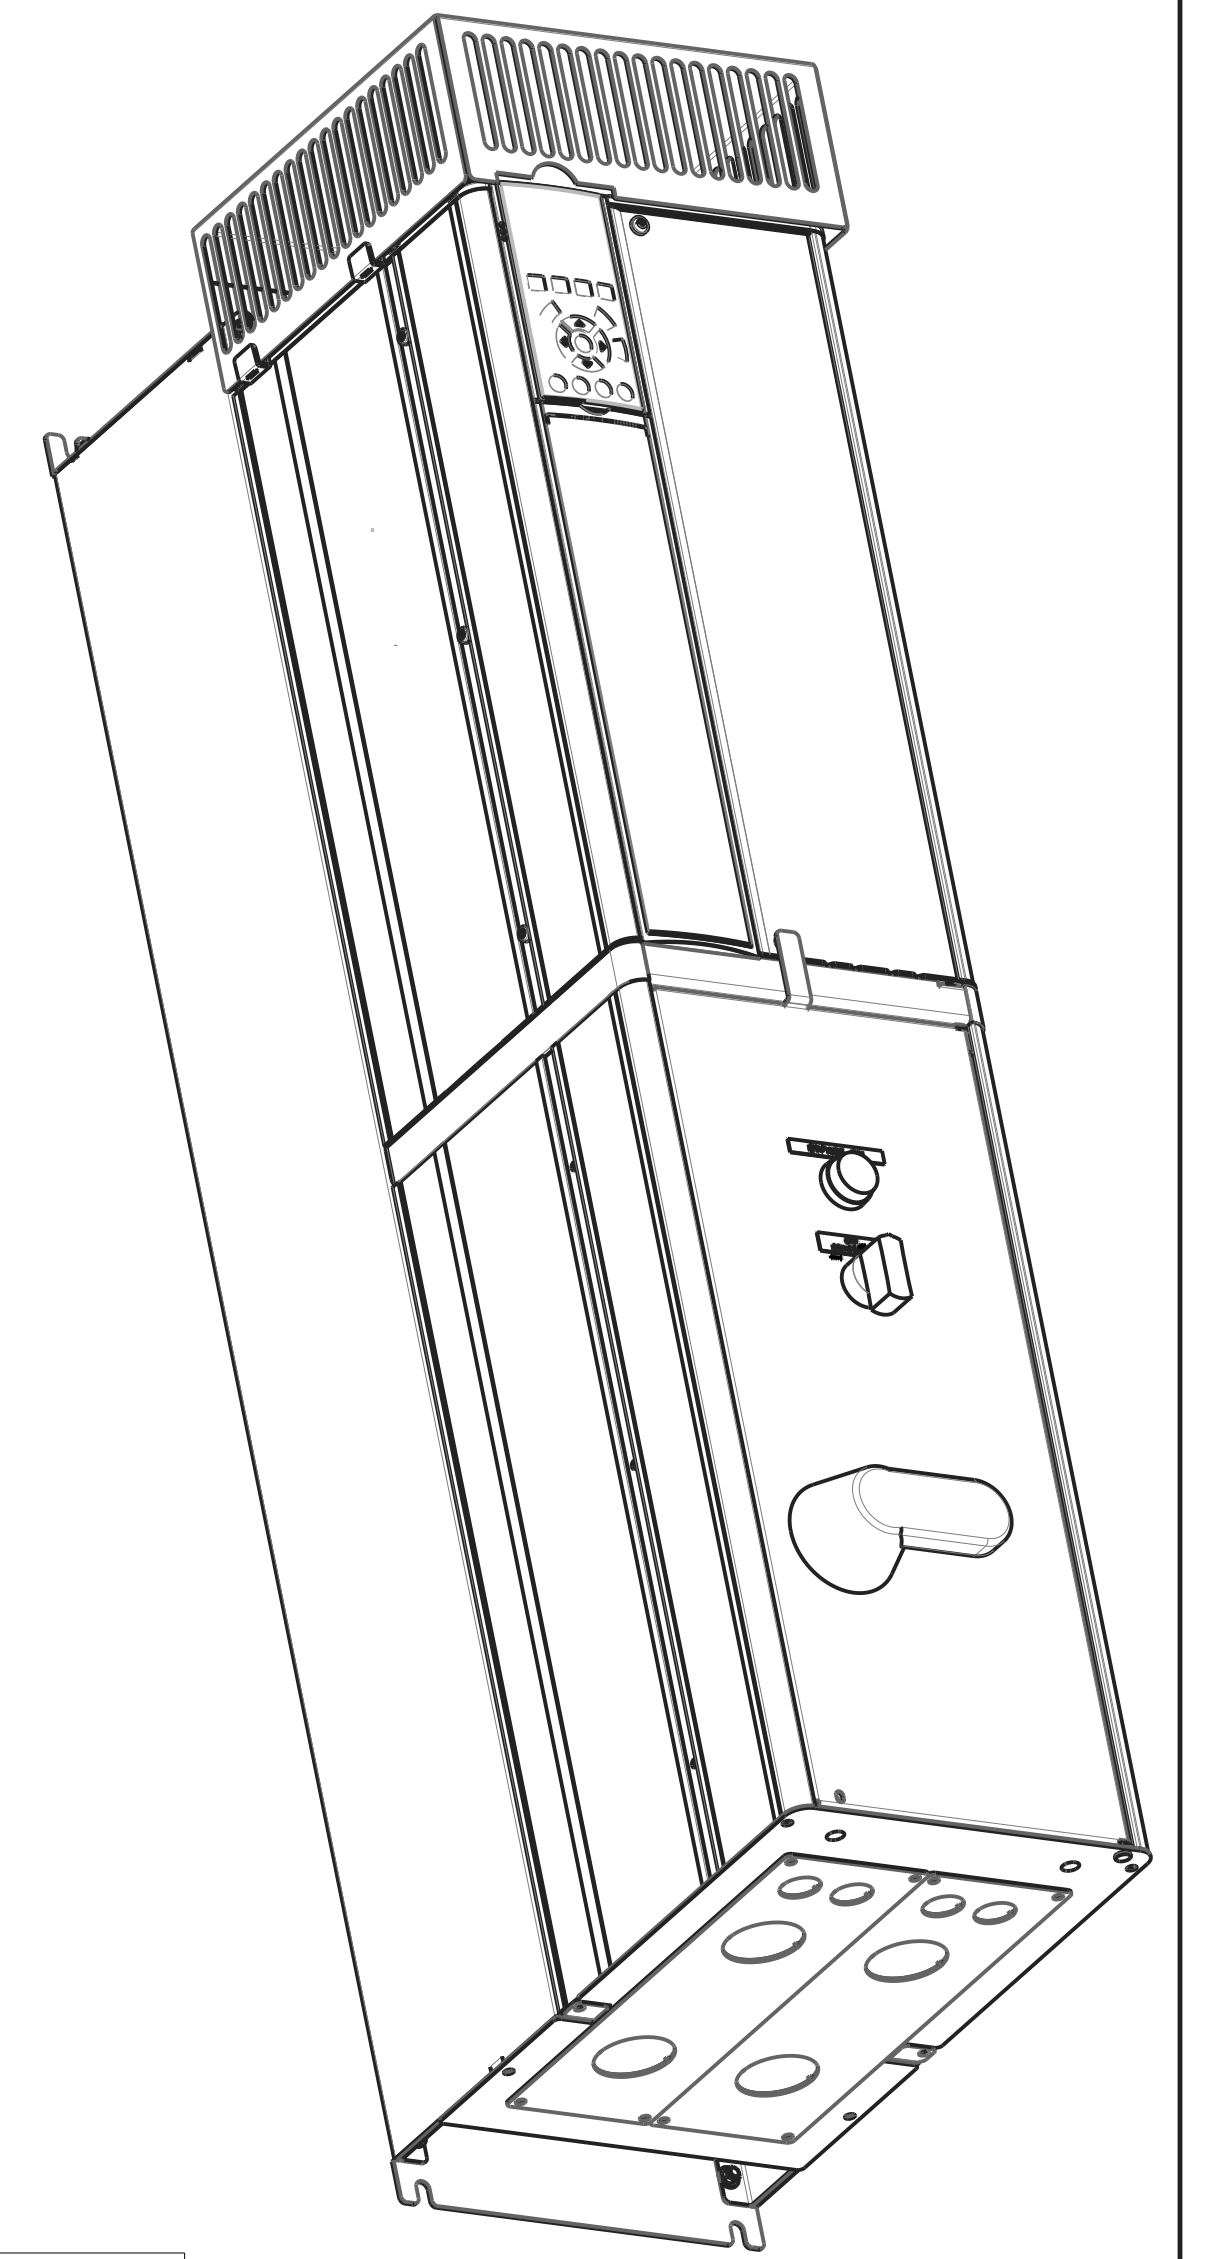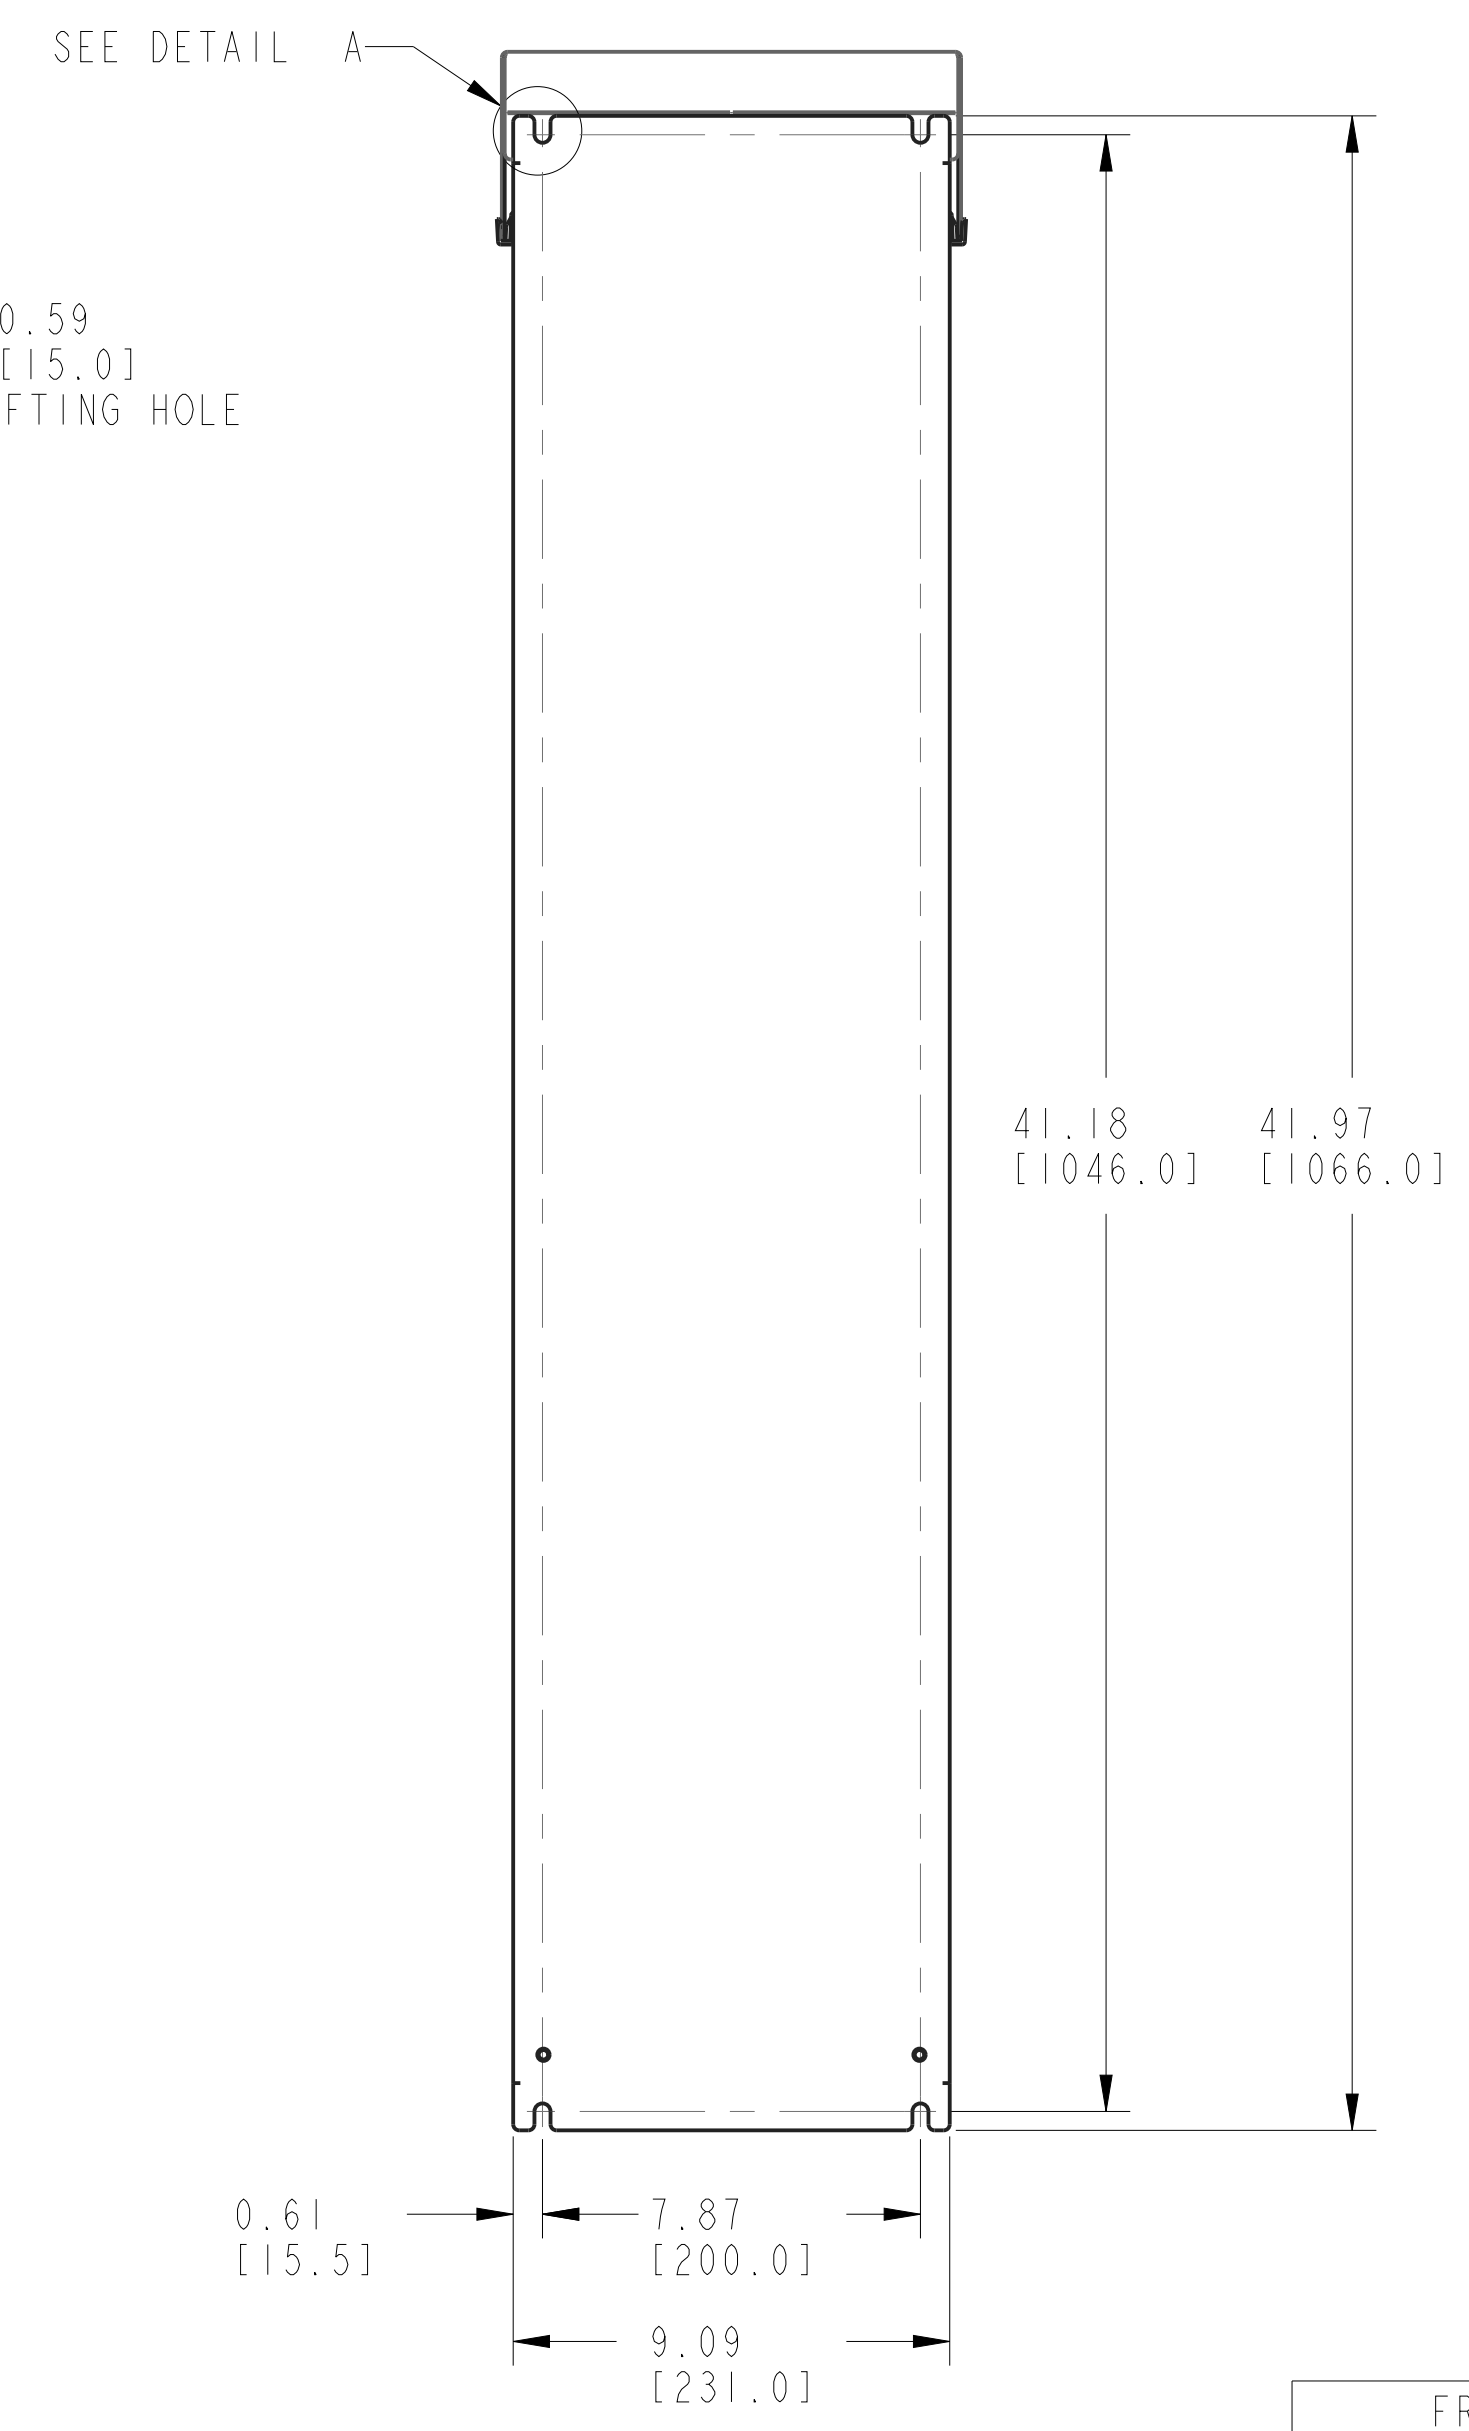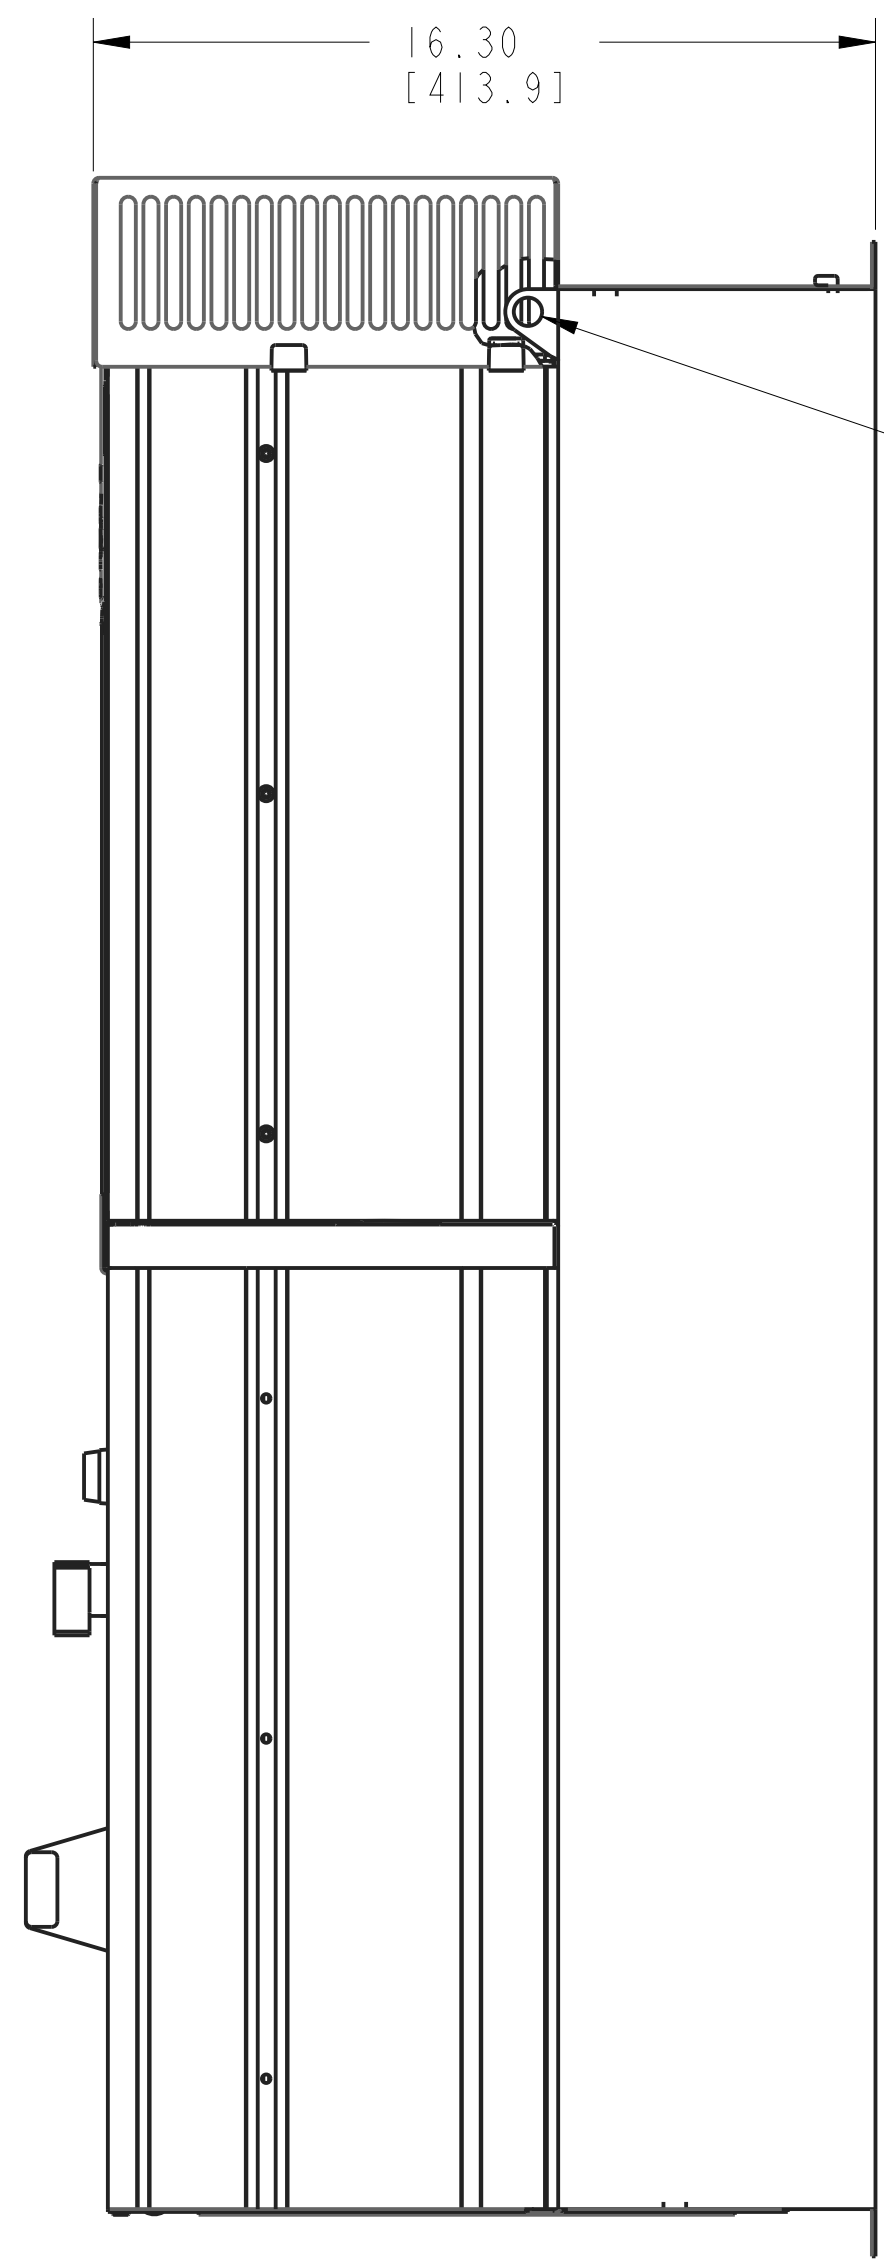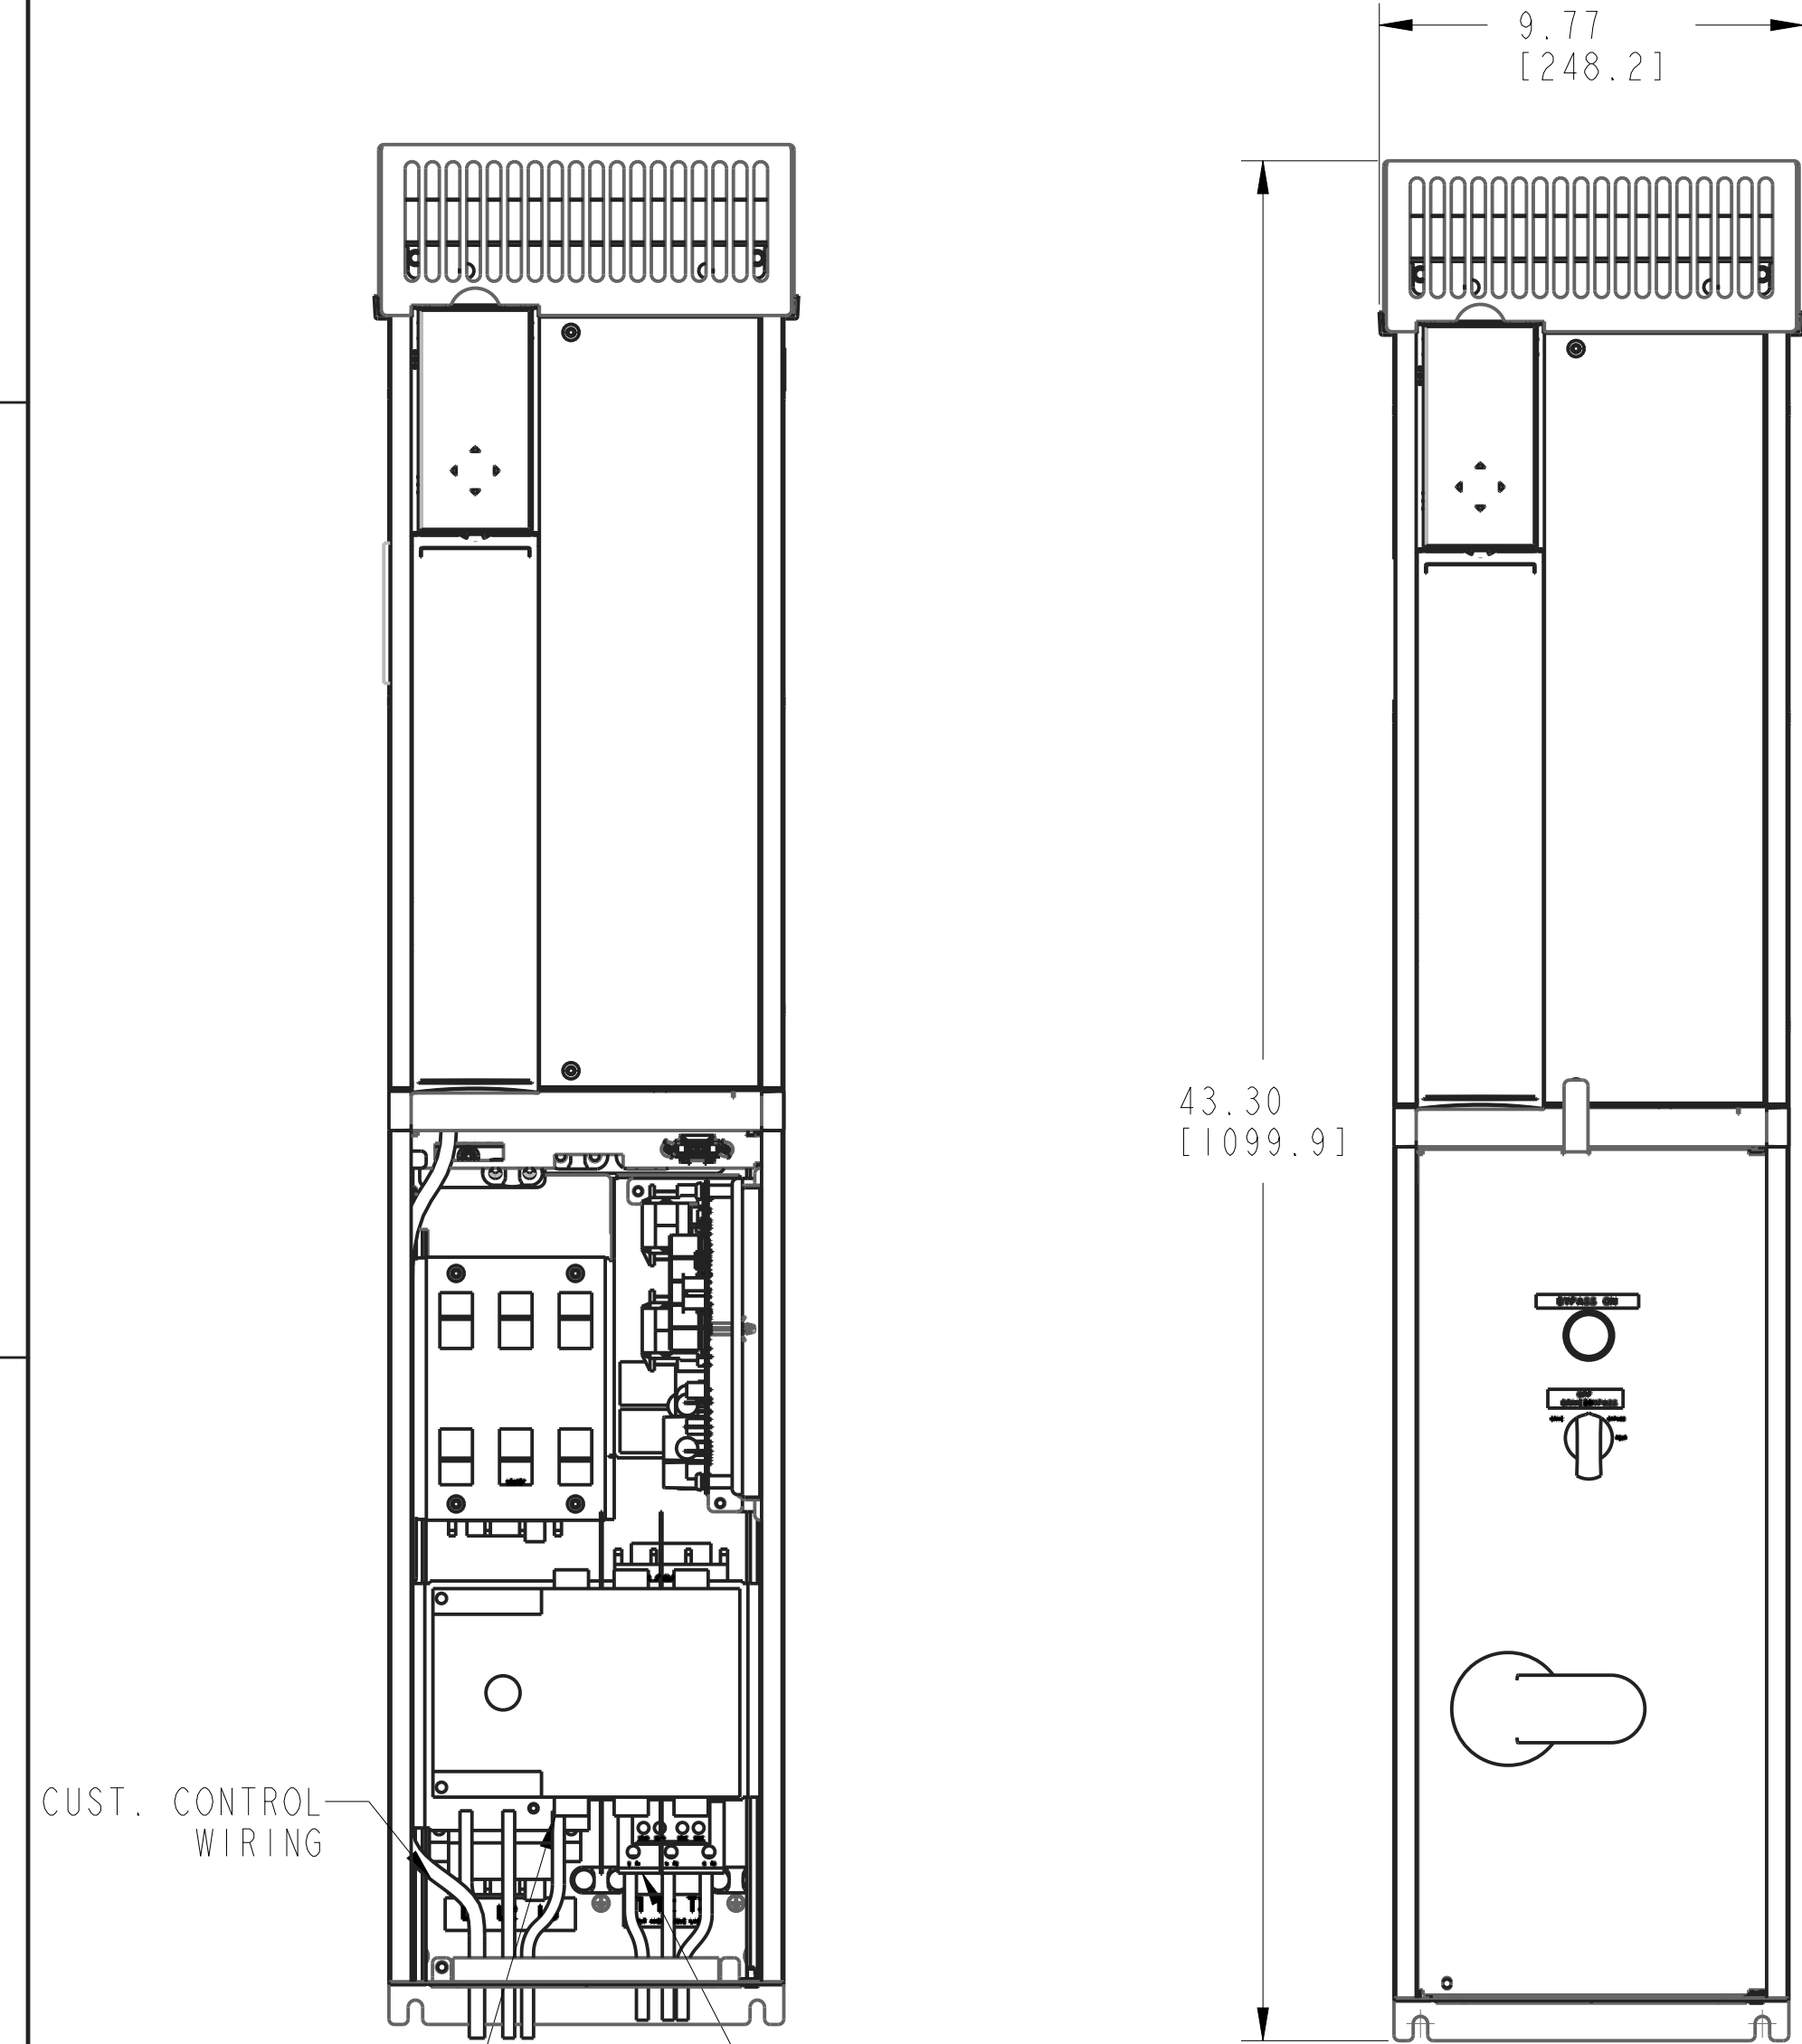

FRAME SIZE P3		
VOLTAGE	HP	KW
208	20	15
	25	18.5
460	30	22
	40	30
	50	37
575	30	22
	40	30
	50	37