

| REVISION | VERSION |
|----------|---------|
| DRAWING  |         |

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES. TOLERANCE:

X ± 0.1  
 XX ± 0.03  
 XXX ± 0.005

ANGLES ± 2.0° HOLE DIA = +  
 CONFORMS TO ASME Y14.5M-1994.

FINISH ✓

**TRANE**

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE

DRAWN BY: DK TRANE DATE: 03/28/11

DO NOT SCALE PRINT THIRD ANGLE PROJECTION

177R0345 SHEET 1 OF 1 REV 002

DWG, SUBMITTAL, P4, NON-BYPASS, TRANE




CLEARANCE REQUIREMENT FOR AIR FLOW COOLING:  
 THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM CLEARANCE OF 7.87" [200mm] ON THE BOTTOM AND 2.00" [50.8mm] ON THE TOP FOR UNIT COOLING.

D

C

B

A

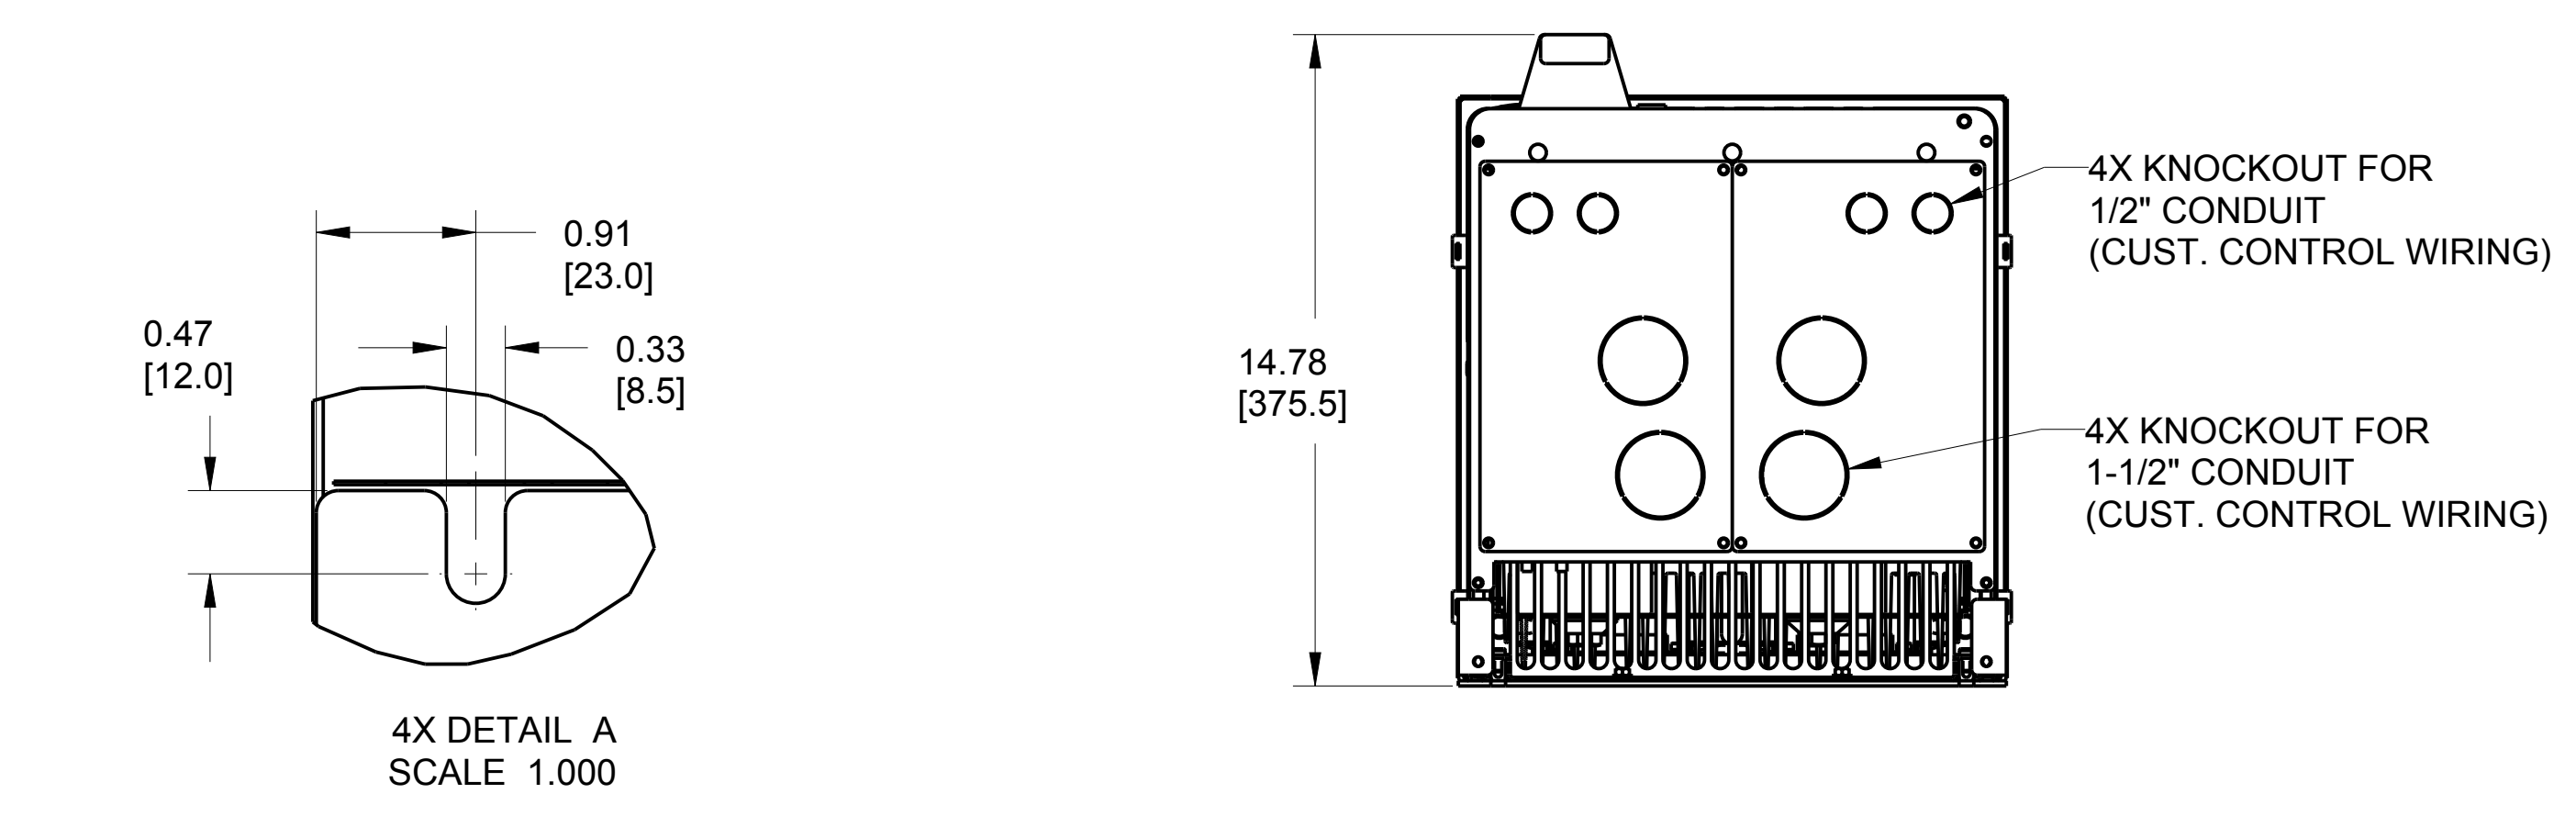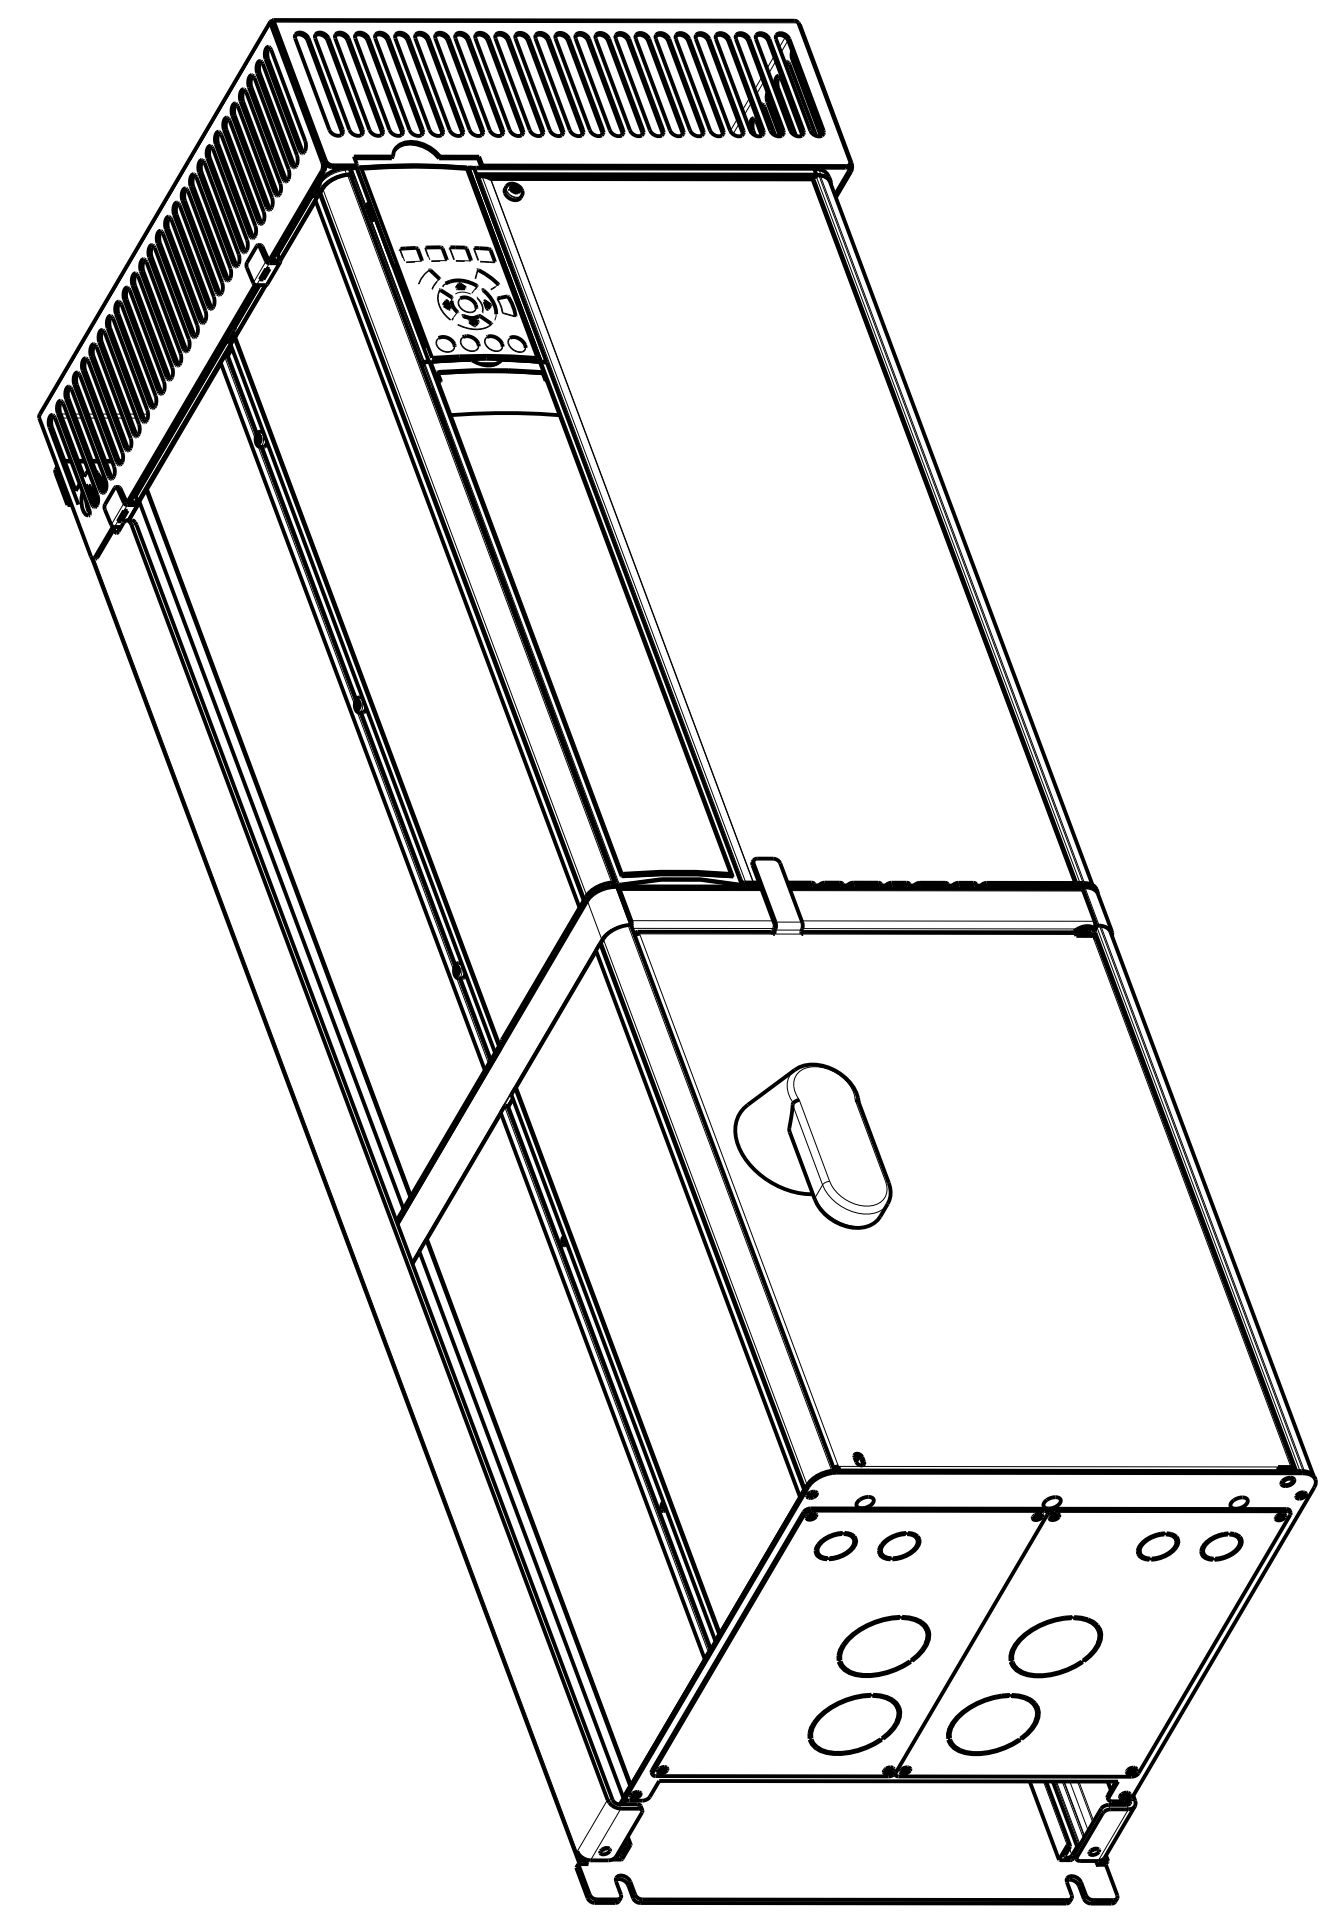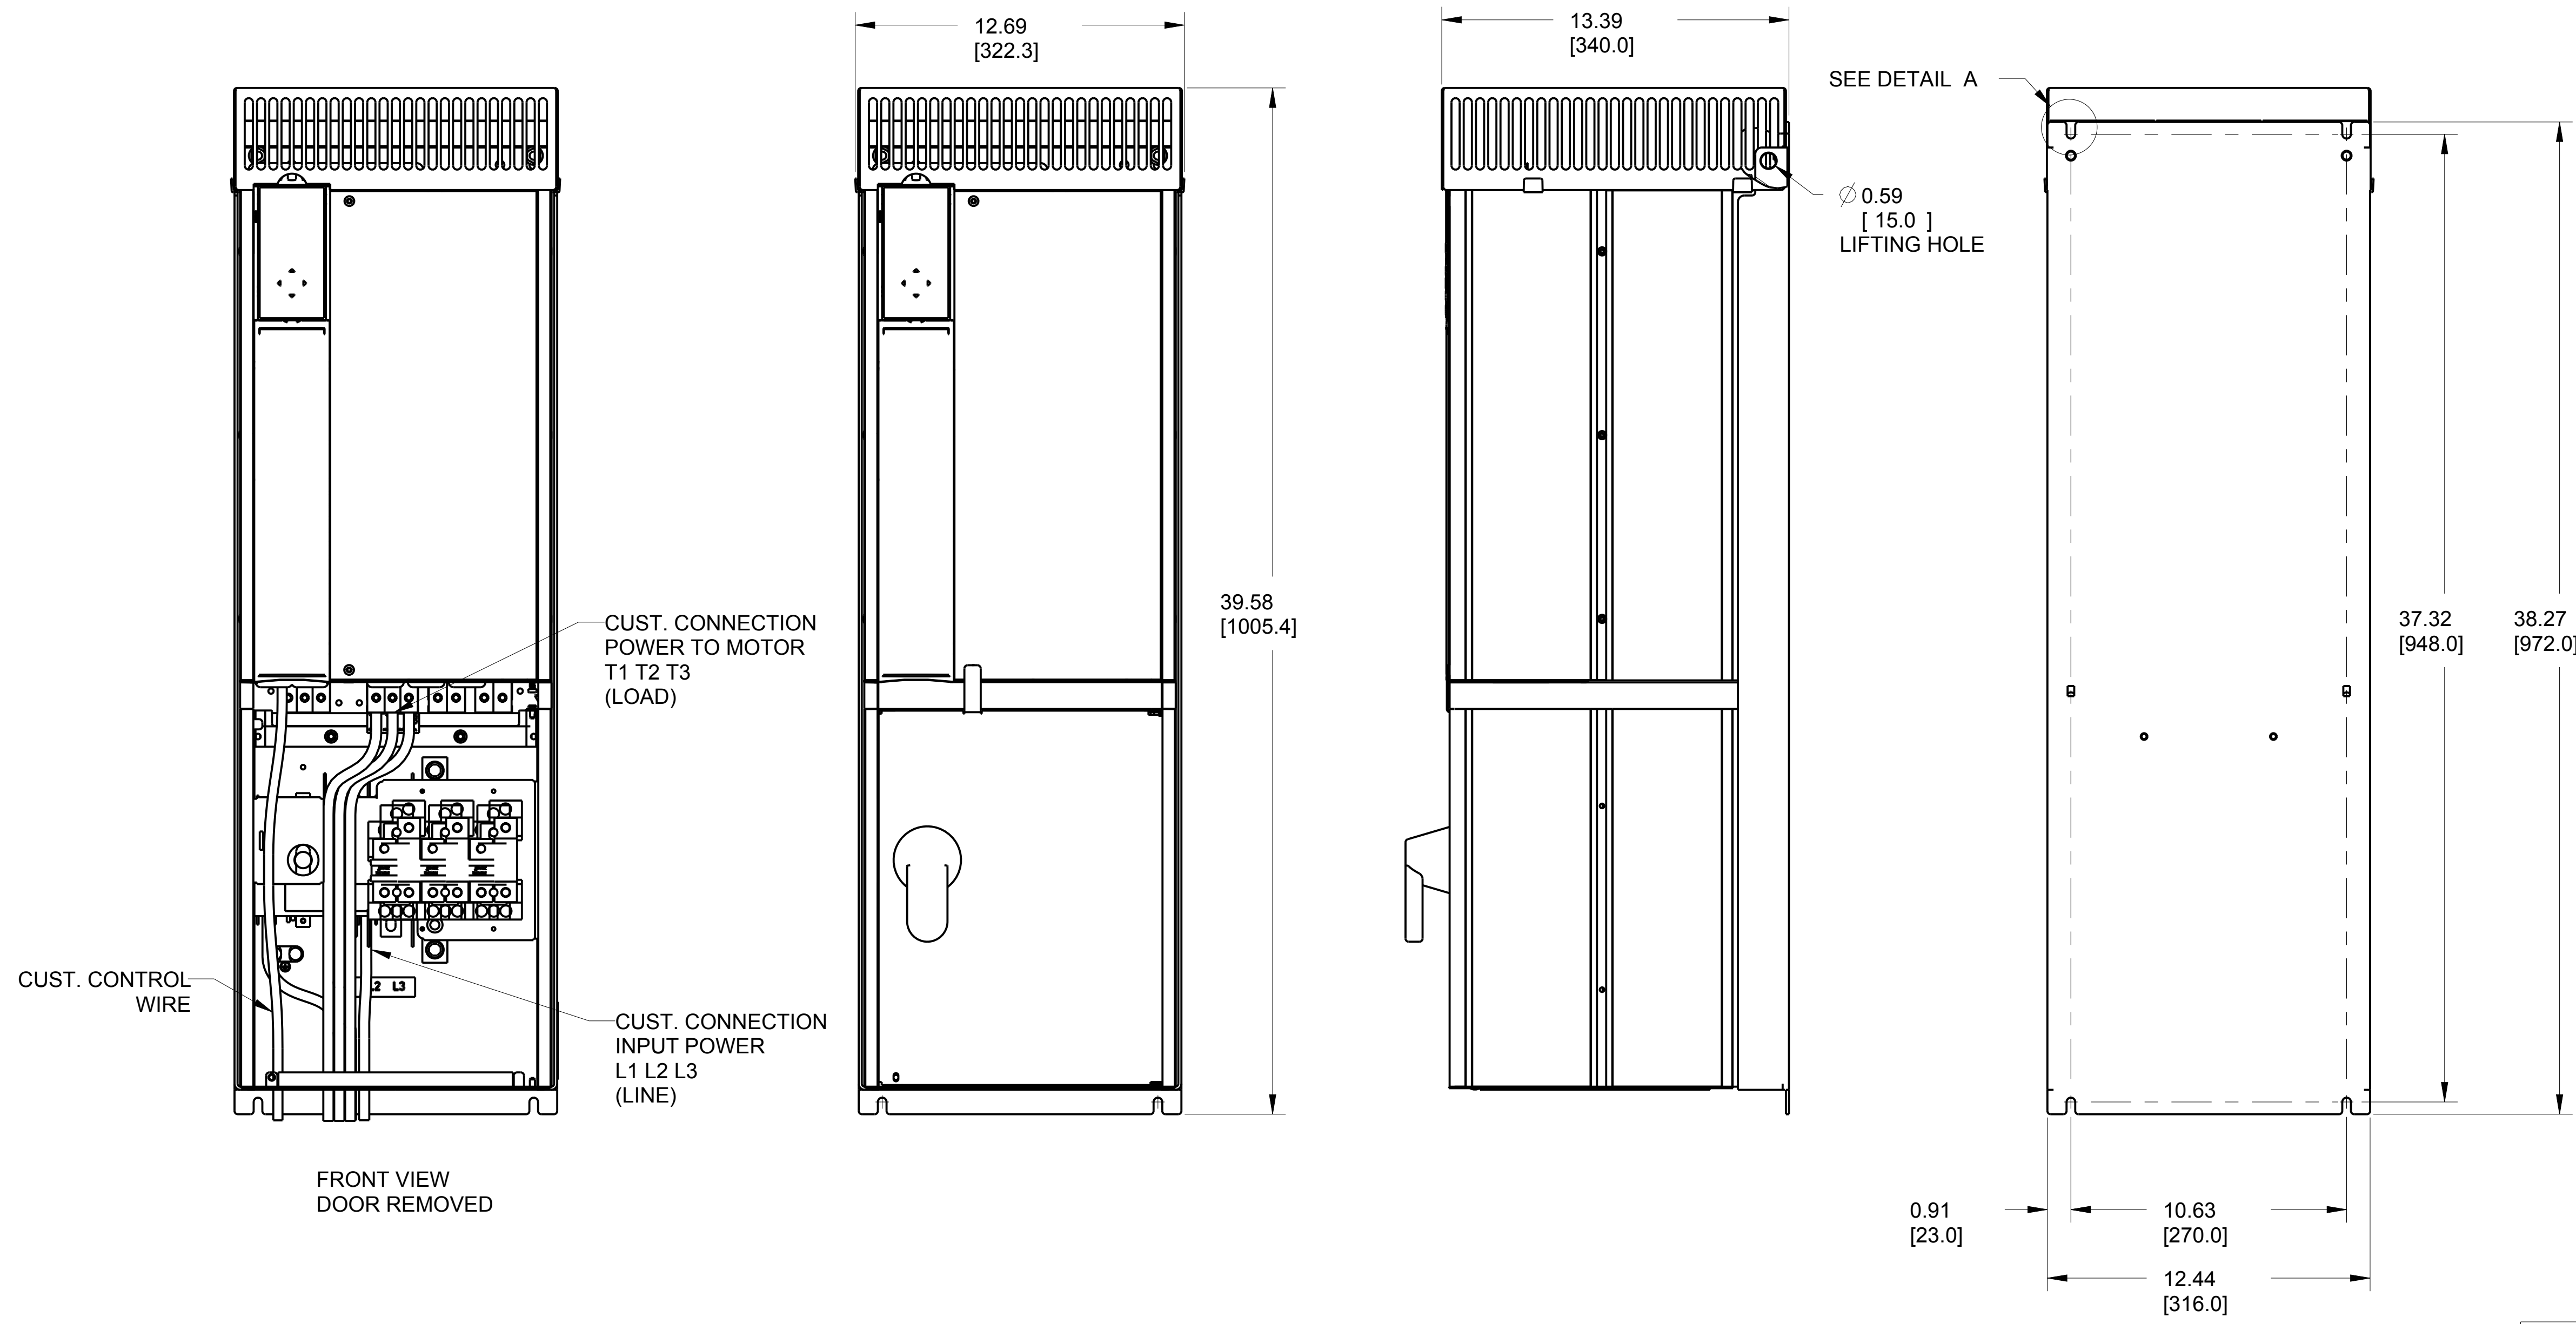

| FRAME SIZE P4 |    |    |
|---------------|----|----|
| VOLTAGE       | HP | KW |
| 208           | 30 | 22 |
|               | 40 | 30 |
| 230           | 30 | 22 |
|               | 40 | 30 |
| 460           | 60 | 45 |
|               | 75 | 55 |
| 575           | 60 | 45 |
|               | 75 | 55 |