

DRAWING	REVISION	VERSION

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES. TOLERANCE:

X ± 0.1  
 XX ± 0.03  
 XXX ± 0.005

FINISH ✓

ANGLES ± 2.0° HOLE DIA = +

CONFORMS TO ASME Y14.5M-1994.

**TRANE**

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE

DRAWN BY: DK TRANE DATE: 03/28/11




DO NOT SCALE PRINT

THIRD ANGLE PROJECTION




177R0346 SHEET 1 OF 1 REV 003

DWG.SUBMITTAL\_P4\_BYPASS\_TRANE

D  
C  
B  
A

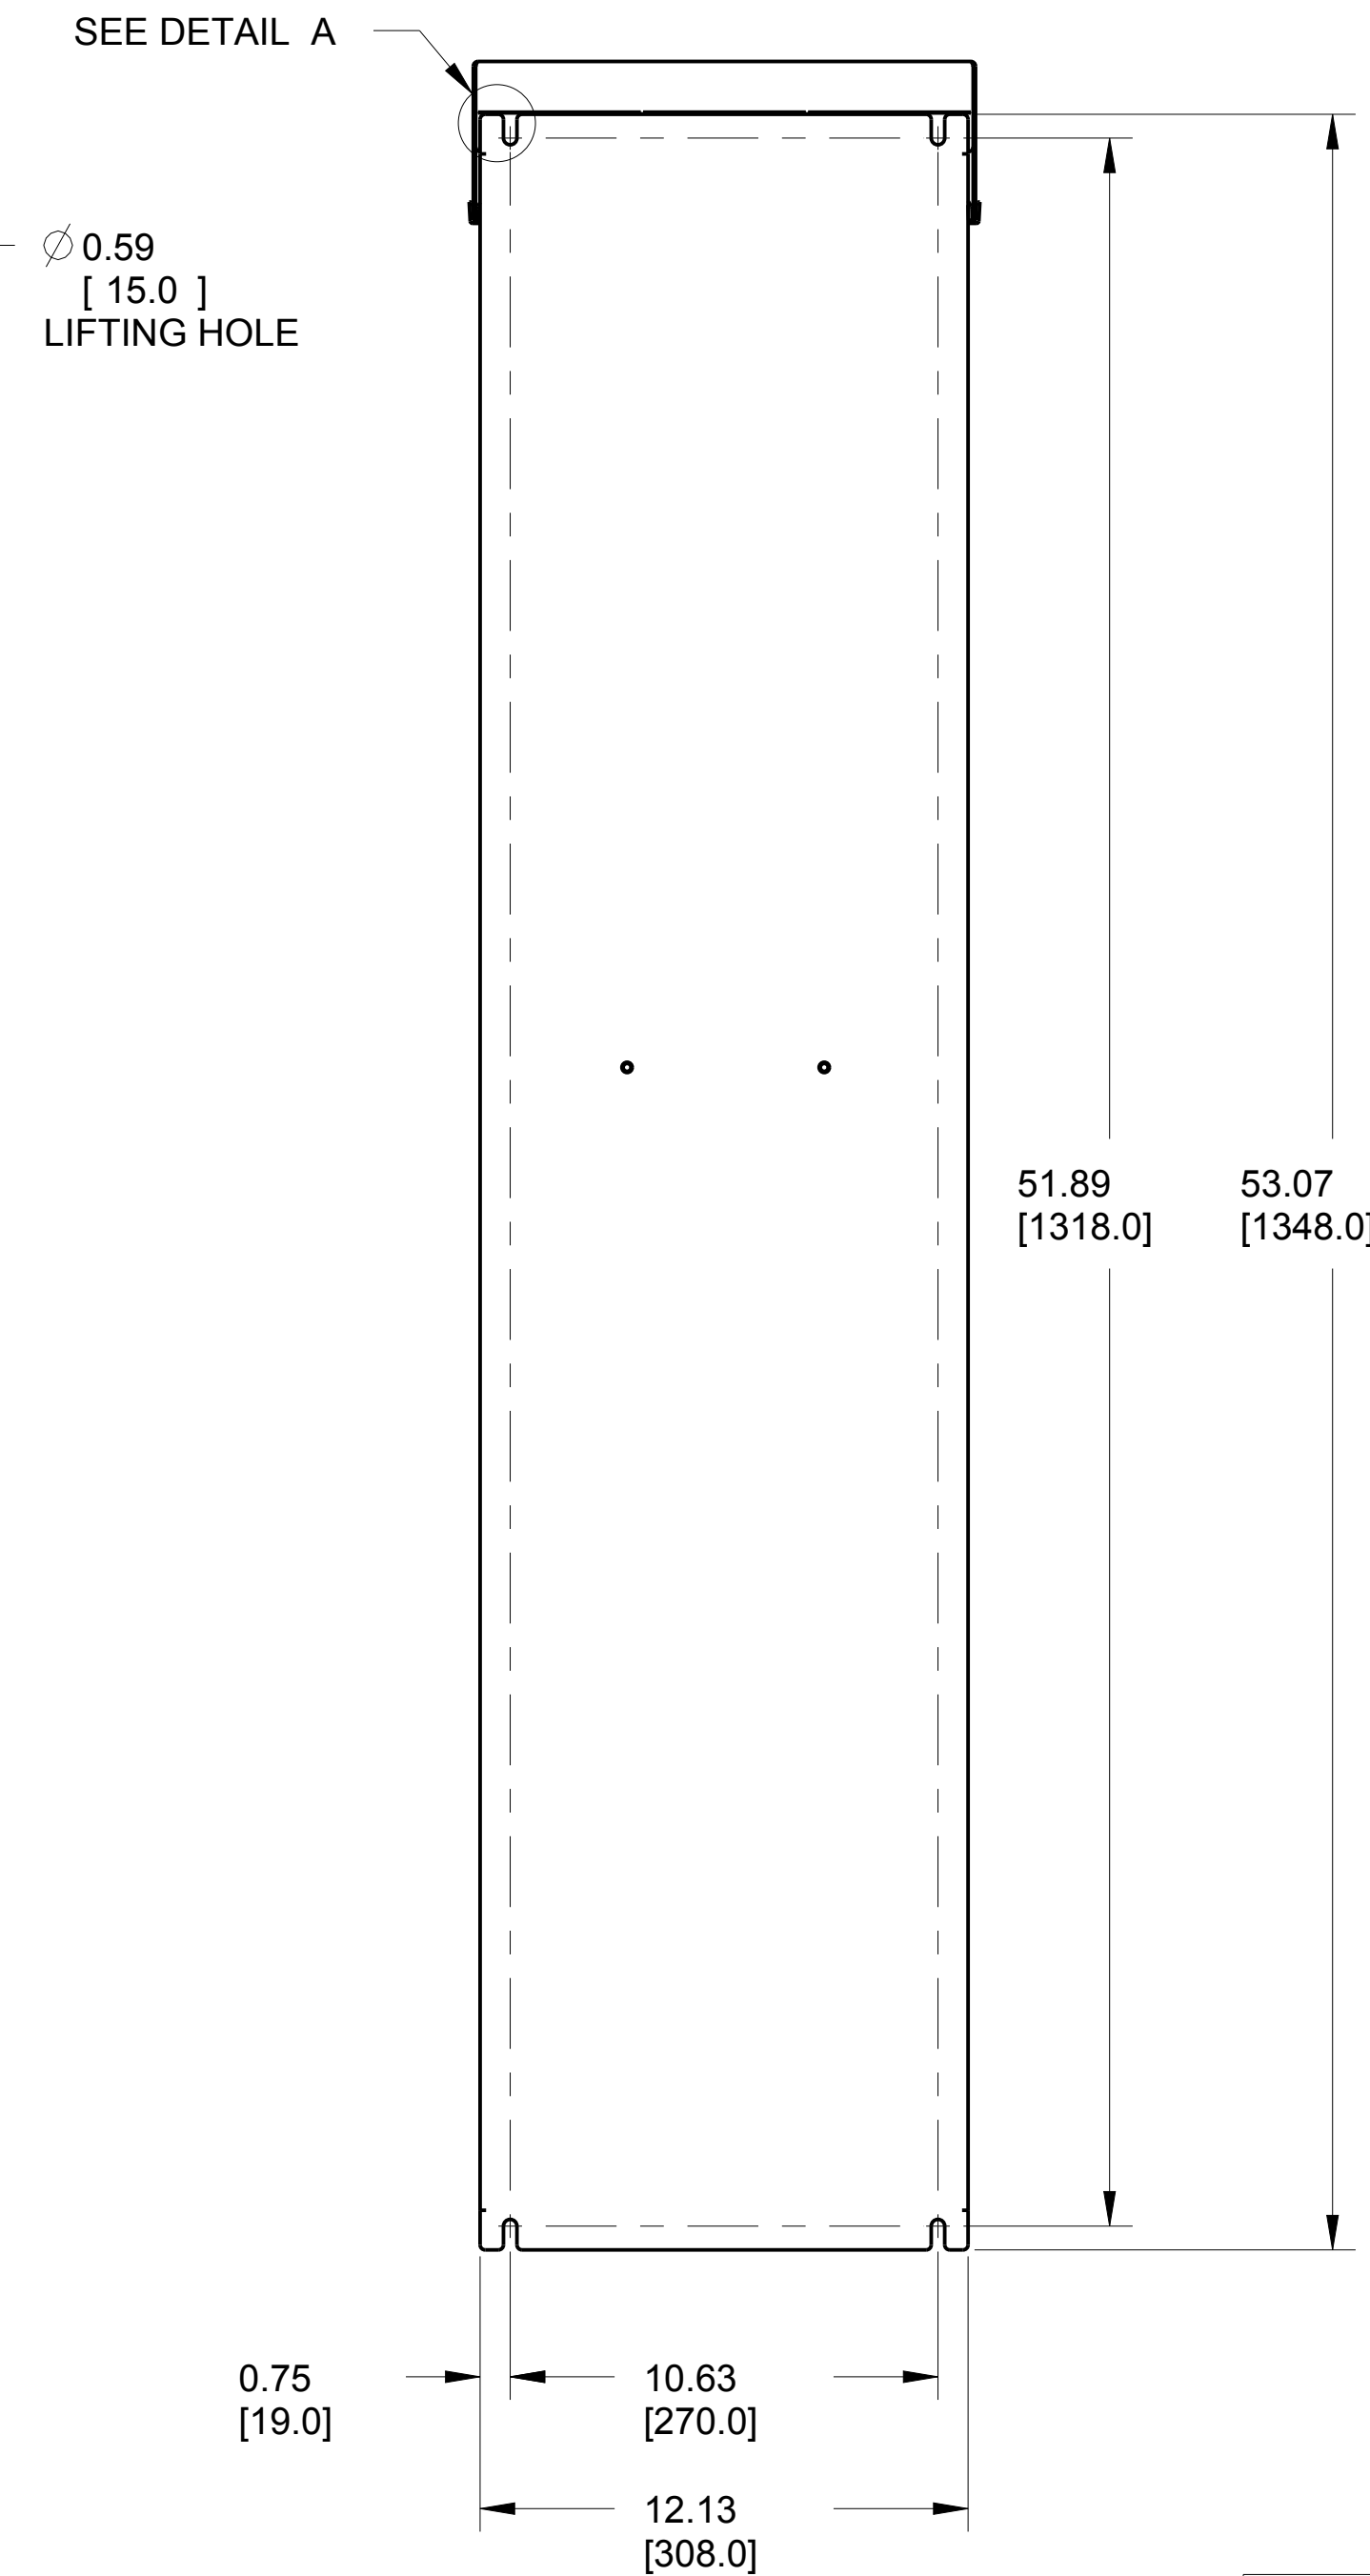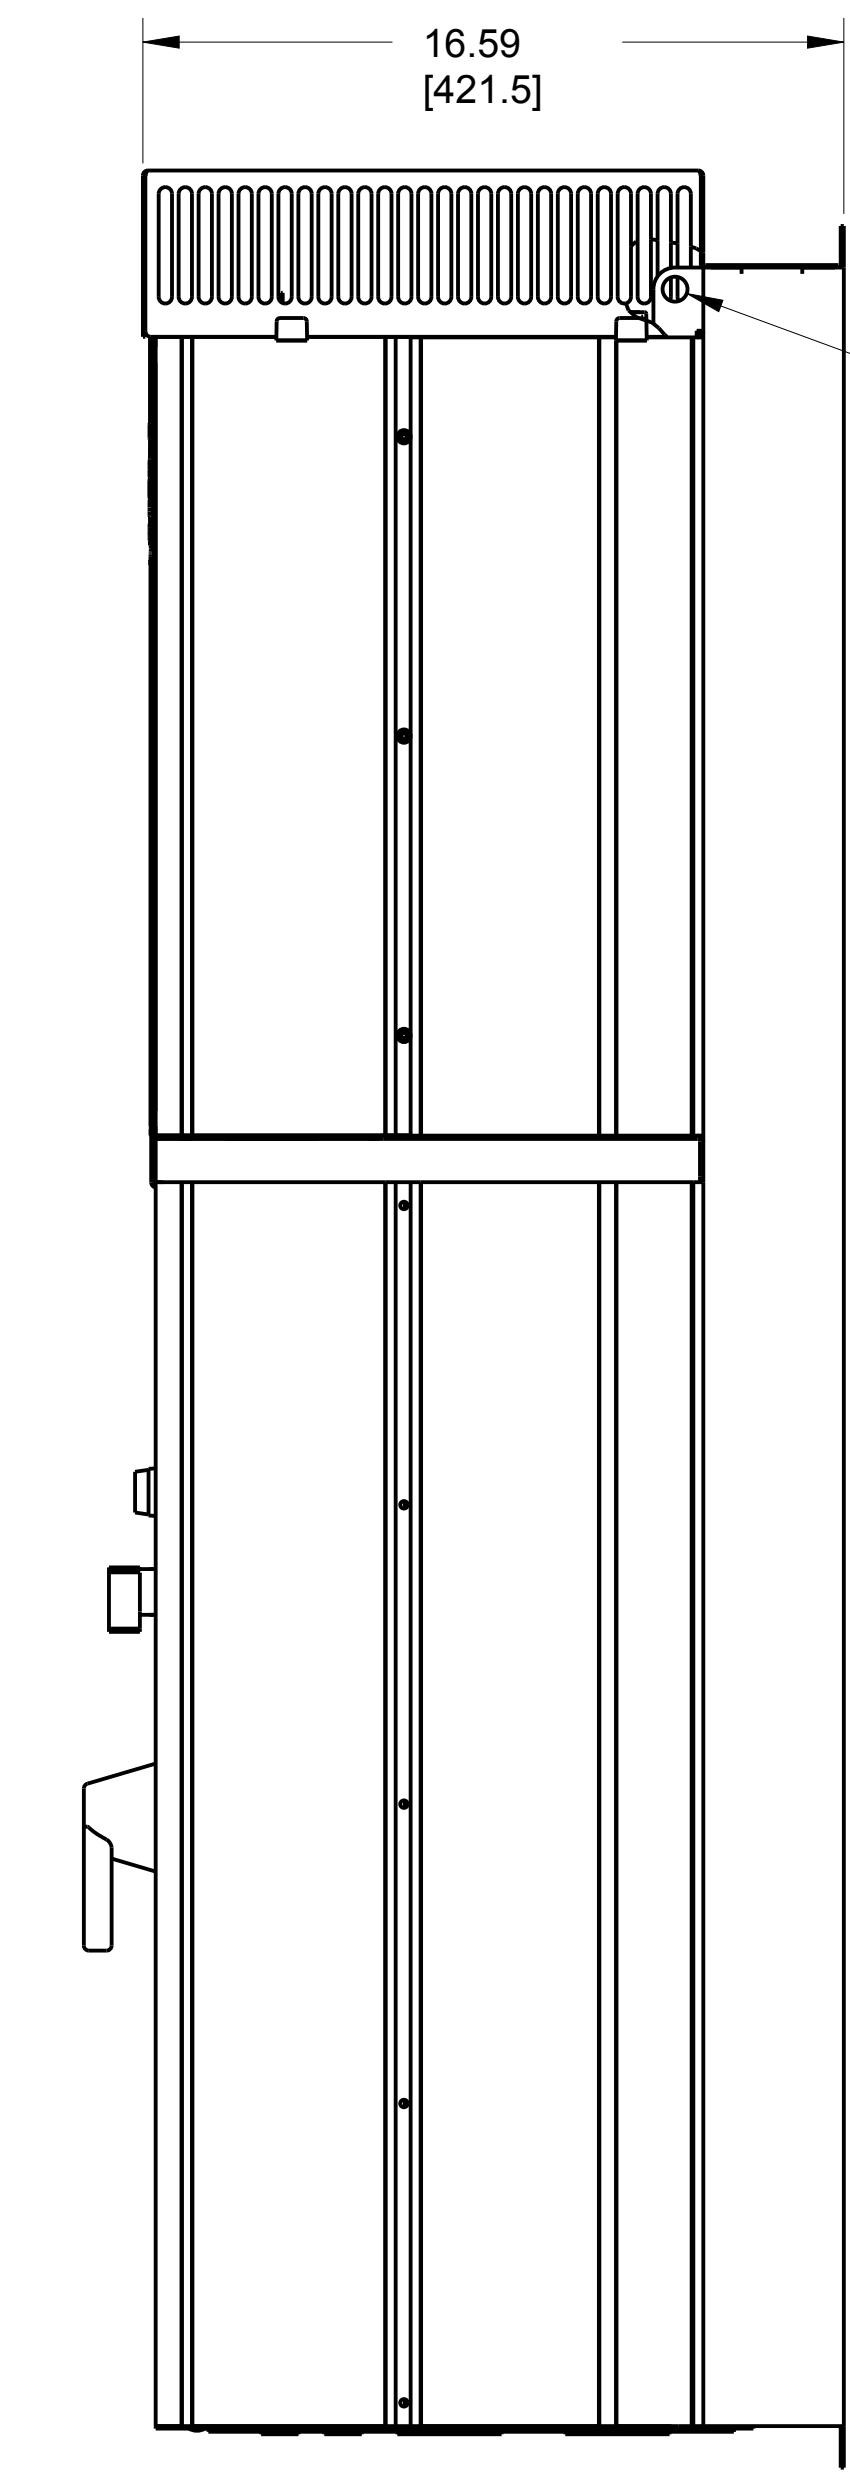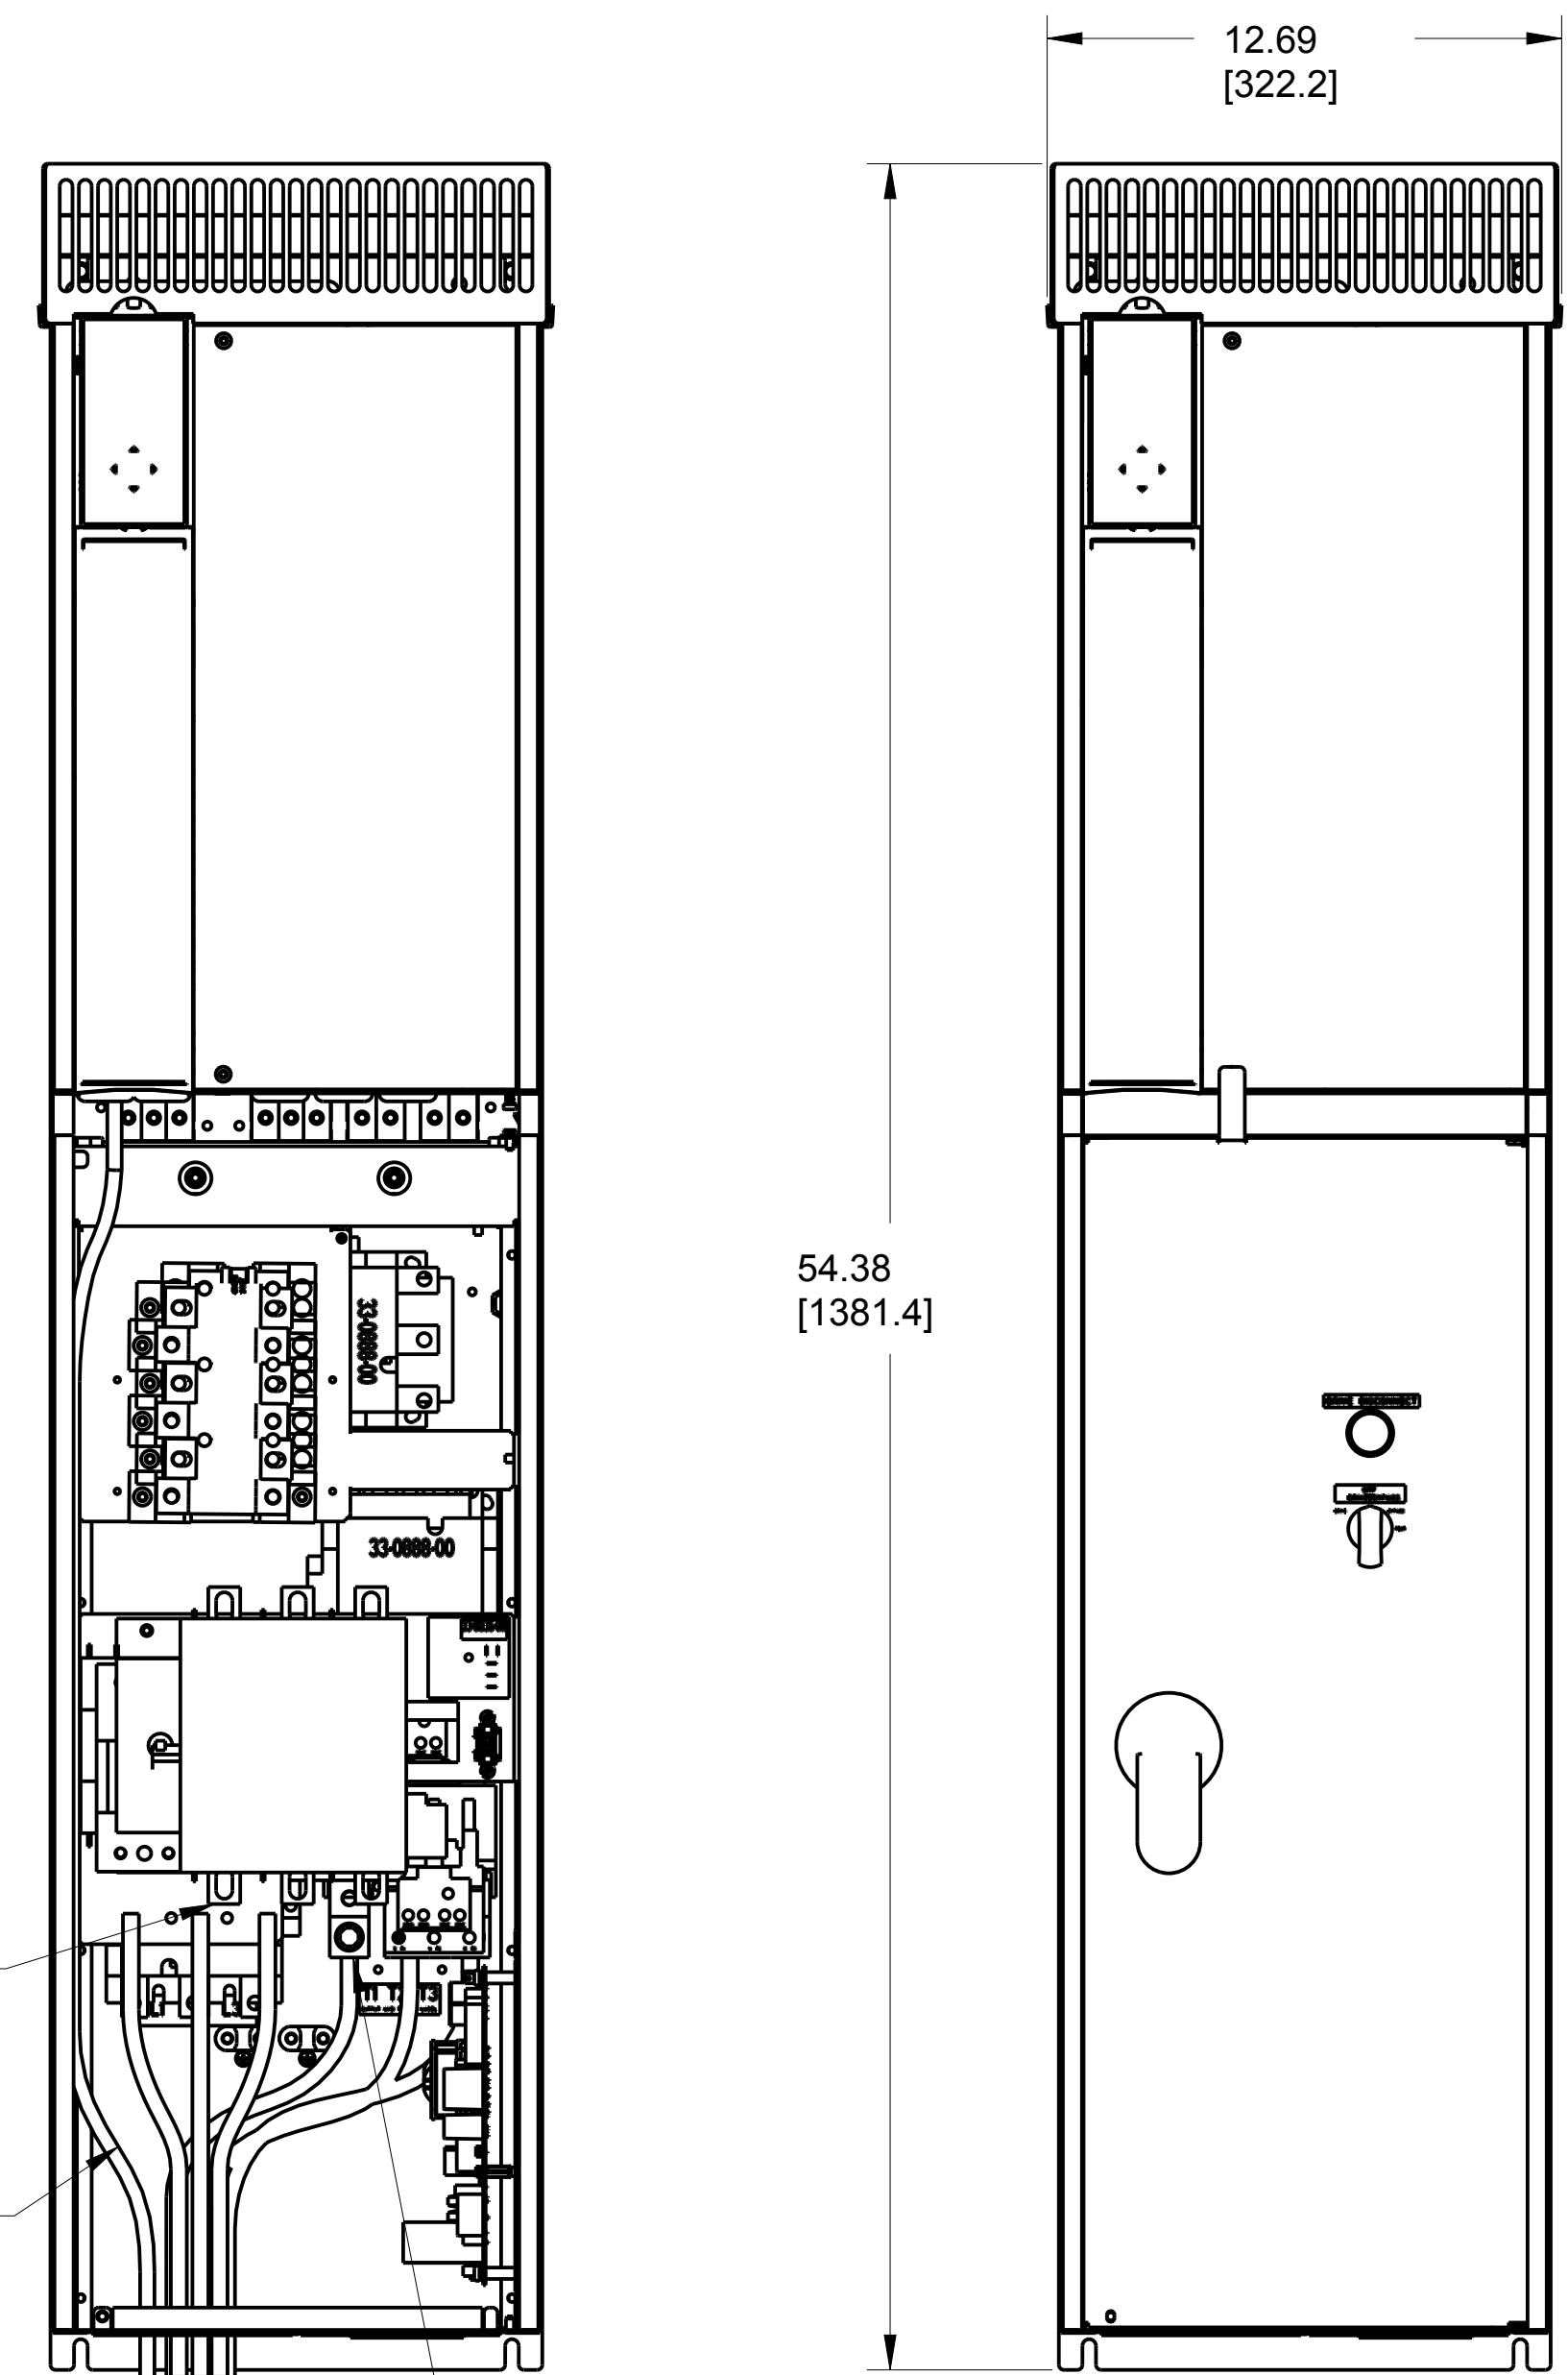

CLEARANCE REQUIREMENT FOR AIR FLOW COOLING:  
 THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM CLEARANCE OF 7.87" [200mm] ON THE BOTTOM AND 2.00" [50.8 mm] ON THE TOP FOR UNIT COOLING.

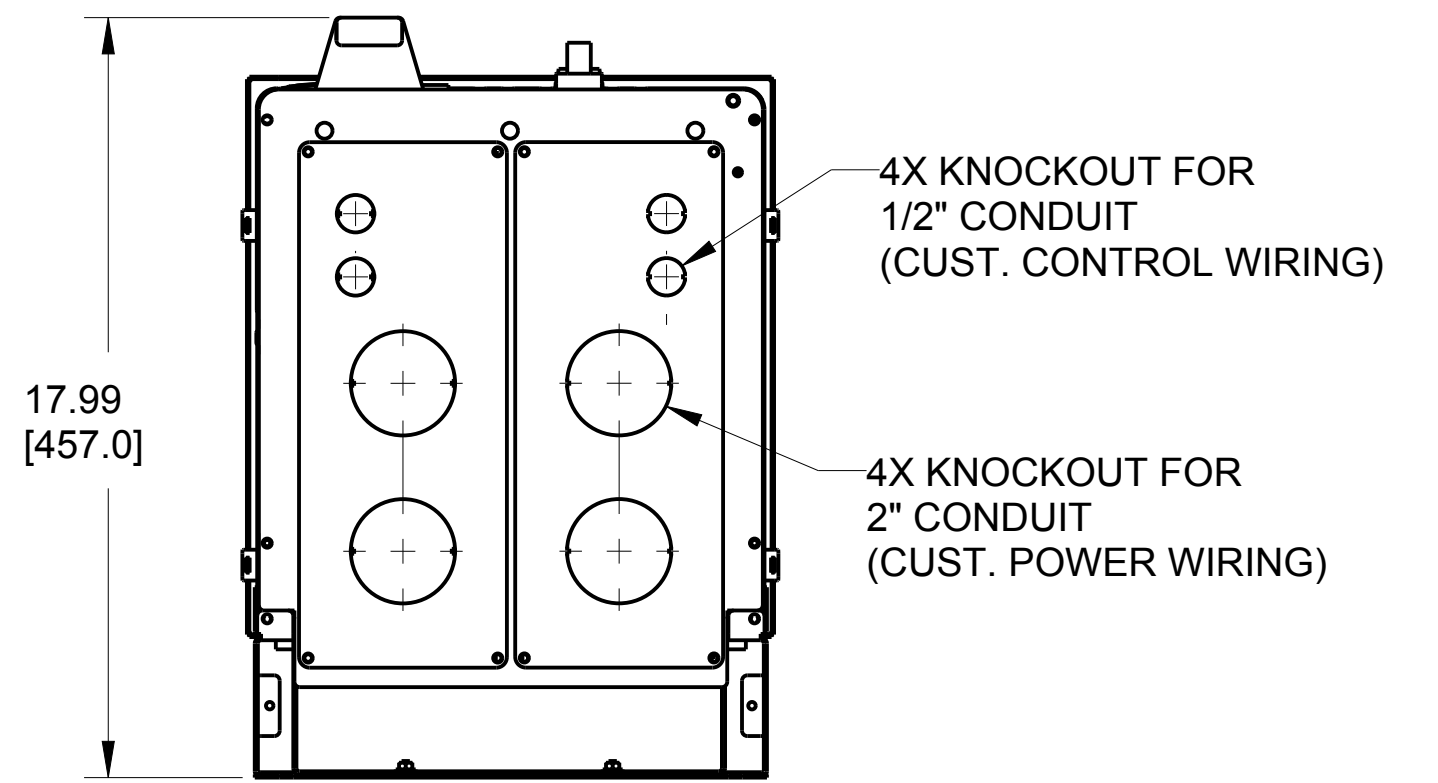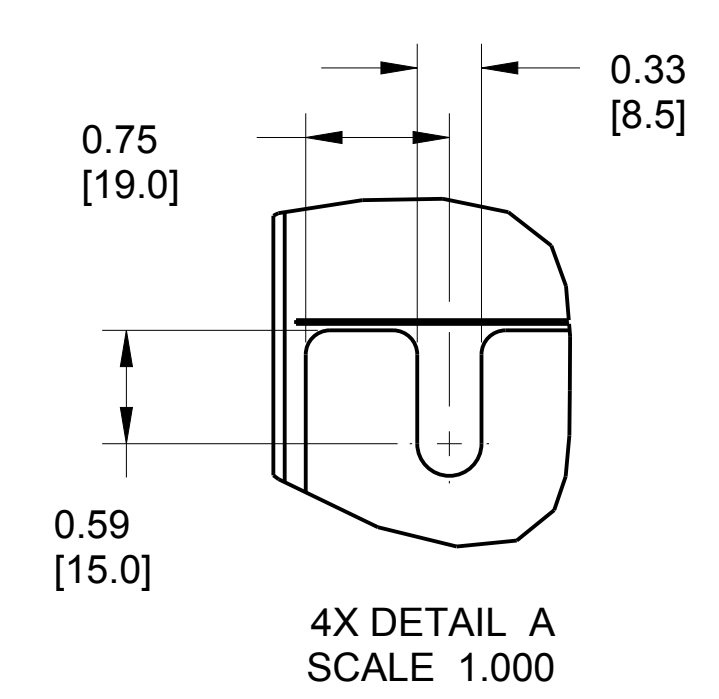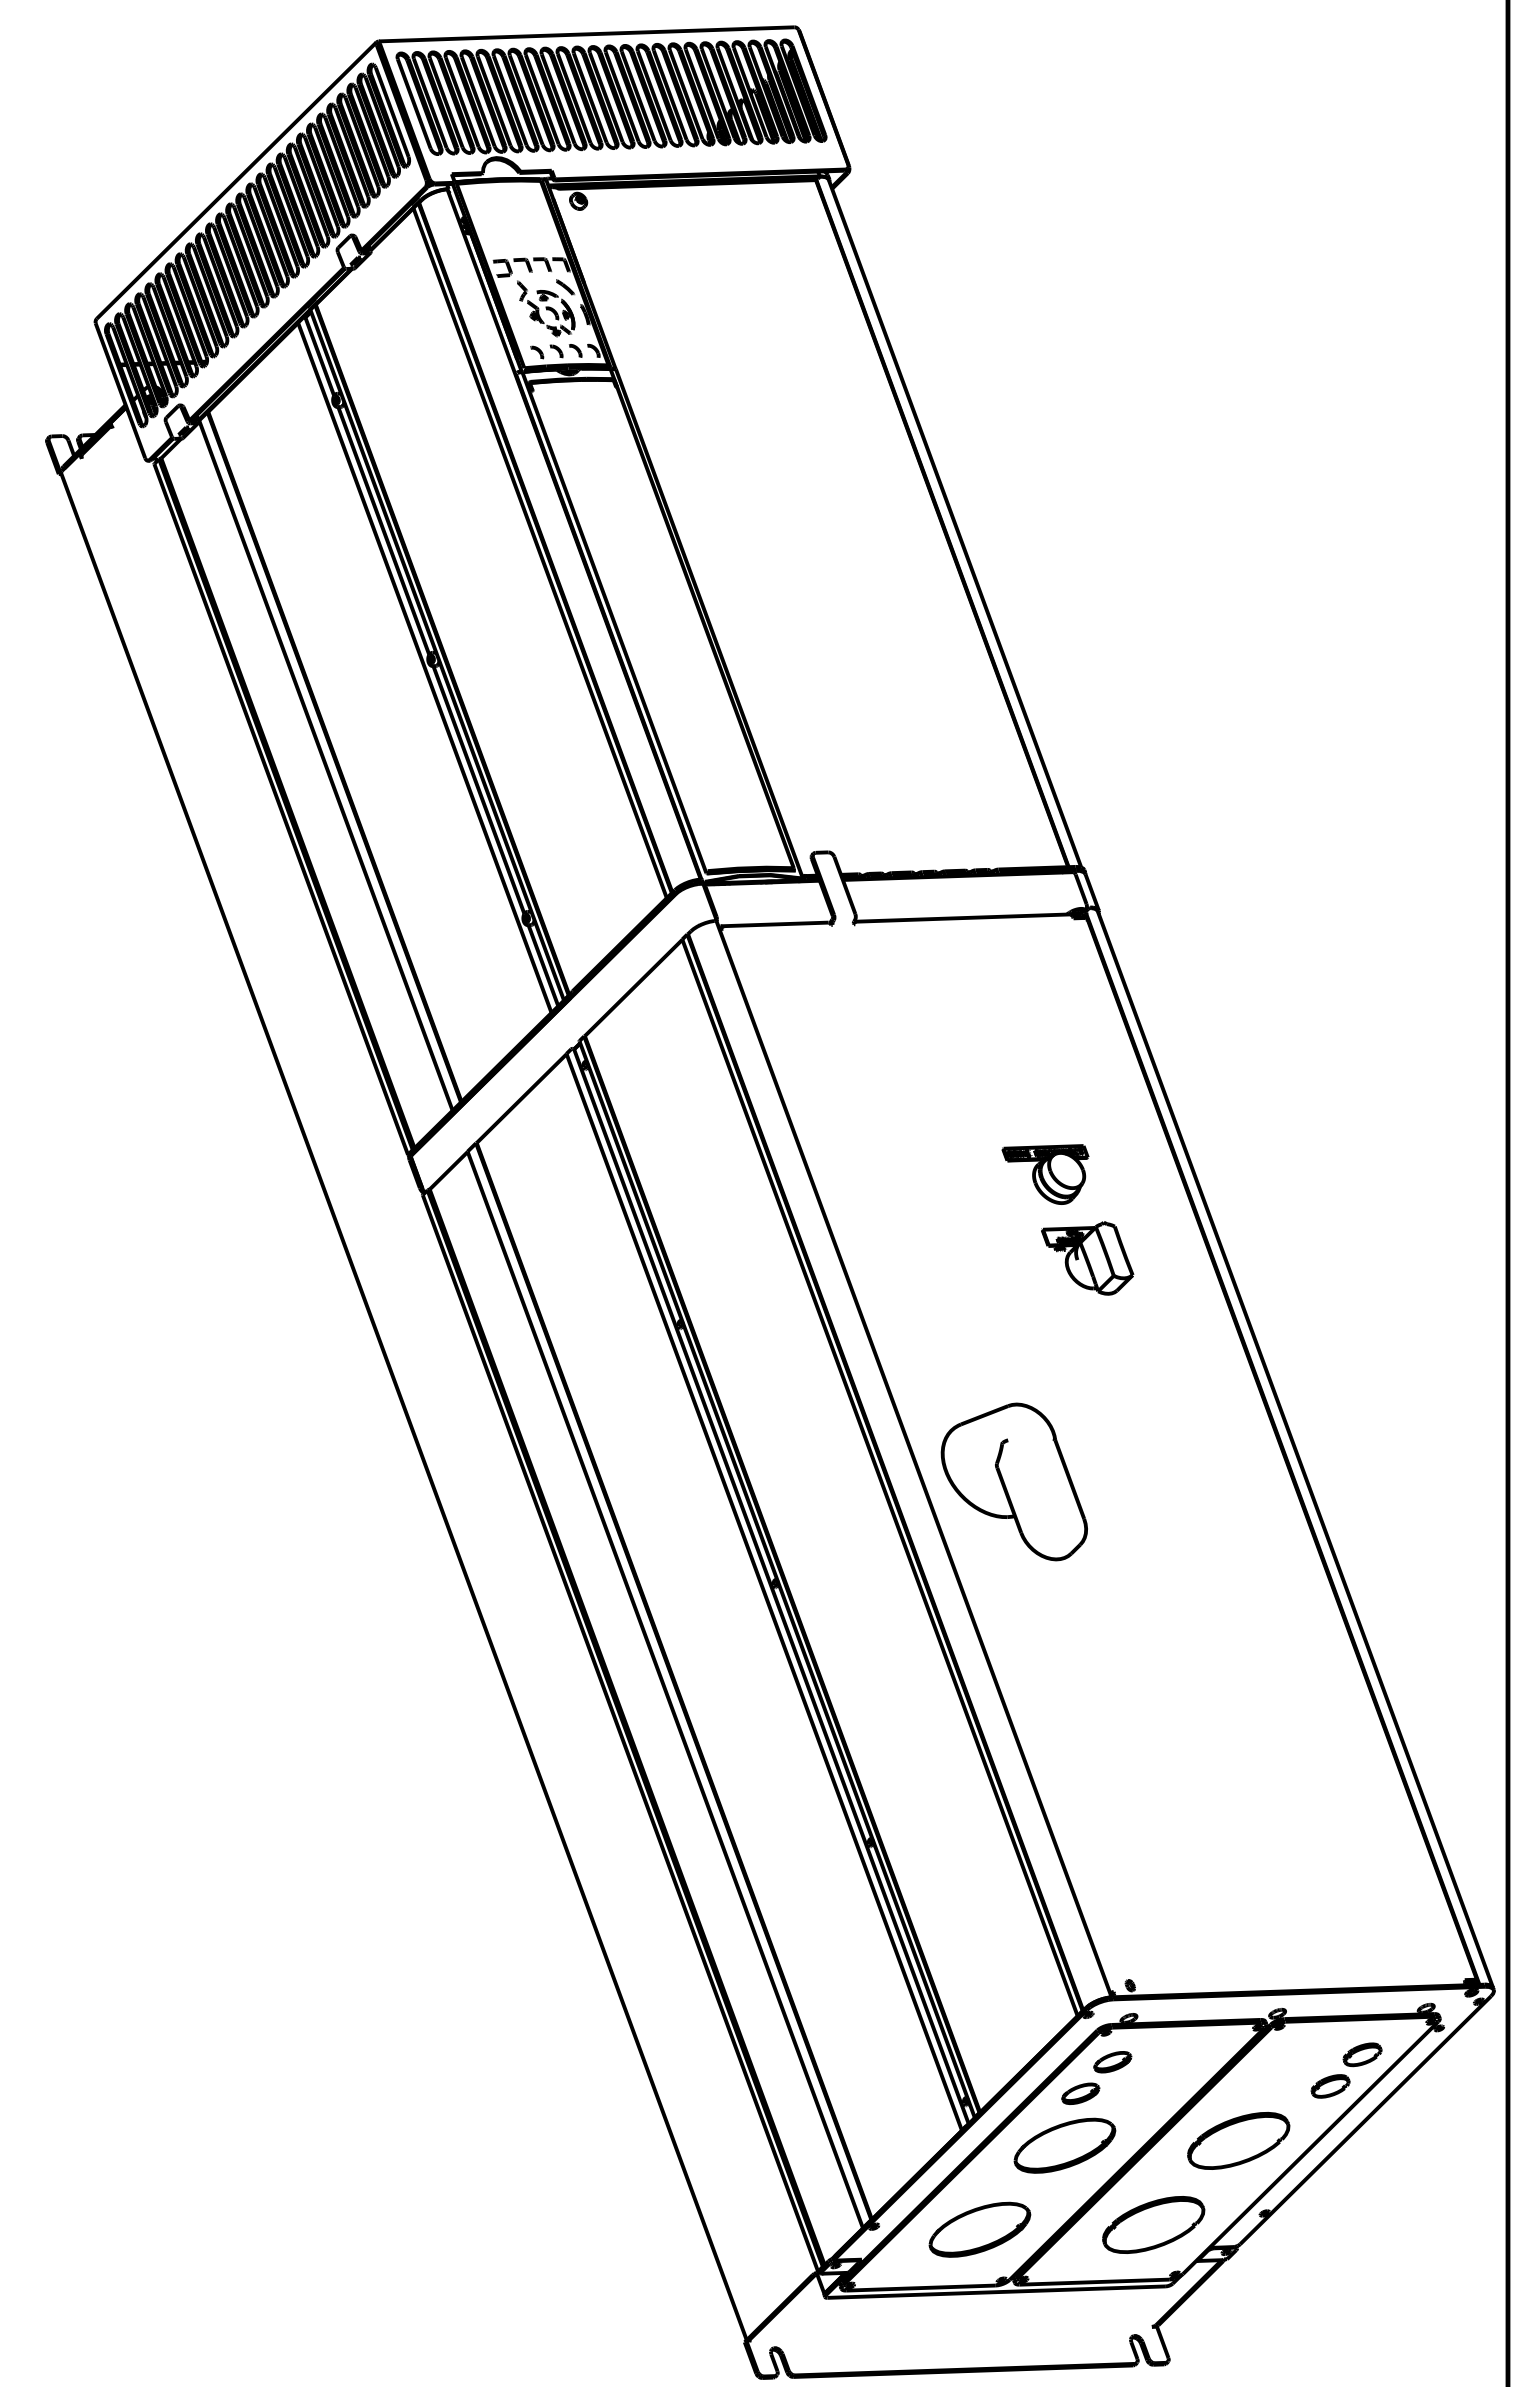

FRAME SIZE P4		
VOLTAGE	HP	KW
208	25	18.5
	30	22
	40	30
230	30	22
	40	30
460	60	45
	75	55
575	60	45
	75	55