

DRAWING	REVISION	VERSION

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES. TOLERANCE:

X ± 0.1  
 XX ± 0.03  
 XXX ± 0.005

ANGLES ± 2.0° HOLE DIA = +  
 CONFORMS TO ASME Y14.5M-1994.

**TRANE**

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE

DRAWN BY: DK TRANE DATE: 03/28/11  
 DO NOT SCALE PRINT THIRD ANGLE PROJECTION

**177R0348** SHEET 1 OF 1 REV 002

DWG.SUBMITTAL\_P5,BYPASS,TRANE


D

C

B

A

CLEARANCE REQUIREMENT FOR AIR FLOW COOLING:  
 THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM CLEARANCE OF 8.86" [225mm] ON THE BOTTOM AND 2.00" [50.8 mm] ON THE TOP FOR UNIT COOLING.

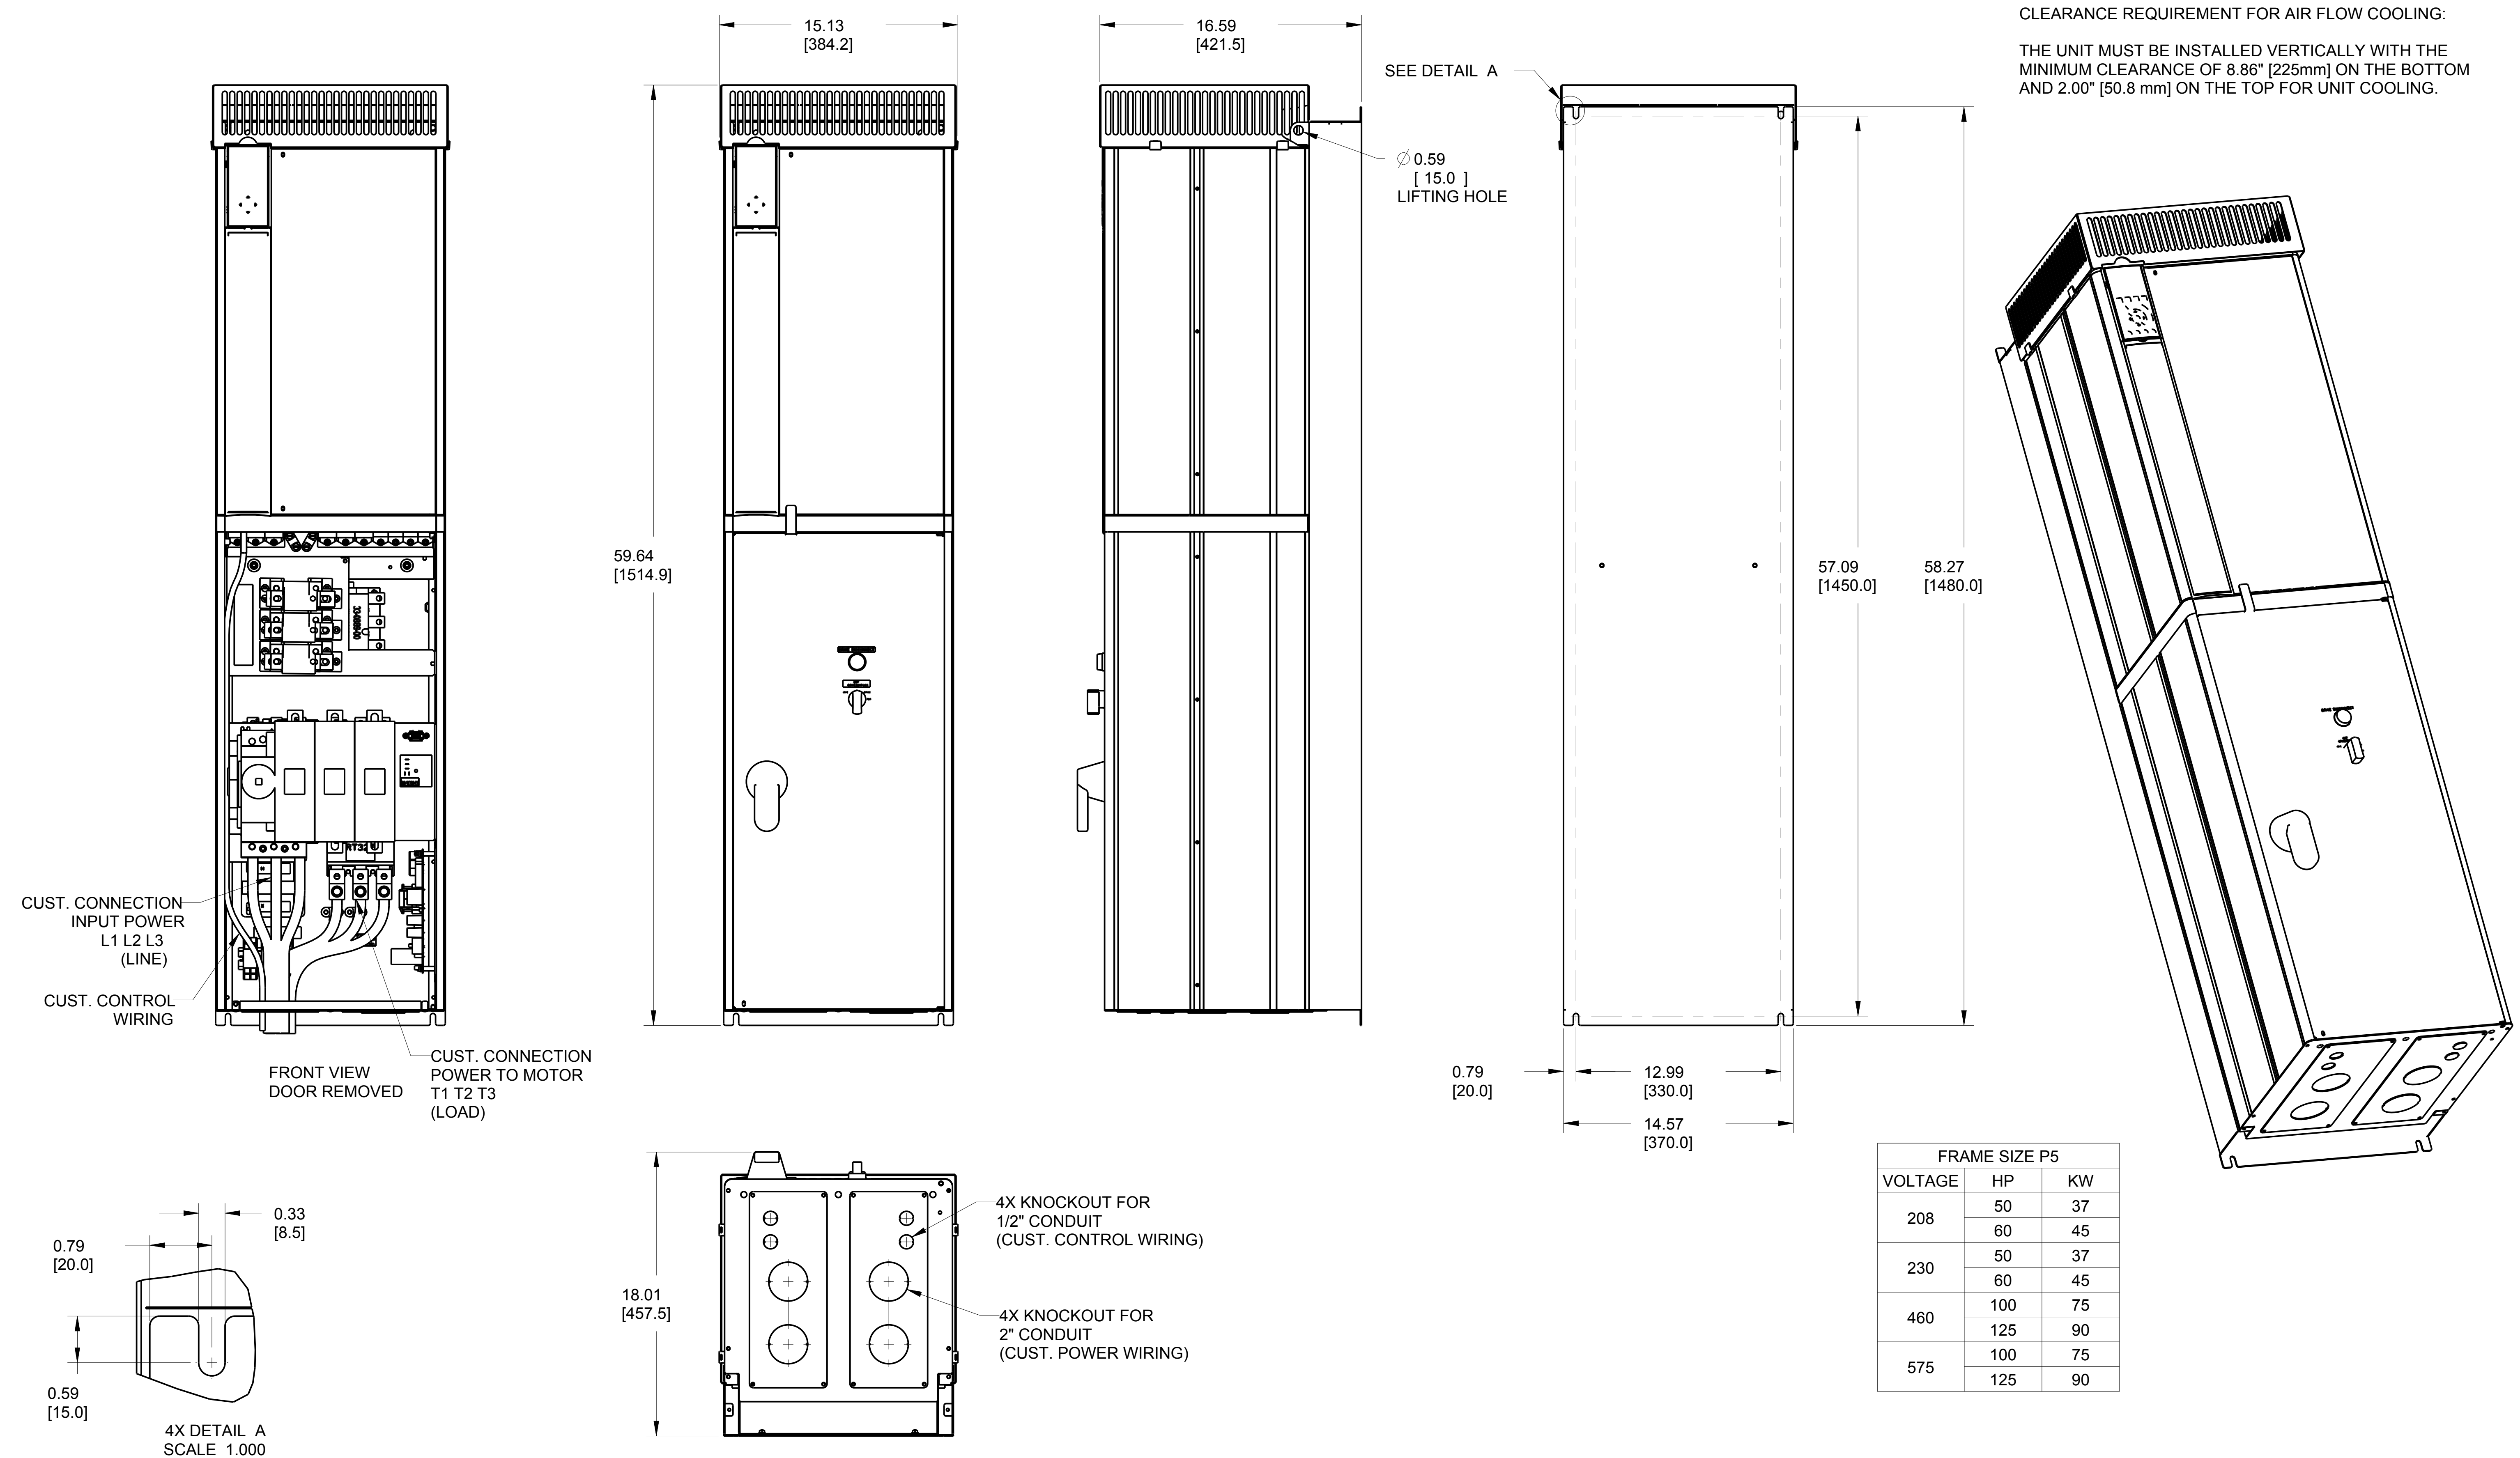

FRAME SIZE P5		
VOLTAGE	HP	KW
208	50	37
	60	45
230	50	37
	60	45
460	100	75
	125	90
575	100	75
	125	90