WIRE COLOR SCHEME	TERMINAL IDENTIFCATION
BLACK – LINE VOLTAGE RED – AC CONTROL WHITE – AC GROUNDED CIRCUIT CONDUCTOR BLUE – DC CONTROL GREEN – CHASSIS GROUND	[X] – DRIVE TERMINAL (X) – CUSTOMER TERMINAL

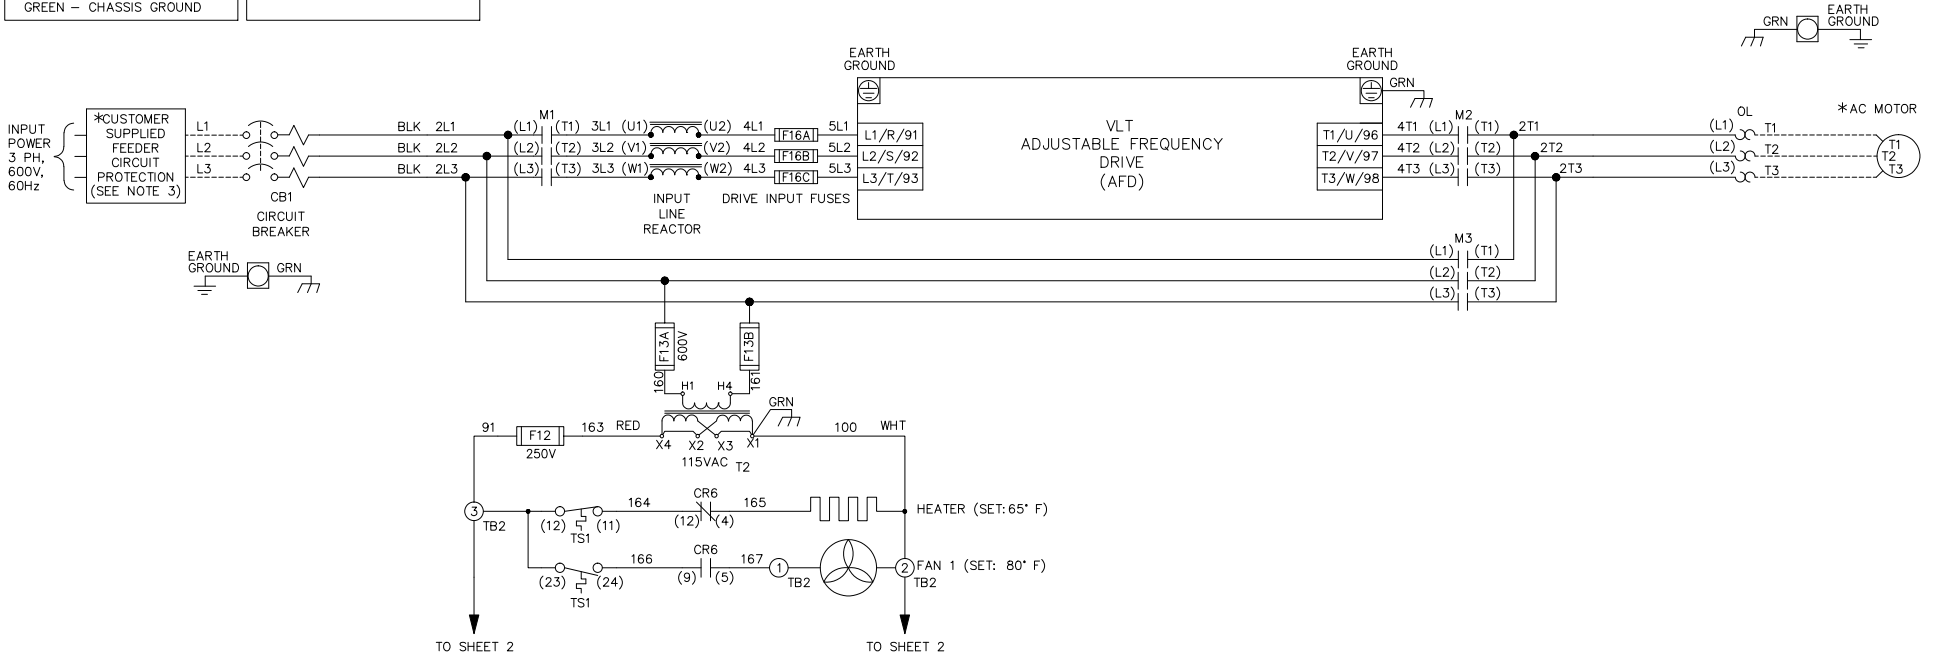

WARNING!
THE FOLLOWING TABLE LISTS THE PARAMETERS THAT ARE SET DIFFERENT FROM THE DRIVE DEFAULT SETTINGS. ADDITIONAL PARAMETER SETTINGS MAY BE REQUIRED FOR YOUR APPLICATION.

DRIVE PARAMETER SETTINGS

PARAMETER #	NAME	SETTING	VALUE
0–02	MOTOR SPEED UNIT	1	HZ
0–03	REGIONAL SETTINGS	1	NORTH AMERICA
1–03	TORQUE CHAR.	3	AUTO ENERGY OPTIM VT
5–02	TERMINAL 29 TYPE	1	OUTPUT
5–11	TERMINAL 19	52	RUN PERMISSIVE
5–31	TERMINAL 29	5	RUNNING
5–40[0]	RELAY 1	160	NO ALARM
5–40[1]	RELAY 2	167	START COMMAND
14–20	RESET MODE	13	INFINITE AUTO REST

NOTES:
1. * INDICATES COMPONENTS NOT SUPPLIED BY MANUFACTURER.
2. REFER TO THE INSTALLATION AND OPERATION MANUAL FOR DRIVE FUNCTIONS AND PARAMETER SETTINGS.
3. FEEDER CIRCUIT PROTECTION, INPUT POWER AND MOTOR WIRING MUST BE SELECTED IN ACCORDANCE WITH THE N.E.C., ANY APPLICATION LOCAL CODES AND THE LOAD CURRENT RATING.
4. REPLACE JUMPER 'J1' WITH NORMALLY CLOSED SAFETY INTERLOCK CONTACT AS NECESSARY. CONTACT MUST BE RATED 1/4 HP @ 120VAC MINIMUM.
5. PANEL MAY REQUIRE DERATING, CONSULT DRIVE MANUAL OR FACTORY FOR FOLLOWING CONDITIONS:
   - 5.1. HIGHER SWITCHING FREQUENCY THAN DRIVE DEFAULT
   - 5.2. HIGHER THAN PANEL LISTED AMBIENT TEMPERATURES
   - 5.3. ELEVATION ABOVE 3300 FEET (1000 METERS)
   - 5.4. LONG MOTOR LEAD LENGTHS

REV	ECN	DATE
B		
A	SP10119	11/10
DR	SP10076	09/10

–NOTICE–

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF THE TRANE COMPANY

DRN DTM
APR DTM

NAME NEMA 3R,600V,3C ,MAIN CB ,DRIVE FUSE ,3MB2,IR,SINGLE MOTOR,1 FAN

MODEL TR200

PAGE 1 OF 2

SIZE A

DWG NO. 185B3225

THE TRANE COMPANY
A DIVISION OF AMERICAN STANDARD INC.

WIRE COLOR SCHEME
BLACK – LINE VOLTAGE
RED – AC CONTROL
WHITE – AC GROUNDED CIRCUIT CONDUCTOR
BLUE – DC CONTROL
GREEN – CHASSIS GROUND

TERMINAL IDENTIFCATION
[X] – DRIVE TERMINAL
(X) – CUSTOMER TERMINAL

CONTACT SEQUENCE CHART FOR S1
X INDICATES CONTACT CLOSED

POSITION / CONTACT	DRIVE	OFF	BYPASS	TEST
1–2	X			X
3–4			X	X
5–6	X			
7–8				X

CUSTOMER DRY CONTACT RATINGS

RELAY	CONTACT RATING
CR1, CR2, CR6, CR8, CR9	5A @ 120VAC 1/10 HP @ 120VAC
M1, M2, M3	10A @ 120/240VAC
UV	8A @ 120VAC 1/3 HP @ 120VAC
TD1	4A @ 250VAC
DRIVE REALY 1 & 2	2A @ 240VAC

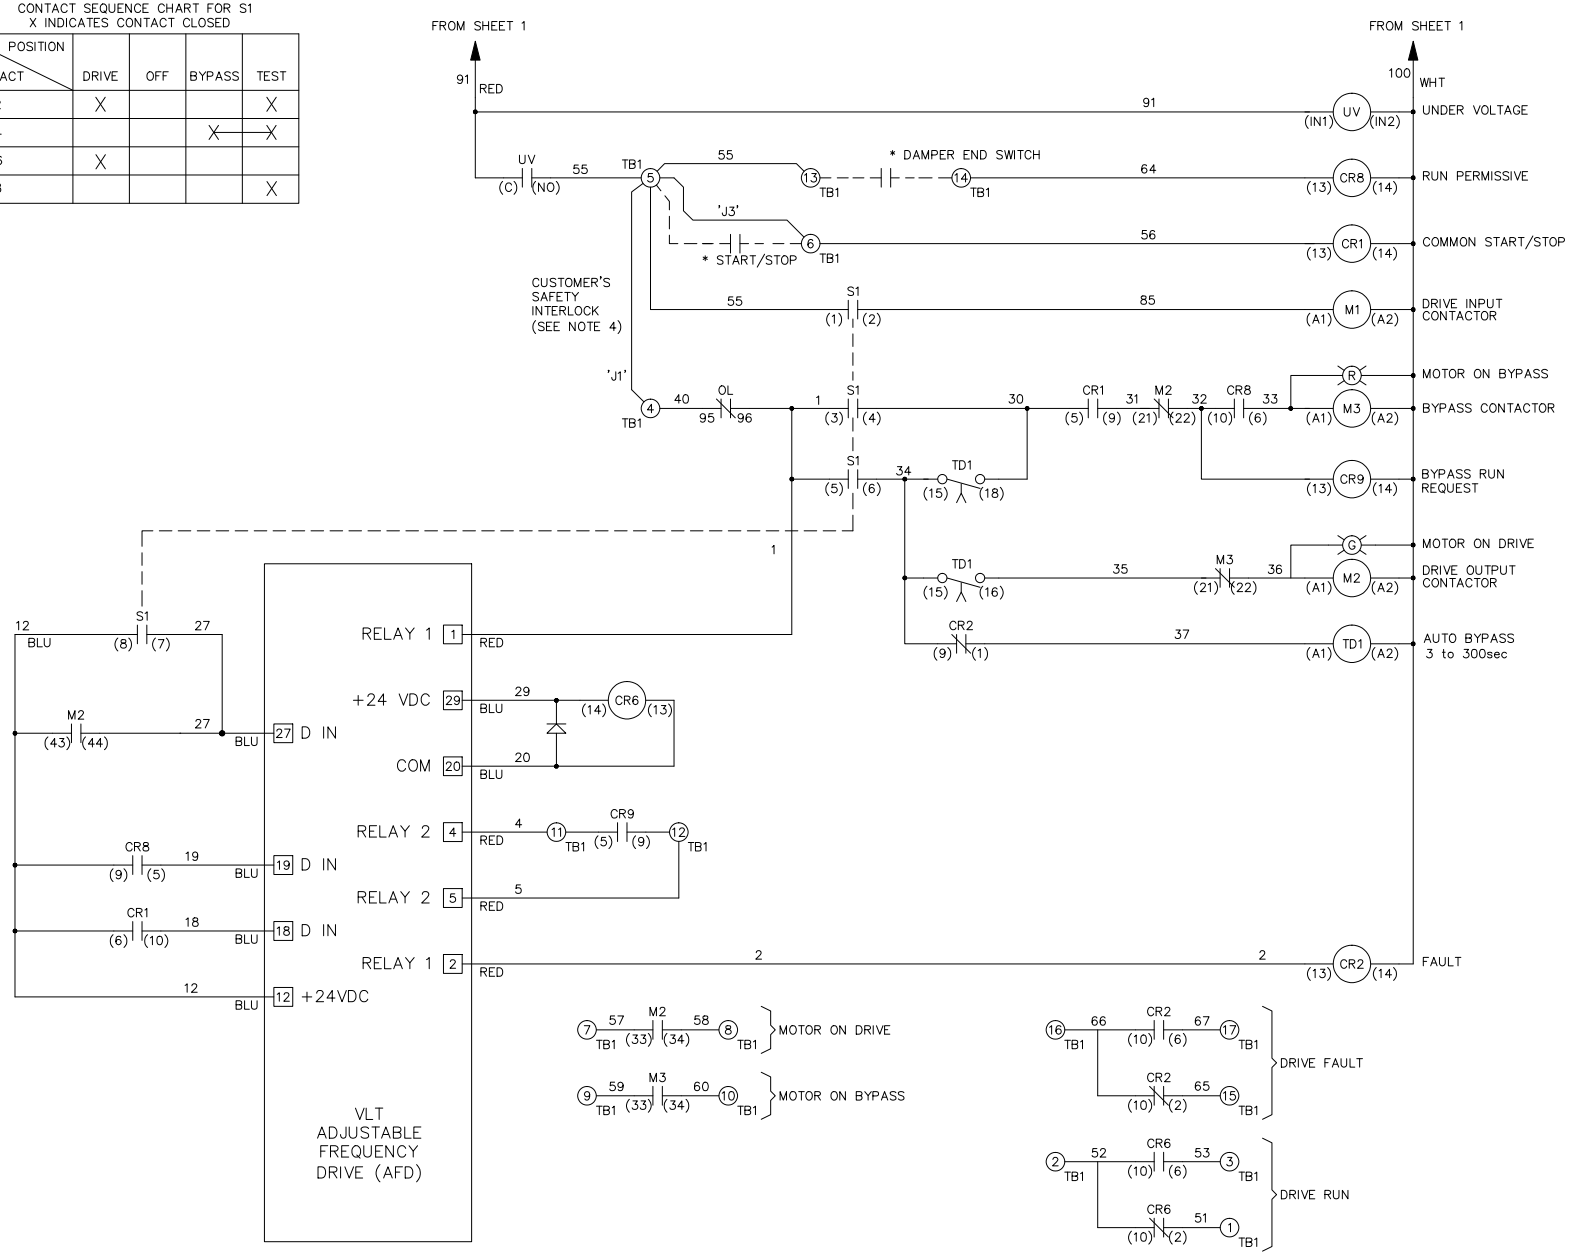

B			–NOTICE– THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF THE TRANE COMPANY	DRN DTM	NAME NEMA 3R,600V,3C ,MAIN CB ,DRIVE FUSE ,3MB2,IR,SINGLE MOTOR,1 FAN	THE TRANE COMPANY A DIVISION OF AMERICAN STANDARD INC.
A	SP10119	11/10		APR DTM		
DR	SP10076	09/10			MODEL TR200	PAGE 2 OF 2
REV	ECN	DATE				SIZE A DWG NO. 185B3225