



Quick Guide

VLT® HVAC Basic Drive FC 101

Contents

1 Quick Guide	2
1.1 Safety	2
1.1.1 Warnings	2
1.1.2 Safety Instructions	2
1.2 Introduction	3
1.2.1 Available Literature	3
1.2.2 Approvals	3
1.2.3 IT Mains	3
1.2.4 Avoid Unintended Start	4
1.2.5 Disposal Instruction	4
1.3 Installation	4
1.3.1 Before Starting Repair Work	4
1.3.2 Side-by-Side Installation	4
1.3.3 Dimensions	5
1.3.4 Electrical Installation in General	6
1.3.5 Connecting to Mains and Motor	7
1.3.6 Fuses	13
1.3.7 EMC-Correct Electrical Installation	15
1.3.8 Control Terminals	17
1.3.9 Electrical Overview	18
1.4 Programming	19
1.4.1 Programming with the Local Control Panel (LCP)	19
1.4.3 The Start-up Wizard for Open Loop Applications	20
1.5.1 Main menu structure	30
1.6 Warnings and Alarms	32
1.7 General Specifications	34
1.7.1 Mains Supply 3x200-240 V AC	34
1.7.2 Mains Supply 3x380-480 V AC	35
1.7.3 Mains Supply 3x380-480 V AC	37
1.7.4 Mains Supply 3x525-600 V AC	39
1.8 Special Conditions	43
1.8.1 Derating for Ambient Temperature and Switching Frequency	43
1.8.2 Derating for Low Air Pressure	43
1.9 Options for VLT® HVAC Basic Drive FC 101	43
1.10 MCT 10 Support	43

1 Quick Guide

1.1 Safety

1.1.1 Warnings

⚠ WARNING

High Voltage Warning

The voltage of the frequency converter is dangerous whenever it is connected to mains. Incorrect installation of the motor or frequency converter may cause damage to the equipment, serious injury or death. Consequently, it is essential to comply with the instructions in this manual as well as local and national rules and safety regulations.

⚠ WARNING

DISCHARGE TIME!

Frequency converters contain DC-link capacitors that can remain charged even when the frequency converter is not powered. To avoid electrical hazards, disconnect AC mains, any permanent magnet type motors, and any remote DC-link power supplies, including battery backups, UPS and DC-link connections to other frequency converters. Wait for the capacitors to fully discharge before performing any service or repair work. The amount of wait time is listed in the *Discharge Time* table. Failure to wait the specified time after power has been removed before doing service or repair could result in death or serious injury.

Voltage [V]	Power range [kW]	Minimum waiting time [min]
3x200	0.25–3.7	4
3x200	5.5–11	15
3x400	0.37–7.5	4
3x400	11–90	15
3x600	2.2–7.5	4
3x600	11–90	15

Table 1.1 Discharge Time

CAUTION

Leakage Current:

The earth leakage current from the frequency converter exceeds 3.5 mA. According to IEC 61800-5-1 a reinforced Protective Earth connection must be ensured with a min. 10 mm² Cu or an additional PE wire - with the same cable cross section as the Mains wiring - must be terminated separately.

Residual Current Device:

This product can cause a DC current in the protective conductor. Where a residual current device (RCD) is used for extra protection, only an RCD of Type B (time delayed) shall be used on the supply side of this product. See also Danfoss Application Note on RCD, MN90G.

Protective earthing of the frequency converter and the use of RCDs must always follow national and local regulations.

Motor thermal protection:

Motor overload protection is possible by setting Parameter 1-90 Motor thermal protection to the value Electronic Thermal Relay (ETR) trip.

⚠ WARNING

Installation at high altitudes

For altitudes above 2 km, contact Danfoss regarding PELV.

1.1.2 Safety Instructions

- Make sure the frequency converter is properly connected to earth.
- Do not remove mains connections, motor connections or other power connections while the frequency converter is connected to power.
- Protect users against supply voltage.
- Protect the motor against overloading according to national and local regulations.
- The earth leakage current exceeds 3.5 mA.
- The [Off/Reset] key is not a safety switch. It does not disconnect the frequency converter from mains.

1.2 Introduction

1.2.1 Available Literature

This Quick Guide contains the basic information necessary for installing and running the frequency converter. If more information is needed, literature can be found on the enclosed cd or downloaded from:
www.danfoss.com/BusinessAreas/DrivesSolutions/Documentations/Technical+Documentation.htm

1.2.2 Approvals

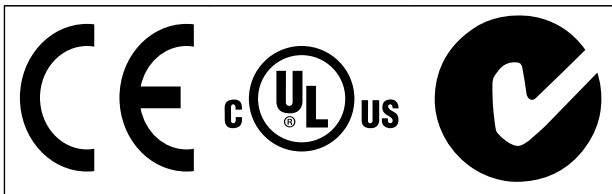


Table 1.2

IP54 enclosure frequency converter do not have UL approvals.

Table 1.3

1.2.3 IT Mains

CAUTION

IT Mains

Installation on isolated mains source, that is, IT mains.
 Max. supply voltage allowed when connected to mains:
 440 V (3x380-480 V units).

On IP20 200-240 V 0.25-11 kW and 380-480 V IP20 0.37-22 kW, open the RFI switch by removing the screw on the side of the frequency converter when at IT grid.

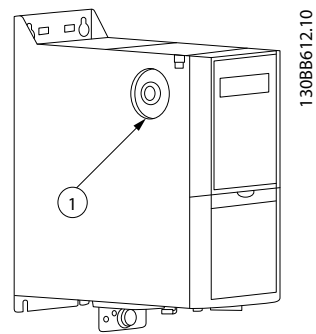


Illustration 1.1 IP20 200-240 V 0.25-11 kW, IP20 0.37-22 kW 380-480 V.

1	EMC screw
---	-----------

Table 1.4

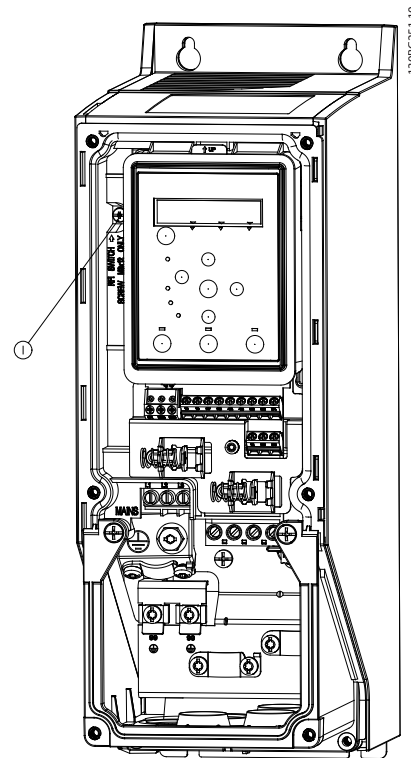


Illustration 1.2 IP54 400 V 0.75-18.5 kW

1	EMC screw
---	-----------

Table 1.5

On all units, set to [Off] when operating in IT mains.

CAUTION


If reinserted, only use M3x12 screw.

1.2.4 Avoid Unintended Start

While the frequency converter is connected to mains, the motor can be started/stopped using digital commands, bus commands, references or via the LCP.

- Disconnect the frequency converter from mains whenever personal safety considerations make it necessary to avoid unintended start of any motors.
- To avoid unintended start, always press [Off/Reset] before changing parameters.

1.2.5 Disposal Instruction



Equipment containing electrical components must not be disposed of together with domestic waste.
It must be separately collected with electrical and electronic waste according to local and currently valid legislation.

Table 1.6

1.3.2 Side-by-Side Installation

The frequency converter can be mounted side-by-side and requires the clearance above and below for cooling.

Frame	IP class	Power [kW]			Clearance above/below [mm/inch]
		3x200-240 V	3x380-480 V	3x525-600 V	
H1	IP20	0.25-1.5	0.37-1.5		100/4
H2	IP20	2.2	2.2-4		100/4
H3	IP20	3.7	5.5-7.5		100/4
H4	IP20	5.5-7.5	11-15		100/4
H5	IP20	11	18.5-22		100/4
H6	IP20	15-18.5	30-45	18.5-30	200/7.9
H7	IP20	22-30	55-75	37-55	200/7.9
H8	IP20	37-45	90	75-90	225/8.9
H9	IP20			2.2-7.5	100/4
H10	IP20			11-15	200/7.9

Table 1.7

NOTE

With IP21/Nema Type1 option kit mounted, a distance of 50 mm between the units is required.

1.3 Installation

1.3.1 Before Starting Repair Work

1. Disconnect FC 101 from mains (and external DC supply, if present).
2. Wait as stated in *Table 1.1* for discharge of the DC-link.
3. Remove motor cable.

1.3.3 Dimensions

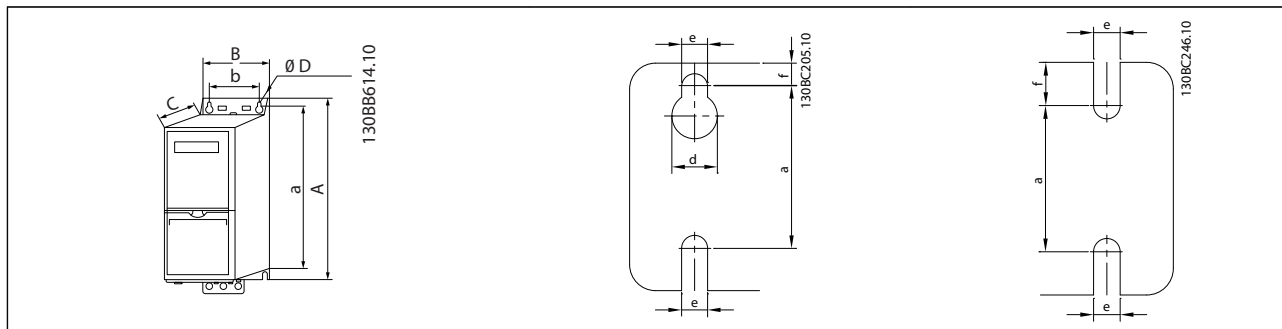


Table 1.8

Enclosure		Power [kW]			Height [mm]			Width [mm]		Depth [mm]	Mounting hole [mm]			Max. Weight [kg]
Frame	IP Class	3x200-240 V	3x380-480 V	3x525-600 V	A	"A incl Decoupling Plate"	a	B	b	C	d	e	f	kg
H1	IP20	0.25-1.5	0.37-1.5		195	273	183	75	56	168	9	4.5	5.3	2.1
H2	IP20	2.2	2.2-4.0		227	303	212	90	65	190	11	5.5	7.4	3.4
H3	IP20	3.7	5.5-7.5		255	329	240	100	74	206	11	5.5	8.1	4.5
H4	IP20	5.5-7.5	11-15		296	359	275	135	105	241	12.6	7	8.4	7.9
H5	IP20	11	18.5-22		334	402	314	150	120	255	12.6	7	8.5	9.5
H6	IP20	15-18.5	30-45	18.5-30	518	595/635 (45 kW)	495	239	200	242	-	8.5	15	24.5
H7	IP20	22-30	55-75	37-55	550	630/690 (75 kW)	521	313	270	335	-	8.5	17	36
H8	IP20	37-45	90	75-90	660	800	631	375	330	335	-	8.5	17	51
H9	IP20			2.2-7.5	269	374	257	130	110	205	11	5.5	9	6.6
H10	IP20			11-15	399	419	380	165	140	248	12	6.8	7.5	12
I2	IP54		0.75-4.0		332	-	318.5	115	74	225	11	5.5	9	5.3
I3	IP54		5.5-7.5		368	-	354	135	89	237	12	6.5	9.5	7.2
I4	IP54		11-18.5		476	-	460	180	133	290	12	6.5	9.5	13.8
I5	IP54		11-18.5		480	-	454	242	210	260	19	9	9	23
I6	IP54		22-37		650	-	624	242	210	260	19	9	9	27
I7	IP54		45-55		680	-	648	308	272	310	19	9	9.8	45
I8	IP54		75-90		770	-	739	370	334	335	19	9	9.8	65

Table 1.9

The dimensions are only for the physical units, but when installing in an application it is necessary to add space for free air passage both above and below the units. The amount of space for free air passage is listed in *Table 1.10*:

Enclosure		Clearance needed for free air passage [mm]	
Frame	IP class	Above unit	Below unit
H1	20	100	100
H2	20	100	100
H3	20	100	100
H4	20	100	100
H5	20	100	100
H6	20	200	200
H7	20	200	200
H8	20	225	225
H9	20	100	100
H10	20	200	200
I2	54	100	100
I3	54	100	100
I4	54	100	100
I5	54	200	200
I6	54	200	200
I7	54	200	200
I8	54	225	225

Table 1.10 Clearance Needed for Free Air Passage [mm]

1.3.4 Electrical Installation in General

All cabling must comply with national and local regulations on cable cross-sections and ambient temperature. Copper conductors required, (75 °C) recommended.

Frame	IP class	Power [kW]		Torque [Nm]					
		3x200-240 V	3x380-480 V	Line	Motor	DC connection	Control terminals	Earth	Relay
H1	IP20	0.25-1.5	0.37-1.5	1.4	0.8	0.8	0.5	0.8	0.5
H2	IP20	2.2	2.2-4	1.4	0.8	0.8	0.5	0.8	0.5
H3	IP20	3.7	5.5-7.5	1.4	0.8	0.8	0.5	0.8	0.5
H4	IP20	5.5-7.5	11-15	1.2	1.2	1.2	0.5	0.8	0.5
H5	IP20	11	18.5-22	1.2	1.2	1.2	0.5	0.8	0.5
H6	IP20	15-18	30-45	4.5	4.5	-	0.5	3	0.5
H7	IP20	22-30	55	10	10	-	0.5	3	0.5
H7	IP20	-	75	14	14	-	0.5	3	0.5
H8	IP20	37-45	90	24 ²	24 ²	-	0.5	3	0.5

Table 1.11

Frame	IP class	Power [kW]		Torque [Nm]					
		3x380-480 V	Line	Motor	DC connection	Control terminals	Earth	Relay	
I2	IP54	0.75-4.0	1.4	0.8	0.8	0.5	0.8	0.5	
I3	IP54	5.5-7.5	1.4	0.8	0.8	0.5	0.8	0.5	
I4	IP54	11-18.5	1.4	0.8	0.8	0.5	0.8	0.5	
I5	IP54	11-18.5	1.8	1.8	-	0.5	3	0.6	
I6	IP54	22-37	4.5	4.5	-	0.5	3	0.6	
I7	IP54	45-55	10	10	-	0.5	3	0.6	
I8	IP54	75-90	14/24 ¹	14/24 ¹	-	0.5	3	0.6	

Table 1.12

Frame	Power [kW]		Torque [Nm]					
	IP class	3x525-600 V	Line	Motor	DC connection	Control terminals	Earth	Relay
H9	IP20	2.2-7.5	1.8	1.8	not recommended	0.5	3	0.6
H10	IP20	11-15	1.8	1.8	not recommended	0.5	3	0.6
H6	IP20	18.5-30	4.5	4.5	-	0.5	3	0.5
H7	IP20	37-55	10	10	-	0.5	3	0.5
H8	IP20	75-90	14/24 ¹	14/24 ¹	-	0.5	3	0.5

Table 1.13 Details of Tightening Torques

¹ Cable dimensions ≤95 mm²

² Cable dimensions >95 mm²

1.3.5 Connecting to Mains and Motor

The frequency converter is designed to operate all standard three-phased asynchronous motors. For maximum cross-section on wires see 1.6 General Specifications.

- Use a shielded/armored motor cable to comply with EMC emission specifications, and connect this cable to both the decoupling plate and the motor metal.
- Keep motor cable as short as possible to reduce the noise level and leakage currents.
- For further details on mounting of the decoupling plate, see FC 101 De-coupling Plate Mounting Instruction MI02Q.
- Also see EMC-Correct Installation in the VLT® HVAC Basic Design Guide, MG18C.

1. Mount the earth wires to earth terminal.
2. Connect motor to terminals U, V and W.
3. Mount mains supply to terminals L1, L2 and L3 and tighten.

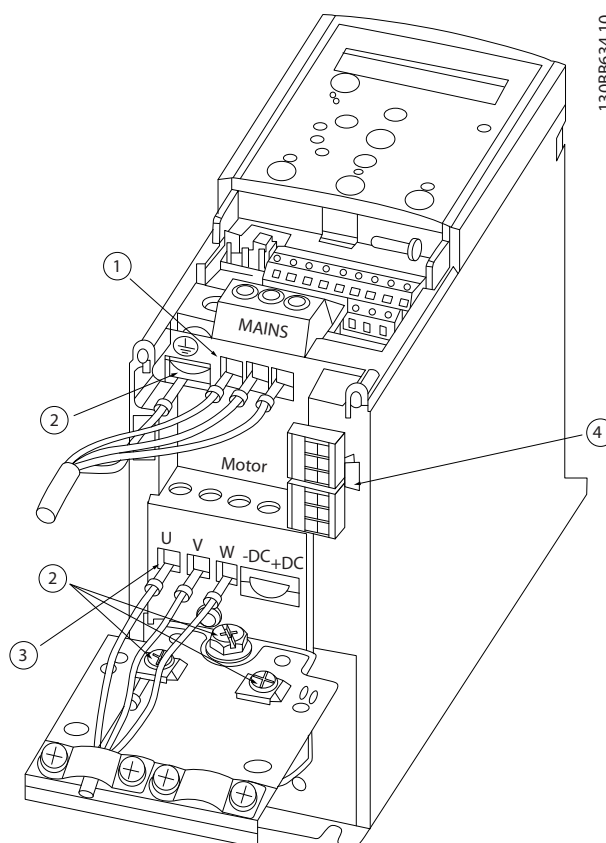


Illustration 1.3 H1-H5 Frame
IP20 200-240 V 0.25-11 kW and IP20 380-480 V 0.37-22 kW.

1	Line
2	Earth
3	Motor
4	Relays

Table 1.14

1

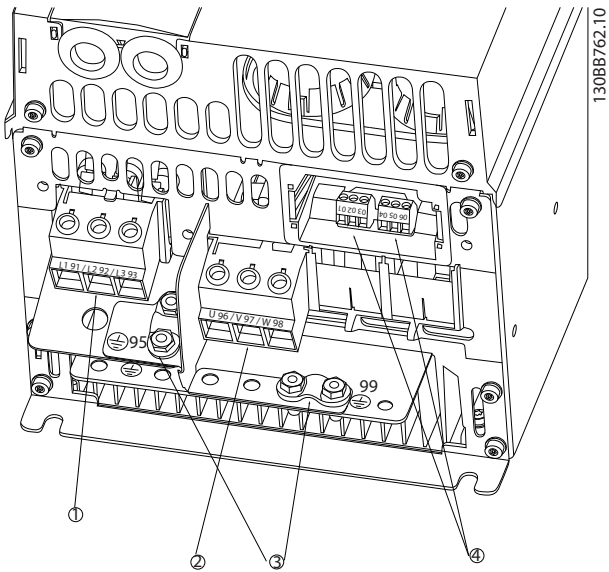


Illustration 1.4 H6 Frame
 IP20 380-480 V 30-45 kW
 IP20 200-240 V 15-18.5 kW
 IP20 525-600 V 22-30 kW

1	Line
2	Motor
3	Earth
4	Relays

Table 1.15

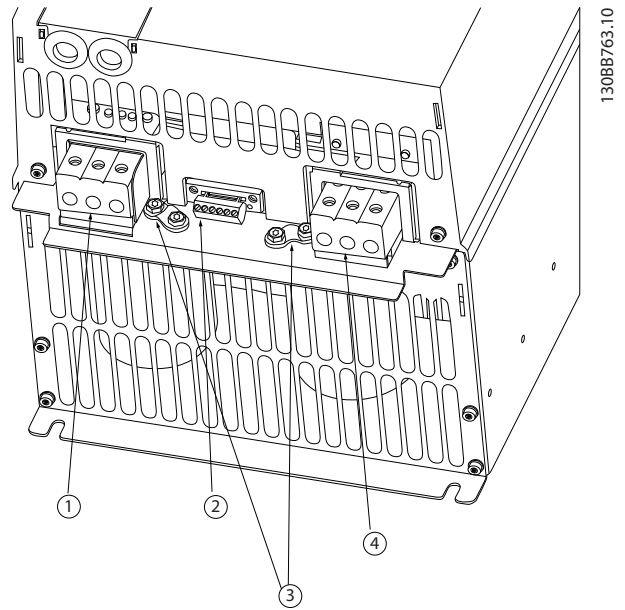


Illustration 1.5 H7 Frame
 IP20 380-480 V 55-75 kW
 IP20 200-240 V 22- 30 kW
 IP20 525-600 V 45-55 kW

1	Line
2	Relays
3	Earth
4	Motor

Table 1.16

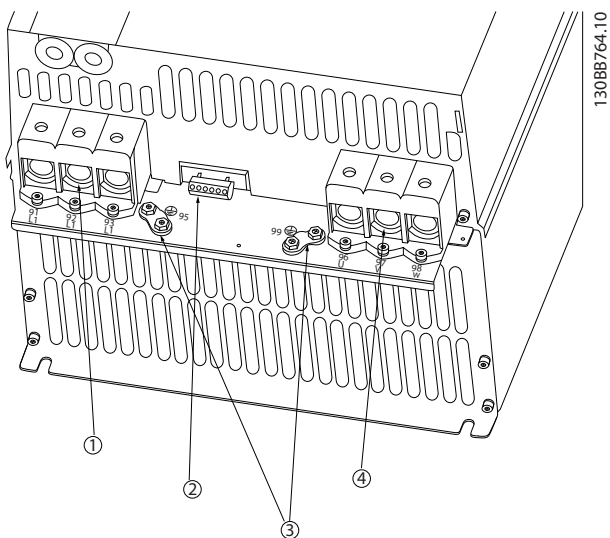


Illustration 1.6 H8 Frame
 IP20 380-480 V 90 kW
 IP20 200-240 V 37-45 kW
 IP20 525-600 V 75-90 kW

1	Line
2	Relays
3	Earth
4	Motor

Table 1.17

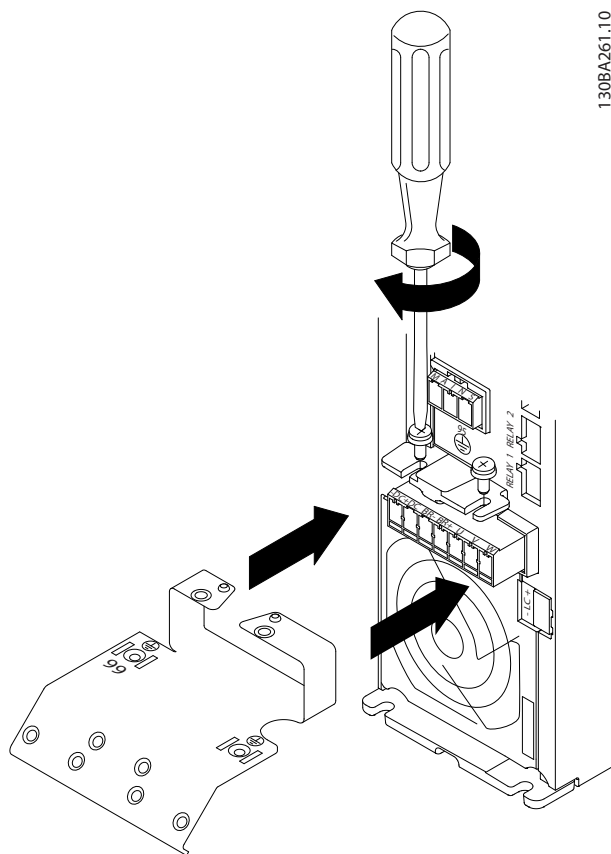


Illustration 1.8

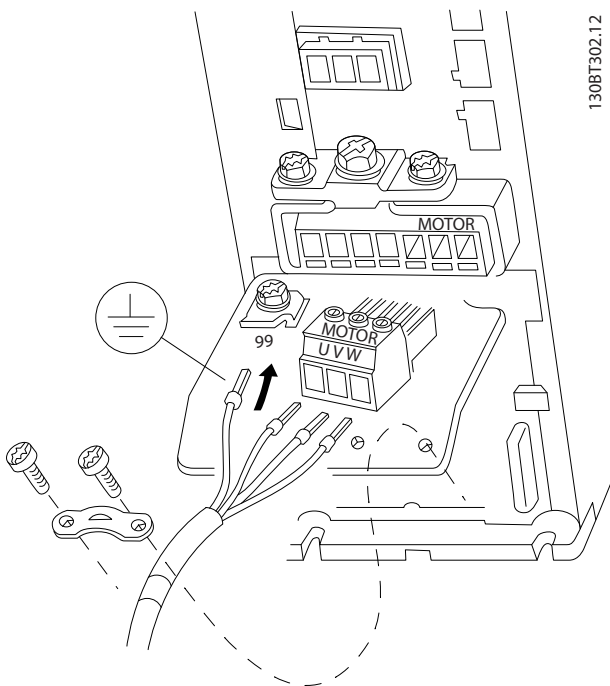


Illustration 1.7 H9 Frame
 IP20 600 V 2.2-7.5 kW

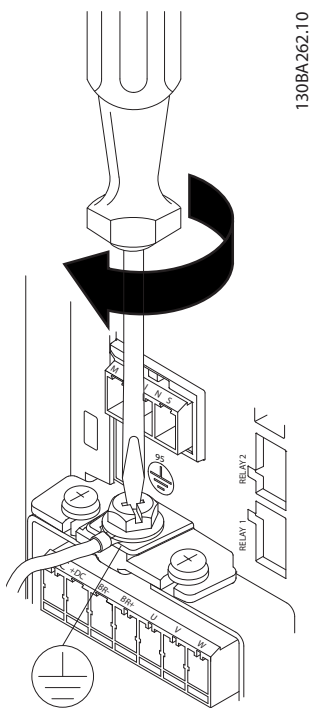


Illustration 1.9

1

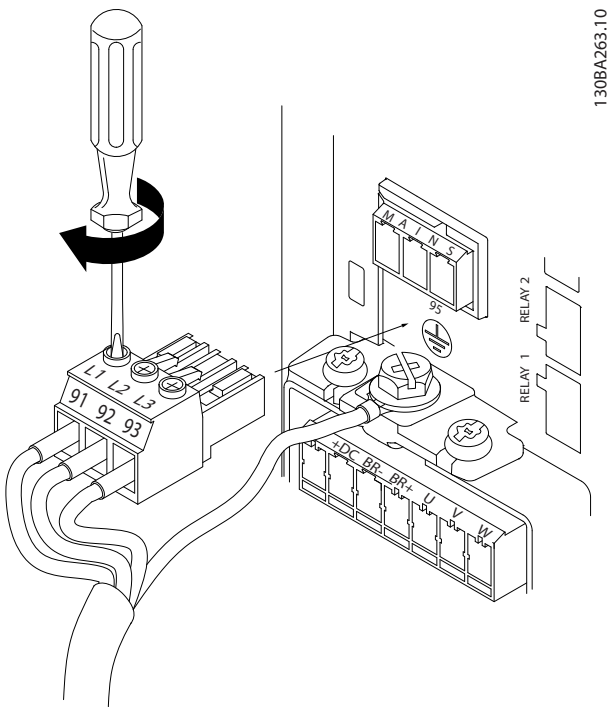


Illustration 1.10

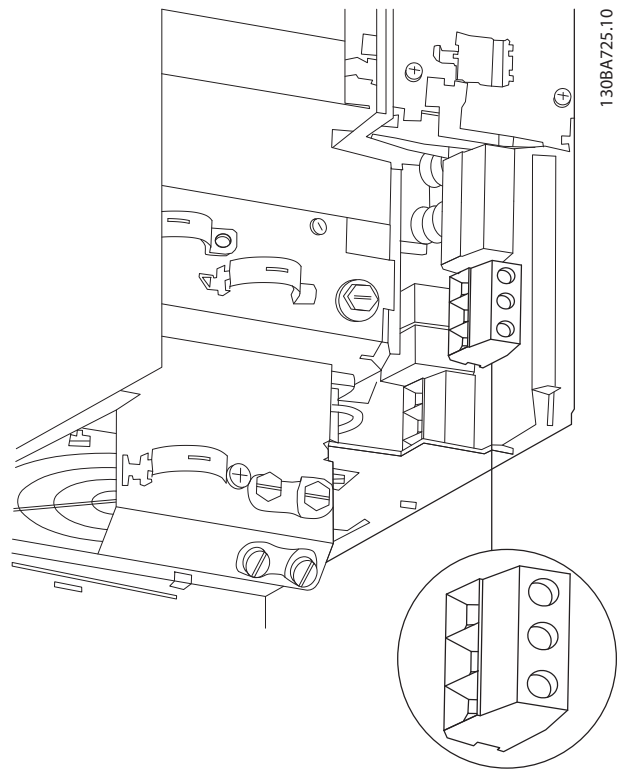


Illustration 1.12 H10 Frame
IP20 600 V 11-15 kW


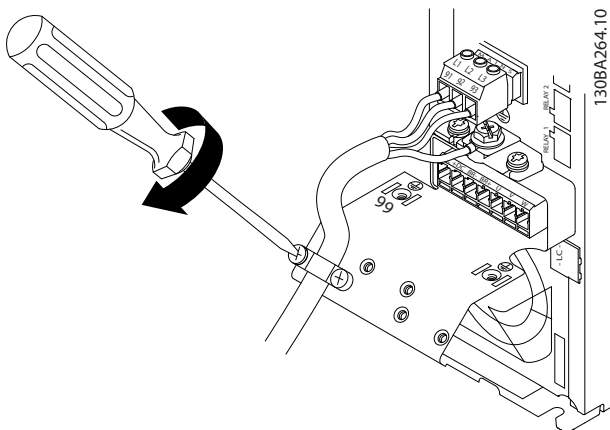


Illustration 1.11

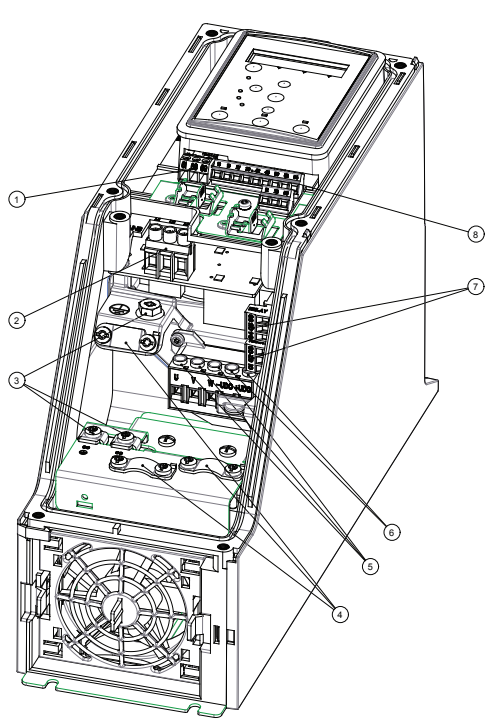


1386C299.10

Illustration 1.13 I2 Frame
IP54 380-480 V 0.75-4.0 kW

1	RS-485
2	Line in
3	Earth
4	Wire clamps
5	Motor
6	UDC
7	Relays
8	I/O

Table 1.18

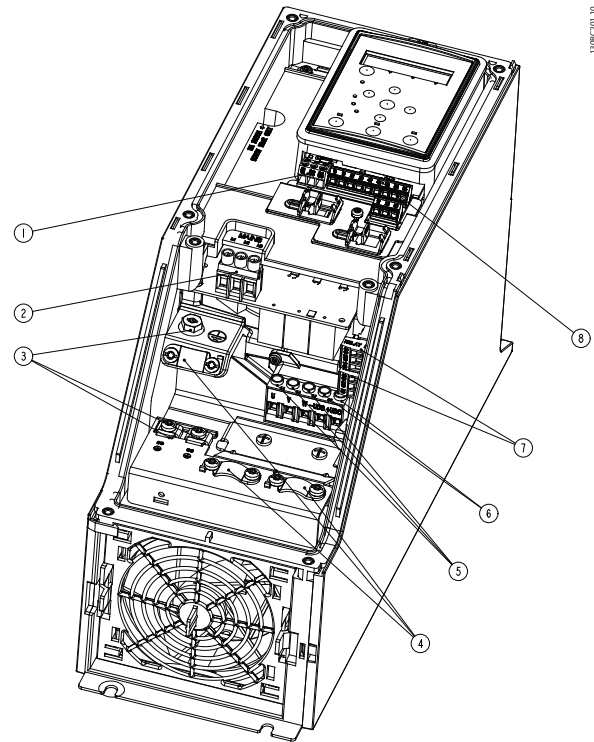


1386C201.10

Illustration 1.14 I3 Frame
IP54 380-480 V 5.5-7.5 kW


1	RS-485
2	Line in
3	Earth
4	Wire clamps
5	Motor
6	UDC
7	Relays
8	I/O

Table 1.19

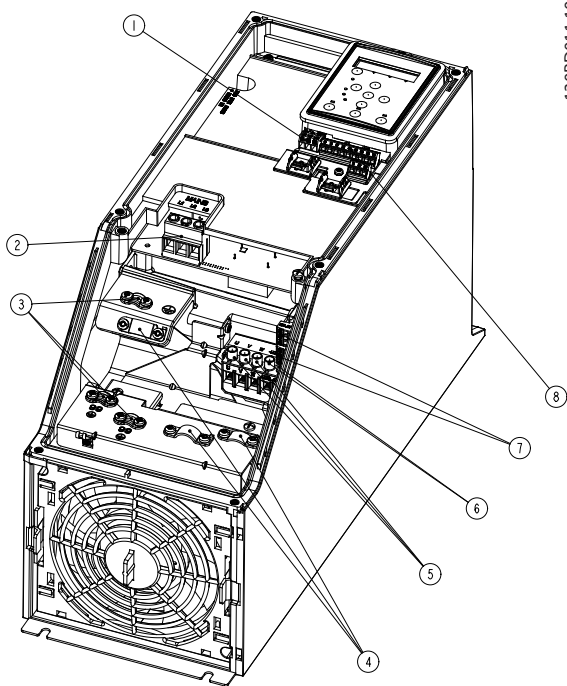

130BD011.10

Illustration 1.15 I4 Frame
IP54 380-480 V 0.75-4.0 kW

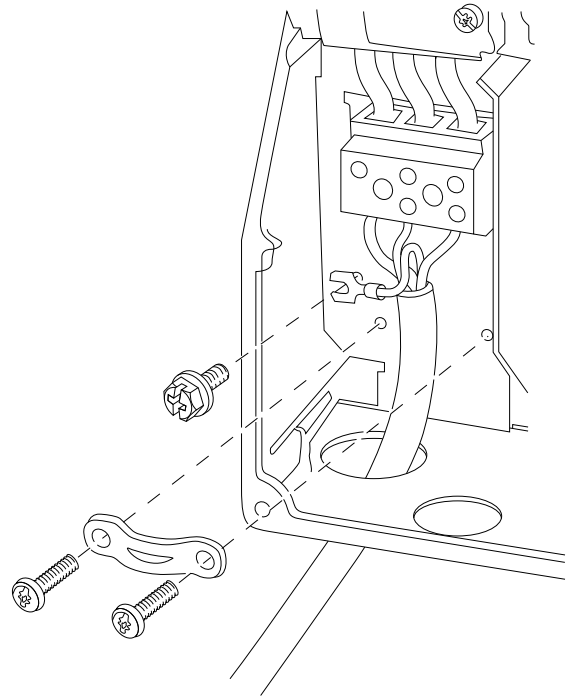


130BT326.10

Illustration 1.17 I6 Frame
IP54 380-480 V 22-37 kW


1	RS-485
2	Line in
3	Earth
4	Wire clamps
5	Motor
6	UDC
7	Relays
8	I/O

Table 1.20

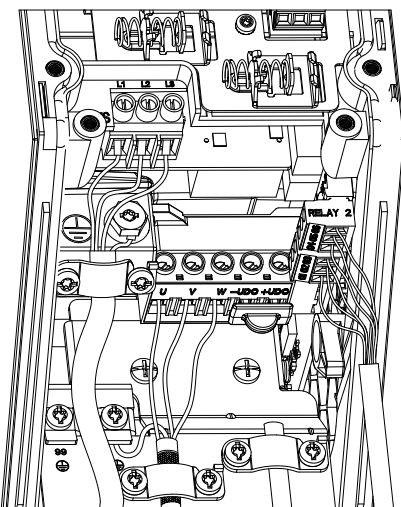


130BC203.10

Illustration 1.16 IP54 I2-I3-I4 frame

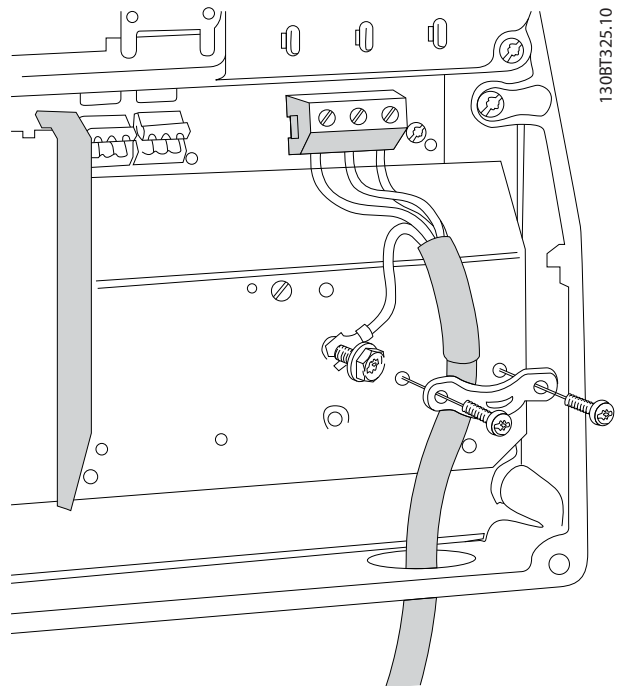


130BT325.10

Illustration 1.18 I6 Frame
IP54 380-480 V 22-37 kW

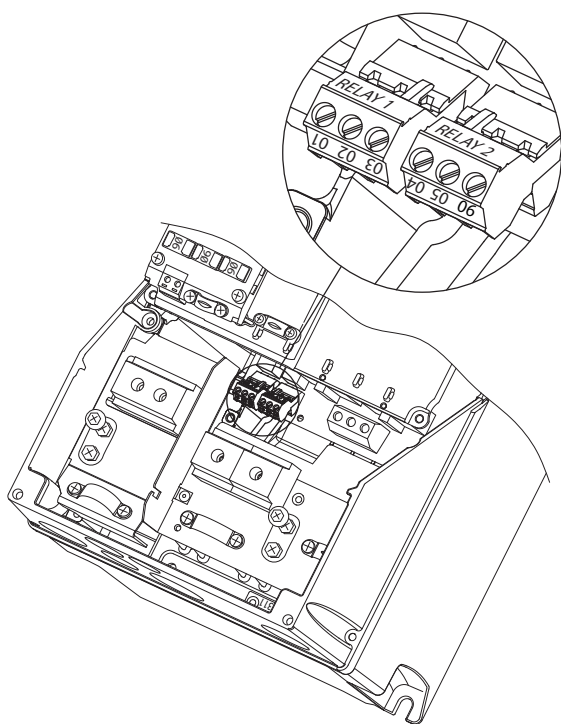

130BA215:10

Illustration 1.19 I6 Frame
IP54 380-480 V 22-37 kW

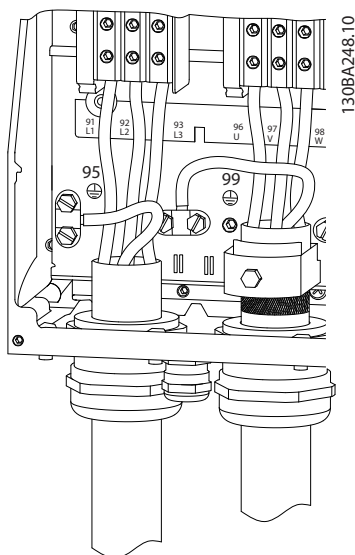

130BA248:10

Illustration 1.20 I7, I8 Frame
IP54 380-480 V 45-55 kW
IP54 380-480 V 75-90 kW

1.3.6 Fuses

Branch circuit protection

In order to protect the installation against electrical and fire hazard, all branch circuits in an installation, switch gear, machines etc., must be short-circuit and overcurrent protected according to national/international regulations.

Short circuit protection

Danfoss recommends using the fuses mentioned in the following tables to protect service personnel or other equipment in case of an internal failure in the unit or short-circuit on DC-link. The frequency converter provides full short circuit protection in case of a short-circuit on the motor.

Overcurrent protection

Provide overload protection to avoid overheating of the cables in the installation. Overcurrent protection must always be carried out according to national regulations. Fuses must be designed for protection in a circuit capable of supplying a maximum of 100,000 A_{rms} (symmetrical), 480 V maximum.

Non UL compliance

If UL/cUL is not to be complied with, Danfoss recommends using the fuses mentioned in *Table 1.21*, which ensures compliance with IEC 61800-5-1.

In case of malfunction, not following the fuse recommendation may result in damage to the frequency converter.

1

Power [kW]	Circuit Breaker		Fuse				
	UL	Non UL	UL				Non UL
			Bussmann Type RK5	Bussmann Type RK1	Bussmann Type J	Bussmann Type T	Max fuse Type G
3x200-240 V IP20							
0.25			FRS-R-10	KTN-R10	JKS-10	JIN-10	10
0.37			FRS-R-10	KTN-R10	JKS-10	JIN-10	10
0.75			FRS-R-10	KTN-R10	JKS-10	JIN-10	10
1.5			FRS-R-10	KTN-R10	JKS-10	JIN-10	10
2.2			FRS-R-15	KTN-R15	JKS-15	JIN-15	16
3.7			FRS-R-25	KTN-R25	JKS-25	JIN-25	25
5.5			FRS-R-50	KTN-R50	JKS-50	JIN-50	50
7.5			FRS-R-50	KTN-R50	JKS-50	JIN-50	50
11			FRS-R-80	KTN-R80	JKS-80	JIN-80	65
15	Cutler-Hammer EGE3100FFG	Moeller NZMB1- A125	FRS-R-100	KTN-R100			125
18.5			FRS-R-100	KTN-R100			125
22	Cutler-Hammer JGE3150FFG	Moeller NZMB1- A160	FRS-R-150	KTN-R150			160
30			FRS-R-150	KTN-R150			160
37	Cutler-Hammer JGE3200FFG	Moeller NZMB1- A200	FRS-R-200	KTN-R200			200
45			FRS-R-200	KTN-R200			200
3x380-480 V IP20							
0.37			FRS-R-10	KTS-R10	JKS-10	JJS-10	10
0.75			FRS-R-10	KTS-R10	JKS-10	JJS-10	10
1.5			FRS-R-10	KTS-R10	JKS-10	JJS-10	10
2.2			FRS-R-15	KTS-R15	JKS-15	JJS-15	16
3			FRS-R-15	KTS-R15	JKS-15	JJS-15	16
4			FRS-R-15	KTS-R15	JKS-15	JJS-15	16
5.5			FRS-R-25	KTS-R25	JKS-25	JJS-25	25
7.5			FRS-R-25	KTS-R25	JKS-25	JJS-25	25
11			FRS-R-50	KTS-R50	JKS-50	JJS-50	50
15			FRS-R-50	KTS-R50	JKS-50	JJS-50	50
18.5			FRS-R-80	KTS-R80	JKS-80	JJS-80	65
22			FRS-R-80	KTS-R80	JKS-80	JJS-80	65
30	Cutler-Hammer EGE3125FFG	Moeller NZMB1- A125	FRS-R-80	KTS-R80	JKS-R80	JJS-R80	80
37			FRS-R-100	KTS-R100	JKS-R100	JJS-R100	100
45			FRS-R-125	KTS-R125	JKS-R125	JJS-R125	125
55	Cutler-Hammer JGE3200FFG	Moeller NZMB1- A200	FRS-R-150	KTS-R150	JKS-R150	JJS-R150	150
75			FRS-R-200	KTS-R200	JKS-R200	JJS-R200	200
90	Cutler-Hammer JGE3250FFG	Moeller NZMB2- A250	FRS-R-250	KTS-R250	JKS-R250	JJS-R250	250

Table 1.21

	Circuit Breaker		Fuse				
	UL	Non UL	UL			Non UL	
Power [kW]			Bussmann Type RK5	Bussmann Type RK1	Bussmann Type J	Bussmann Type T	Max fuse Type G
3x525-600 V IP20							
2.2				KTS-R20			20
3				KTS-R20			20
3.7				KTS-R20			20
5.5				KTS-R20			20
7.5				KTS-R20			30
11				KTS-R30			35
15				KTS-R30			35
18.5	Cutler-Hammer EGE3080FFG	Cutler-Hammer EGE3080FFG	FRS-R-80	KTN-R80			80
22			FRS-R-80	KTN-R80			80
30			FRS-R-80	KTN-R80			80
37	Cutler-Hammer JGE3125FFG	Cutler-Hammer JGE3125FFG	FRS-R-125	KTN-R125			125
45			FRS-R-125	KTN-R125			125
55			FRS-R-125	KTN-R125			125
75	Cutler-Hammer JGE3200FAG	Cutler-Hammer JGE3200FAG	FRS-R-200	KTN-R200			200
90			FRS-R-200	KTN-R200			200
3x380-480 V IP54							
0.75							
1.5							
2.2							
3							
4							
5.5							
7.5							
11							
15							
18.5							
22	Moeller NZMB1-A125						125
30							125
37							125
45	Moeller NZMB2-A160						160
55							160
75	Moeller NZMB2-A250						200
90							200

Table 1.22 Fuses

1.3.7 EMC-Correct Electrical Installation

General points to be observed to ensure EMC-correct electrical installation.

- Use only screened/armoured motor cables and screened/armoured control cables.
- Connect the screen to earth at both ends.
- Avoid installation with twisted screen ends (pigtailed), since this ruins the screening effect at

high frequencies. Use the cable clamps provided instead.

- It is important to ensure good electrical contact from the installation plate through the installation screws to the metal cabinet of the frequency converter.
- Use starwashers and galvanically conductive installation plates.
- Do not use unscreened/unarmoured motor cables in the installation cabinets.

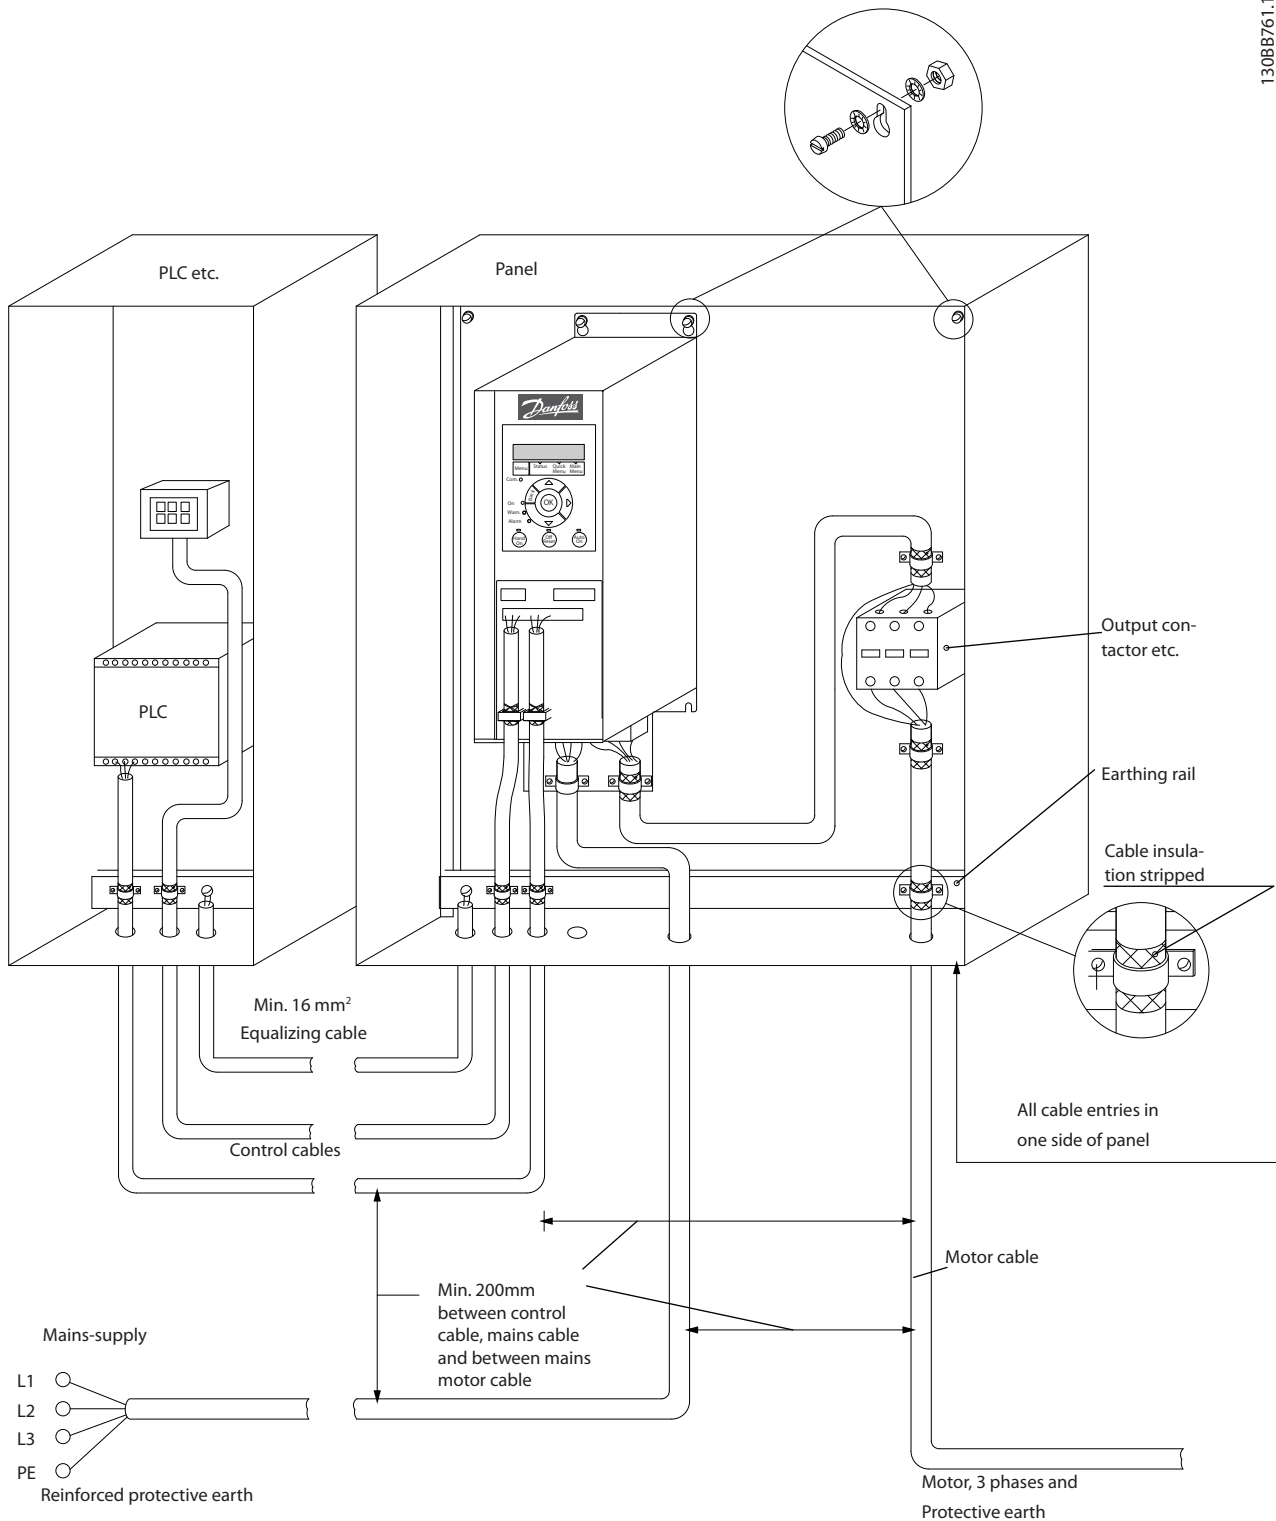


Illustration 1.21 EMC-correct Electrical Installation

NOTE

For North America use metal conduits instead of shielded cables.

1.3.8 Control Terminals

IP20 200-240 V 0.25-11 kW and IP20 380-480 V 0.37-22 kW:

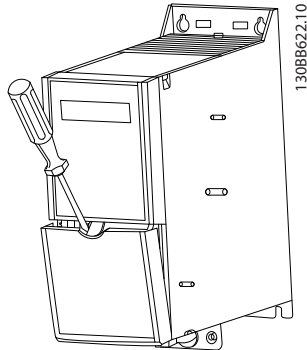


Illustration 1.22 Location of Control Terminals

1. Place a screwdriver behind the terminal cover to activate snap.
2. Tilt the screwdriver outwards to open the cover.

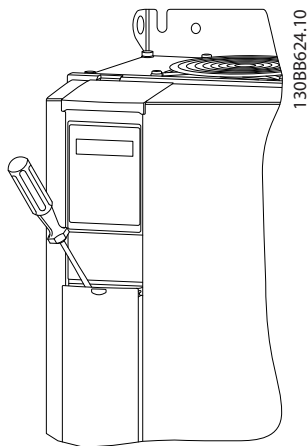


Illustration 1.23 IP20 380-480 V 30-90 kW

1. Place a screwdriver behind the terminal cover to activate snap.
2. Tilt the screwdriver outwards to open the cover.

Digital input 18, 19 and 27 mode is set in 5-00 Digital Input Mode (PNP is default value) and digital input 29 mode is set in 5-03 Digital Input 29 Mode (PNP is default value).

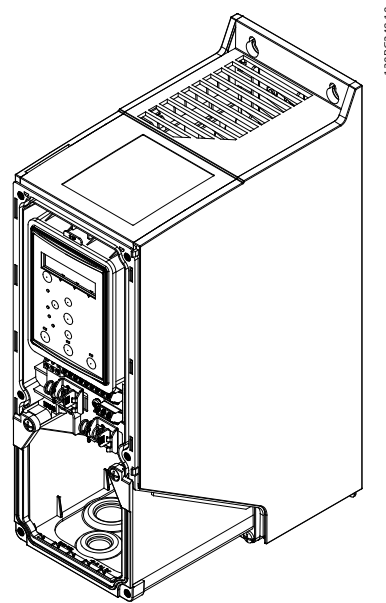


Illustration 1.24 IP54 400 V 0.75-7.5 kW

1. Remove the front cover.

Control terminals

Illustration 1.25 shows all control terminals of the frequency converter. Applying Start (term. 18), connection between terminal 12-27 and an analog reference (term. 53 or 54 and 55) make the frequency converter run.

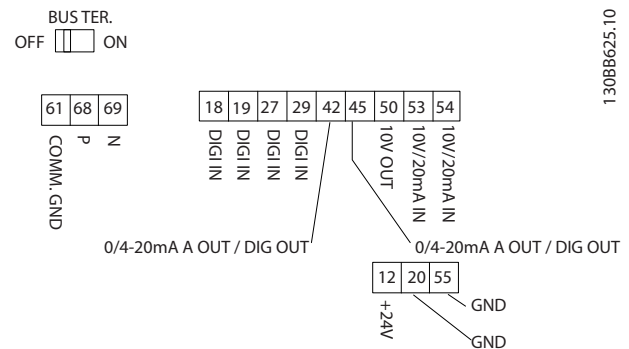


Illustration 1.25 Control Terminals

1.3.9 Electrical Overview

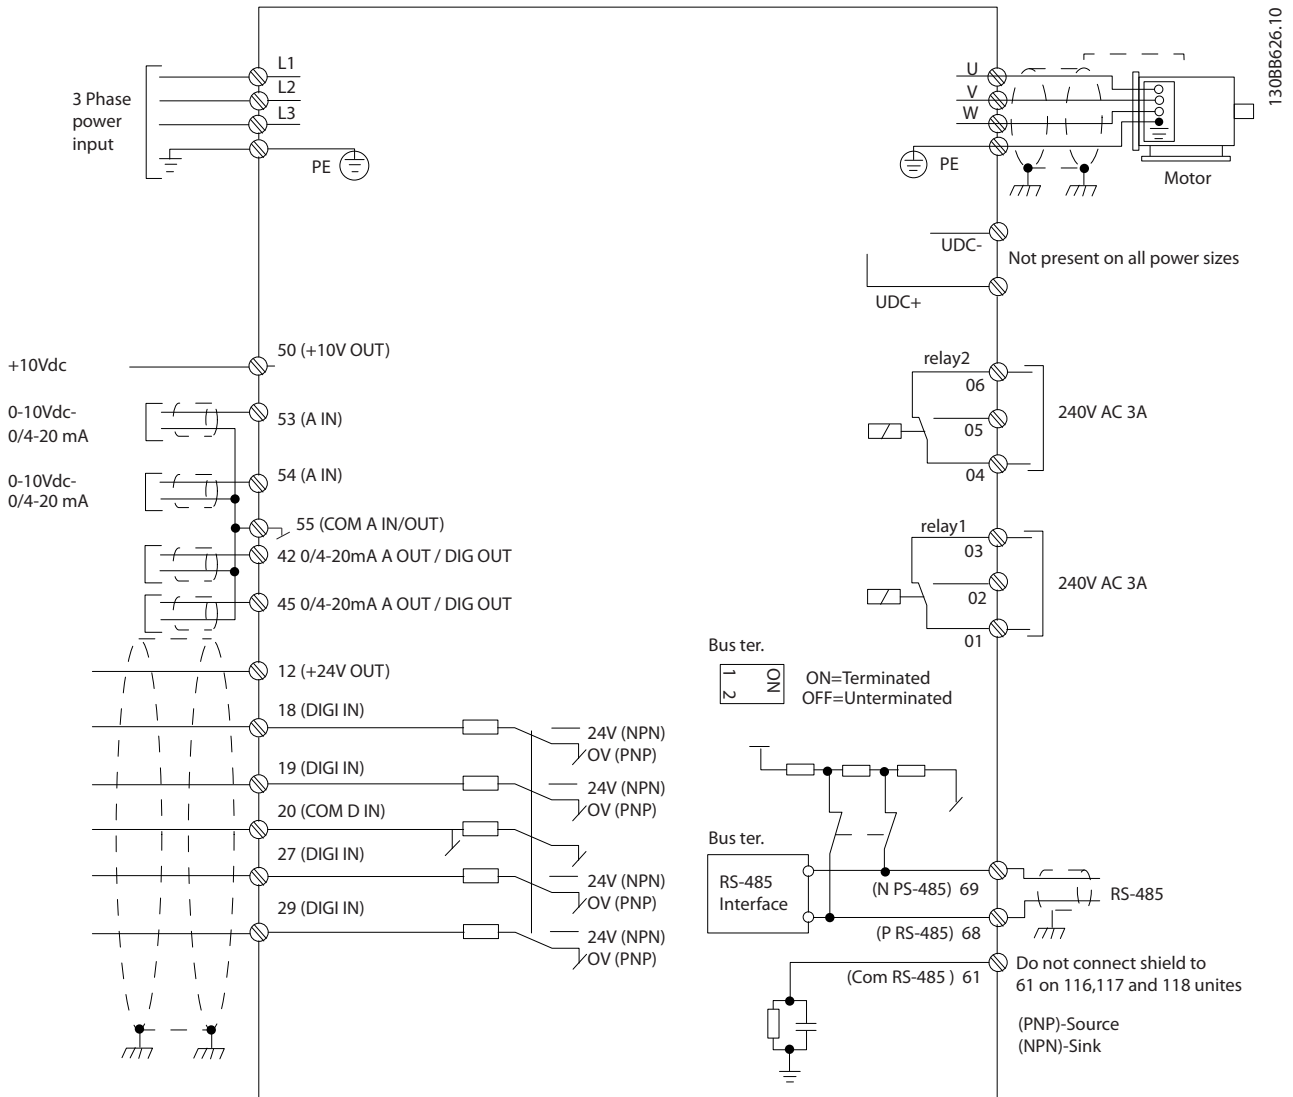


Illustration 1.26

NOTE

There is no access to UDC- and UDC+ on the following units:

- IP20 380-480 V 30-90 kW
- IP20 200-240 V 15-45 kW
- IP20 525-600 V 2.2-90 kW
- IP54 380-480 V 22-90 kW

1.4 Programming

1.4.1 Programming with the Local Control Panel (LCP)

NOTE

The frequency converter can also be programmed from a PC via RS-485 com-port by installing the MCT 10 Set-up Software. This software can either be ordered using code number 130B1000 or downloaded from the Danfoss Web site: www.danfoss.com/BusinessAreas/DrivesSolutions/software-download

1.4.2 Local Control Panel (LCP)

The following instructions are valid for the FC 101 LCP. The LCP is divided into four functional sections.

- A. Alphanumeric display
- B. Menu key
- C. Navigation keys and indicator lights (LEDs)
- D. Operation keys and indicator lights (LEDs)

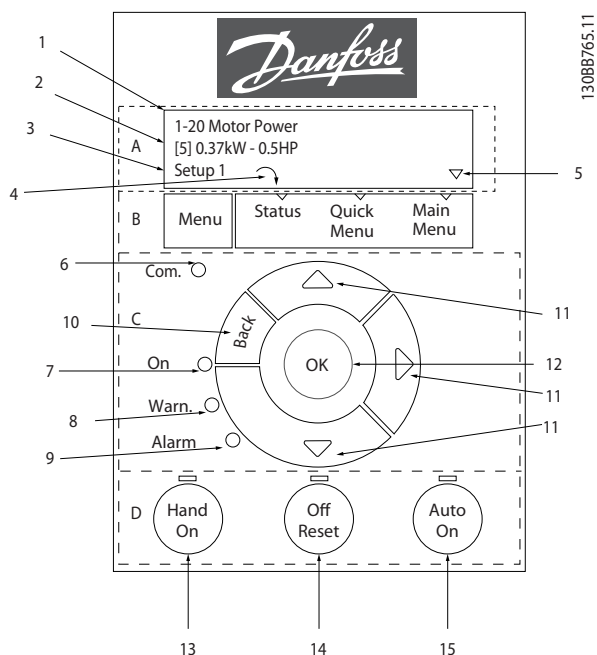


Illustration 1.27

A. Alpha Numeric Display

The LCD-display is back-lit with 2 alpha-numeric lines. All data is displayed on the LCP.

Information can be read from the display.

1	Parameter number and name.
2	Parameter value.
3	Set-up number shows the active set-up and the edit set-up. If the same set-up acts as both active and edit set-up, only that set-up number is shown (factory setting). When active and edit set-up differ, both numbers are shown in the display (Setup 12). The number flashing, indicates the edit set-up.
4	Motor direction is shown to the bottom left of the display – indicated by a small arrow pointing either clockwise or counterclockwise.
5	The triangle indicates if the LCP is in status, quick menu or main menu.

Table 1.23

B. Menu key

Use the menu key to select between status, quick menu or main menu.

C. Navigation keys and indicator lights (LEDs)

6	Com led: Flashes when bus communication is communicating.
7	Green LED/On: Control section is working.
8	Yellow LED/Warn.: Indicates a warning.
9	Flashing Red LED/Alarm: Indicates an alarm.
10	[Back]: For moving to the previous step or layer in the navigation structure
11	[▲] [▼] [▶]: For maneuvering between parameter groups, parameters and within parameters. Can also be used for setting local reference.
12	[OK]: For selecting a parameter and for accepting changes to parameter settings

Table 1.24

D. Operation keys and indicator lights (LEDs)

13	[Hand On]: Starts the motor and enables control of the frequency converter via the LCP. NOTE Terminal 27 Digital Input (5-12 Terminal 27 Digital Input) has coast inverse as default setting. This means that [Hand On] not starts the motor if there is no 24 V to terminal 27. Connect terminal 12 to terminal 27.
14	[Off/Reset]: Stops the motor (Off). If in alarm mode the alarm will be reset.
15	[Auto On]: frequency converter is controlled either via control terminals or serial communication.

Table 1.25

At power-up

At the first power-up, select the preferred language. Once selected, this screen never shows again in the following powerups, but language can still be changed in 0-01 Language.




Illustration 1.28

1.4.3 The Start-up Wizard for Open Loop Applications

The built-in “wizard” menu guides the installer through the setup of the frequency converter in a clear and structured manner to setup an open loop application. An open loop application is here an application with a start signal, analog reference (voltage or current) and optionally also relay signals (but no feed back signal from the process applied).

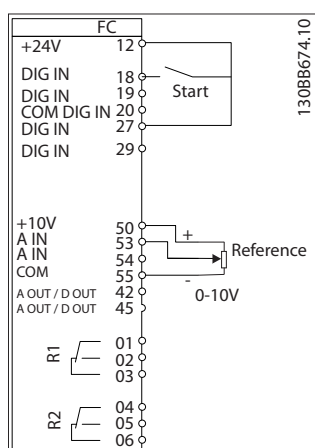


Illustration 1.29

The wizard will initially be shown after power up until any parameter has been changed. The wizard can always be accessed again through the quick menu. Press [OK] to start the wizard. If [Back] is pressed, the FC 101 returns to the status screen.






Illustration 1.30

At power up the user is asked to choose the preferred language.




Power Up Screen

The next screen will be the Wizard screen.



Wizard Screen



Status Screen

The Wizard can always be reentered via the Quick Menu!

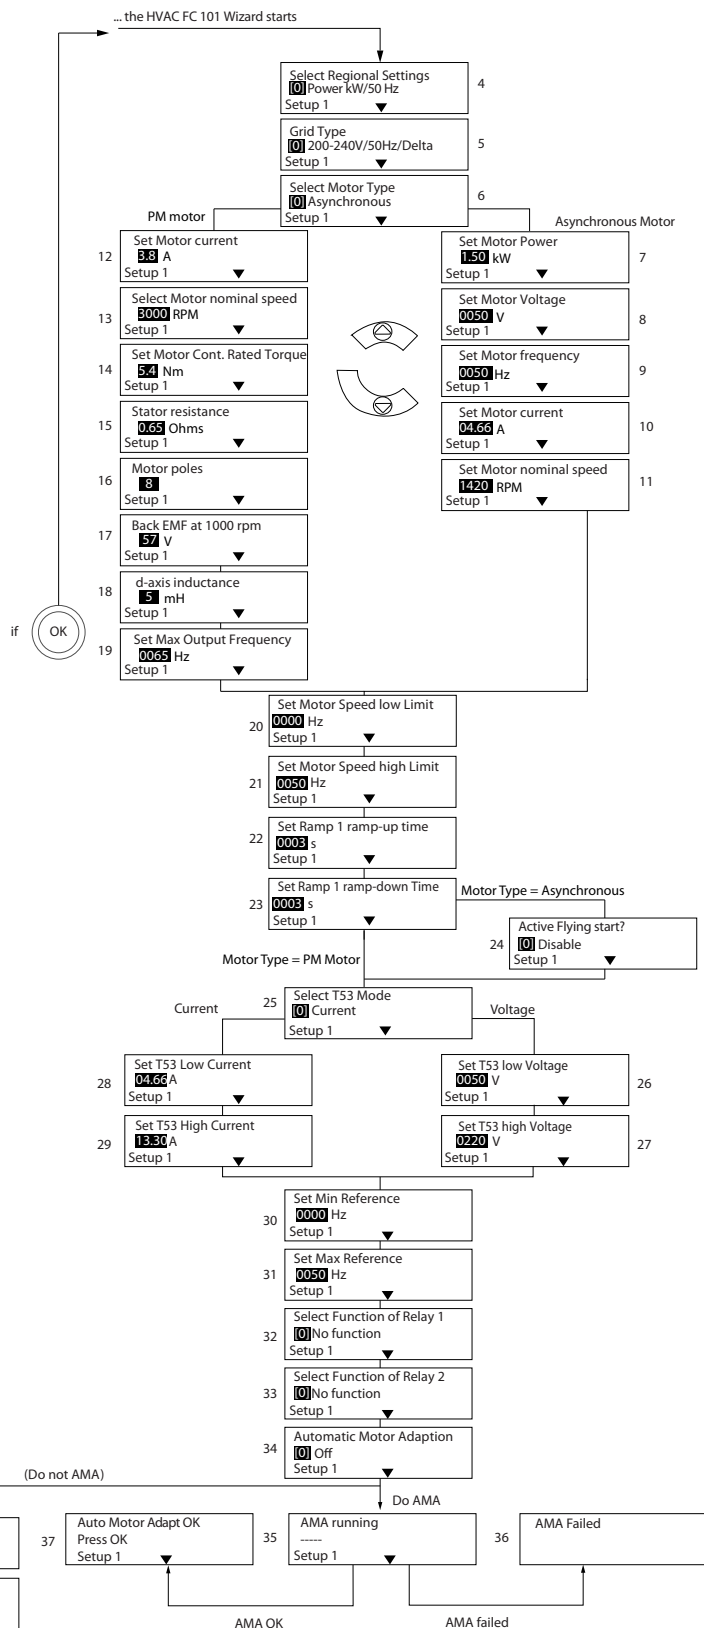


Illustration 1.31

The FC 101 Start-up Wizard for Open Loop Applications


No & Name	Range	Default	Function
0-03 Regional Settings	[0] International [1] US	0	
0-06 GridType	[0] 200-240 V/50 Hz/IT-grid [1] 200-240 V/50 Hz/Delta [2] 200-240 V/50 Hz [10] 380-440 V/50 Hz/IT-grid [11] 380-440 V/50 Hz/Delta [12] 380-440 V/50 Hz [20] 440-480 V/50 Hz/IT-grid [21] 440-480 V/50 Hz/Delta [22] 440-480 V/50 Hz [30] 525-600 V/50 Hz/IT-grid [31] 525-600 V/50 Hz/Delta [32] 525-600 V/50 Hz [100] 200-240 V/60 Hz/IT-grid [101] 200-240 V/60 Hz/Delta [102] 200-240 V/60 Hz [110] 380-440 V/60 Hz/IT-grid [111] 380-440 V/60 Hz/Delta [112] 380-440 V/60 Hz [120] 440-480 V/60 Hz/IT-grid [121] 440-480 V/60 Hz/Delta [122] 440-480 V/60 Hz [130] 525-600 V/60 Hz/IT-grid [131] 525-600 V/60 Hz/Delta [132] 525-600 V/60 Hz	Size related	Select operating mode for restart upon reconnection of the drive to mains voltage after power down
1-10 Motor Construction	*[0] Asynchron [1] PM, non salient SPM	[0] Asynchron	Setting the parameter value might change these parameters: 1-01 Motor Control Principle 1-03 Torque Characteristics 1-14 Damping Gain 1-15 Low Speed Filter Time Const. 1-16 High Speed Filter Time Const. 1-17 Voltage filter time const. 1-20 Motor Power [kW] 1-22 Motor Voltage 1-23 Motor Frequency 1-24 Motor Current 1-25 Motor Nominal Speed 1-26 Motor Cont. Rated Torque 1-30 Stator Resistance (Rs) 1-33 Stator Leakage Reactance (X1) 1-35 Main Reactance (Xh) 1-37 d-axis Inductance (Ld) 1-39 Motor Poles 1-40 Back EMF at 1000 RPM 1-66 Min. Current at Low Speed 1-72 Start Function 1-73 Flying Start 4-19 Max Output Frequency 4-58 Missing Motor Phase Function
1-20 Motor Power	0.12-110 kW/0.16-150 hp	Size related	Enter motor power from nameplate data
1-22 Motor Voltage	50.0-1000.0 V	Size related	Enter motor voltage from nameplate data
1-23 Motor Frequency	20.0-400.0 Hz	Size related	Enter motor frequency from nameplate data

No & Name	Range	Default	Function
1-24 Motor Current	0.01-10000.00 A	Size related	Enter motor current from nameplate data
1-25 Motor Nominal Speed	100.0-9999.0 RPM	Size related	Enter motor nominal speed from nameplate data
1-26 Motor Cont. Rated Torque	0.1-1000.0	Size related	This parameter is available only when 1-10 Motor Construction Design is set to [1] PM, non-salient SPM . NOTE Changing this parameter will affect settings of other parameters
1-29 Automatic Motor Adaption (AMA)	See 1-29 Automatic Motor Adaption (AMA)	Off	Performing an AMA optimizes motor performance
1-30 Stator Resistance (Rs)	0.000-99.990	Size related	Set the stator resistance value
1-37 d-axis Inductance (Ld)	0-1000	Size related	Enter the value of the d-axis inductance. Obtain the value from the permanent magnet motor data sheet. The de-axis inductance cannot be found by performing an AMA.
1-39 Motor Poles	2-100	4	Enter the number of motor poles
1-40 Back EMF at 1000 RPM	10-9000	Size related	Line-Line RMS back EMF voltage at 1000 RPM
1-73 Flying Start			When PM is selected, Flying Start is enabled and can not disable
1-73 Flying Start	[0] Disabled [1] Enabled	0	Select [1] Enable to enable the drive to catch a motor spinning due to mains drop-out. Select [0] Disable if this function is not required. When is enabled 1-71 Start Delay and 1-72 Start Function have no function. is active in VVC+ mode only
3-02 Minimum Reference	-4999-4999	0	The minimum reference is the lowest value obtainable by summing all references
3-03 Maximum Reference	-4999-4999	50	The maximum reference is the lowest obtainable by summing all references
3-41 Ramp 1 Ramp Up Time	0.05-3600.0 s	Size related	Ramp up time from 0 to rated 1-23 Motor Frequency if Asynchron motor is selected; ramp up time from 0 to 1-25 Motor Nominal Speed if PM motor is selected
3-42 Ramp 1 Ramp Down Time	0.05-3600.0 s	Size related	Ramp down time from rated 1-23 Motor Frequency to 0 if Asynchron motor is selected; ramp down time from 1-25 Motor Nominal Speed to 0 if PM motor is selected
4-12 Motor Speed Low Limit [Hz]	0.0-400 Hz	0 Hz	Enter the minimum limit for low speed
4-14 Motor Speed High Limit [Hz]	0.0-400 Hz	65 Hz	Enter the maximum limit for high speed
4-19 Max Output Frequency	0-400	Size related	Enter the maximum output frequency value
5-40 Function Relay [0] Function relay	See 5-40 Function Relay	Alarm	Select the function to control output relay 1
5-40 Function Relay [1] Function relay	See 5-40 Function Relay	Drive running	Select the function to control output relay 2
6-10 Terminal 53 Low Voltage	0-10 V	0.07 V	Enter the voltage that corresponds to the low reference value
6-11 Terminal 53 High Voltage	0-10 V	10 V	Enter the voltage that corresponds to the high reference value

No & Name	Range	Default	Function
6-12 Terminal 53 Low Current	0-20 mA	4	Enter the current that corresponds to the low reference value
6-13 Terminal 53 High Current	0-20 mA	20	Enter the current that corresponds to the high reference value
6-19 Terminal 53 mode	[0] Current [1] Voltage	1	Select if terminal 53 is used for current- or voltage input

Table 1.26

Closed Loop Set-up Wizard

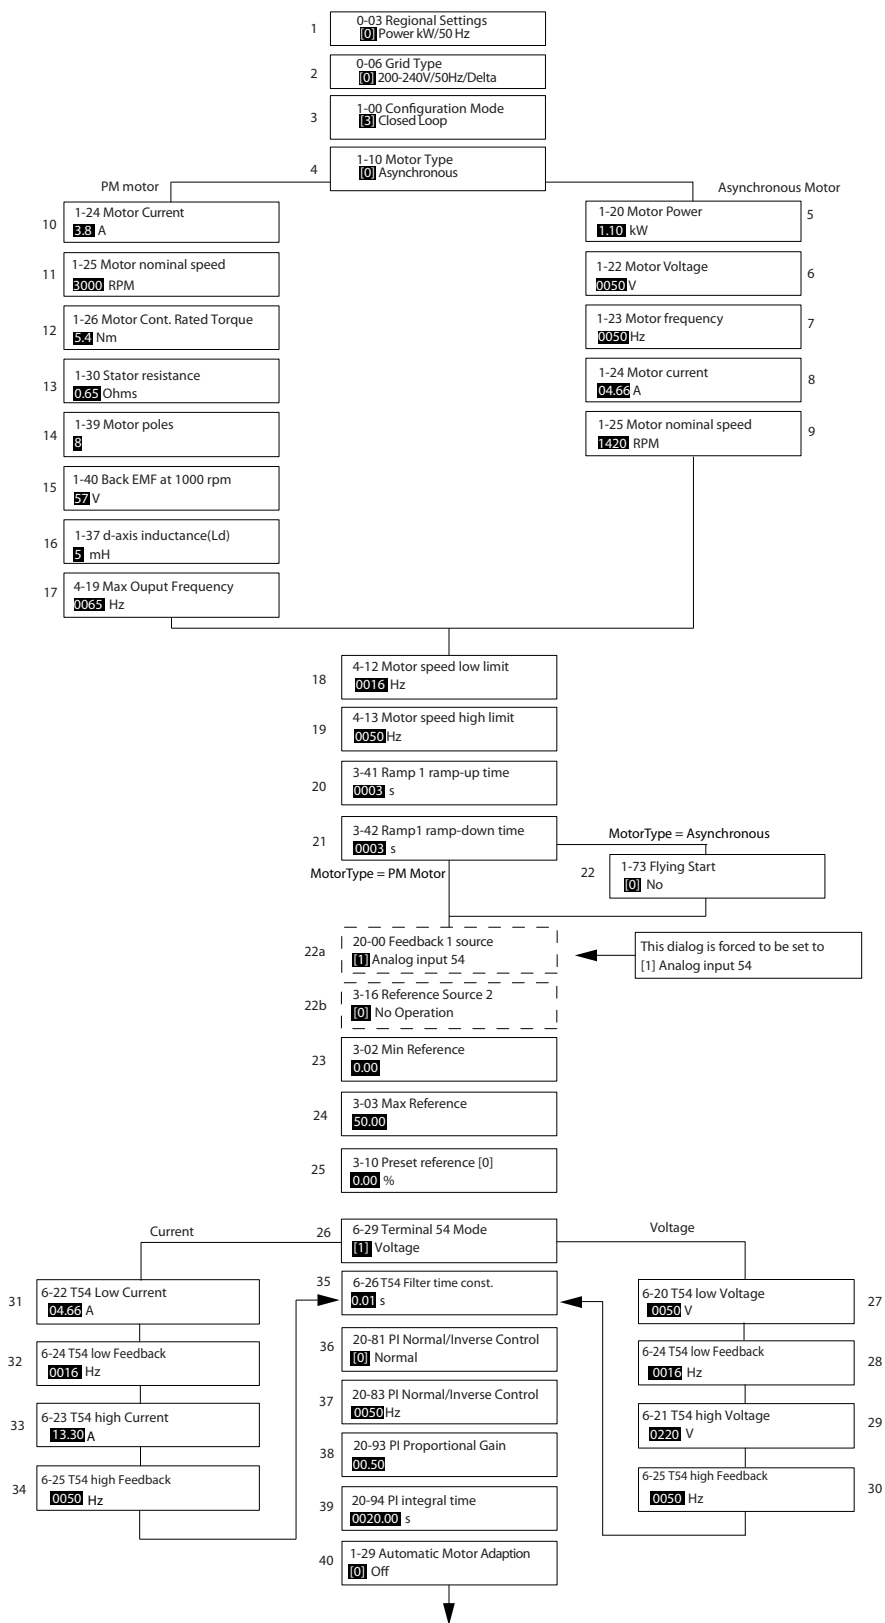

1308C402.10

Illustration 1.32

Closed Loop Set-up Wizard

No & Name	Range	Default	Function
0-03 Regional Settings	[0] International [1] US	0	
0-06 GridType	[0] -[[132] see start -up wizard for open loop application	Size selected	Select operating mode for restart upon reconnection of the frequency converter to mains voltage after power down
1-00 Configuration Mode	[0] Open loop [3] Closed loop	0	Change this parameter to Closed loop
1-10 Motor Construction	*[0] Motor construction [1] PM, non salient SPM	[0] Asynchron	Setting the parameter value might change these parameters: 1-01 Motor Control Principle 1-03 Torque Characteristics 1-14 Damping Gain 1-15 Low Speed Filter Time Const. 1-16 High Speed Filter Time Const. 1-17 Voltage filter time const. 1-20 Motor Power [kW] 1-22 Motor Voltage 1-23 Motor Frequency 1-25 Motor Nominal Speed 1-26 Motor Cont. Rated Torque 1-30 Stator Resistance (Rs) 1-33 Stator Leakage Reactance (X1) 1-35 Main Reactance (Xh) 1-37 d-axis Inductance (Ld) 1-39 Motor Poles 1-40 Back EMF at 1000 RPM 1-66 Min. Current at Low Speed 1-72 Start Function 1-73 Flying Start 4-19 Max Output Frequency 4-58 Missing Motor Phase Function
1-20 Motor Power	0.09-110 kW	Size related	Enter motor power from nameplate data
1-22 Motor Voltage	50.0-1000.0 V	Size related	Enter motor voltage from nameplate data
1-23 Motor Frequency	20.0-400.0 Hz	Size related	Enter motor frequency from nameplate data
1-24 Motor Current	0.0 -10000.00 A	Size related	Enter motor current from nameplate data
1-25 Motor Nominal Speed	100.0-9999.0 RPM	Size related	Enter motor nominal speed from nameplate data
1-26 Motor Cont. Rated Torque	0.1-1000.0	Size related	This parameter is available only when 1-10 Motor Construction Design is set to [1] PM, non-salient SPM . NOTE Changing this parameter affects settings of other parameters
1-29 Automatic Motor Adaption (AMA)		Off	Performing an AMA optimizes motor performance
1-30 Stator Resistance (Rs)	0.000-99.990	Size related	Set the stator resistance value
1-37 d-axis Inductance (Ld)	0-1000	Size related	Enter the value of the d-axis inductance. Obtain the value from the permanent magnet motor data sheet. The de-axis inductance cannot be found by performing an AMA.
1-39 Motor Poles	2-100	4	Enter the number of motor poles
1-40 Back EMF at 1000 RPM	10-9000	Size related	Line-Line RMS back EMF voltage at 1000 RPM

No & Name	Range	Default	Function
1-73 Flying Start	[0] Disabled [1] Enabled	0	Select [1] <i>Enable</i> to enable the frequency converter to catch a spinning motor. I.e. fan applications. When PM is selected, Flying Start is enabled.
3-02 Minimum Reference	-4999-4999	0	The minimum reference is the lowest value obtainable by summing all references
3-03 Maximum Reference	-4999-4999	50	The maximum reference is the highest value obtainable by summing all references
3-10 Preset Reference	-100-100%	0	Enter the set point
3-41 Ramp 1 Ramp Up Time	0.05-3600.0 s	Size related	Ramp up time from 0 to rated 1-23 Motor Frequency if Asynchron motor is selected; ramp up time from 0 to 1-25 Motor Nominal Speed if PM motor is selected"
3-42 Ramp 1 Ramp Down Time	0.05-3600.0 s	Size related	Ramp down time from rated 1-23 Motor Frequency to 0 if Asynchron motor is selected; ramp down time from 1-25 Motor Nominal Speed to 0 if PM motor is selected
4-12 Motor Speed Low Limit [Hz]	0.0-400 Hz	0.0 Hz	Enter the minimum limit for low speed
4-14 Motor Speed High Limit [Hz]	0-400 Hz	65 Hz	Enter the minimum limit for high speed
4-19 Max Output Frequency	0-400	Size related	Enter the maximum output frequency value
6-29 Terminal 54 mode	[0] Current [1] Voltage	1	Select if terminal 54 is used for current- or voltage input
6-20 Terminal 54 Low Voltage	0-10 V	0.07 V	Enter the voltage that corresponds to the low reference value
6-21 Terminal 54 High Voltage	0-10 V	10 V	Enter the voltage that corresponds to the low high reference value
6-22 Terminal 54 Low Current	0-20 mA	4	Enter the current that corresponds to the high reference value
6-23 Terminal 54 High Current	0-20 mA	20	Enter the current that corresponds to the high reference value
6-24 Terminal 54 Low Ref./Feedb. Value	-4999-4999	0	Enter the feedback value that corresponds to the voltage or current set in 6-20 <i>Terminal 54 Low Voltage</i> /6-22 <i>Terminal 54 Low Current</i>
6-25 Terminal 54 High Ref./Feedb. Value	-4999-4999	50	Enter the feedback value that corresponds to the voltage or current set in 6-21 <i>Terminal 54 High Voltage</i> /6-23 <i>Terminal 54 High Current</i>
6-26 Terminal 54 Filter Time Constant	0-10 s	0.01	Enter the filter time constant
20-81 PI Normal/ Inverse Control	[0] Normal [1] Inverse	0	Select [0] <i>Normal</i> to set the process control to increase the output speed when the process error is positive. Select [1] <i>Inverse</i> to reduce the output speed.
20-83 PI Start Speed [Hz]	0-200 Hz	0	Enter the motor speed to be attained as a start signal for commencement of PI control
20-93 PI Proportional Gain	0-10	0.01	Enter the process controller proportional gain. Quick control is obtained at high amplification. However if amplification is too great, the process may become unstable
20-94 PI Integral Time	0.1-999.0 s	999.0 s	Enter the process controller integral time. Obtain quick control through a short integral time, though if the integral time is too short, the process becomes unstable. An excessively long integral time disables the integral action.

Table 1.27

1

Motor Set-up

The Quick Menu Motor Set-up guides through the needed motor parameters.

No & Name	Range	Default	Function
0-03 Regional Settings	[0] International [1] US	0	
0-06 GridType	[0] -[132] see start -up wizard for open loop application	Size selected	Select operating mode for restart upon reconnection of the drive to mains voltage after power down
1-10 Motor Construction	*[0] Motor construction [1] PM, non salient SPM	[0] Asynchron	
1-20 Motor Power	0.12-110 kW/ 0.16-150 hp	Size related	Enter motor power from nameplate data
1-22 Motor Voltage	50.0-1000.0 V	Size related	Enter motor voltage from nameplate data
1-23 Motor Frequency	20.0-400.0 Hz	Size related	Enter motor frequency from nameplate data
1-24 Motor Current	0.01-10000.00 A	Size related	Enter motor current from nameplate data
1-25 Motor Nominal Speed	100.0-9999.0 RPM	Size related	Enter motor nominal speed from nameplate data
1-26 Motor Cont. Rated Torque	0.1-1000.0	Size related	This parameter is available only when 1-10 Motor Construction Design is set to [1] PM, non-salient SPM. NOTE Changing this parameter affects settings of other parameters
1-30 Stator Resistance (Rs)	0.000-99.990	Size related	Set the stator resistance value

No & Name	Range	Default	Function
1-37 d-axis Inductance (Ld)	0-1000	Size related	Enter the value of the d-axis inductance. Obtain the value from the permanent magnet motor data sheet. The de-axis inductance cannot be found by performing an AMA.
1-39 Motor Poles	2-100	4	Enter the number of motor poles
1-40 Back EMF at 1000 RPM	10-9000	Size related	Line-Line RMS back EMF voltage at 1000 RPM
1-73 Flying Start	[0] Disabled [1] Enabled	0	Select Enable to enable the frequency converter to catch a spinning motor
3-41 Ramp 1 Ramp Up Time	0.05-3600.0 s	Size related	Ramp up time from 0 to rated 1-23 Motor Frequency
3-42 Ramp 1 Ramp Down Time	0.05-3600.0 s	Size related	Ramp down time from rated 1-23 Motor Frequency to 0
4-12 Motor Speed Low Limit [Hz]	0.0-400 Hz	0.0 Hz	Enter the minimum limit for low speed
4-14 Motor Speed High Limit [Hz]	0.0-400 Hz	65	Enter the maximum limit for high speed
4-19 Max Output Frequency	0-400	Size related	Enter the maximum output frequency value

Table 1.28

Changes Made

Changes Made lists all parameters changed since factory setting. Only the changed parameters in current edit-setup are listed in changes made.

If the parameters value is changed back to factory setting's value from another different value, the parameter will NOT be listed in Changes Made.

1. Press [Menu] key to enter the Quick Menu until indicator in display is placed above Quick Menu.
2. Press [▲] [▼] to select either FC 101 wizard, closed loop setup, motor setup or changes made, then press [OK].
3. Press [▲] [▼] to browse through the parameters in the Quick Menu.
4. Press [OK] to select a parameter.
5. Press [▲] [▼] to change the value of a parameter setting.
6. Press [OK] to accept the change.
7. Press either [Back] twice to enter "Status", or press [Menu] once to enter "Main Menu".

The Main Menu accesses all parameters.

1. Press [Menu] key until indicator in display is placed above "Main Menu".
2. Press [▲] [▼] to browse through the parameter groups.
3. Press [Ok] to select a parameter group.
4. Press [▲] [▼] to browse through the parameters in the specific group.
5. Press [Ok] to select the parameter.
6. Press [▲] [▼] to set/change the parameter value.

1.5.1 Main menu structure							
0-0* Operation / Display	Motor Cable Length	4-10	Motor Speed Direction	6-22	Terminal 54 Low Current	8-9*	Bus Feedback
0-0* Basic Settings	Motor Cable Length Feet	4-12	Motor Speed Low Limit [Hz]	6-23	Terminal 54 High Current	8-94	Bus Feedback 1
0-01 Language	Load Indep. Setting	4-14	Motor Speed High Limit [Hz]	6-24	Terminal 54 Low Ref./Feedb. Value	13-3**	Smart Logic
0-03 Regional Settings	Motor Magnetisation at Zero Speed	4-18	Current Limit	6-25	Terminal 54 High Ref./Feedb. Value	13-0*	SLC Settings
0-04 Operating State at Power-up	Min Speed Normal Magnetising [Hz]	4-19	Motor Output Frequency	6-26	Terminal 54 Filter Time Constant	13-00	SL Controller Mode
0-06 GridType	U/f Characteristic - U	4-4*	Adj. Warnings 2	6-29	Terminal 54 mode	13-01	Start Event
0-07 Auto DC Braking	U/f Characteristic - F	4-40	Warning Freq. Low	6-7*	Analog/Digital Output 45	13-02	Stop Event
0-1* Set-up Operations	Load Depen. Setting	4-41	Warning Freq. High	6-70	Terminal 45 Mode	13-03	Reset SLC
0-10 Active Set-up	Low Speed Load Compensation	4-5*	Adj. Warnings	6-71	Terminal 45 Analog Output	13-1*	Comparators
0-11 Programming Set-up	High Speed Load Compensation	4-50	Warning Current Low	6-72	Terminal 45 Digital Output	13-10	Comparator Operand
0-12 Link Setups	Slip Compensation	4-51	Warning Current High	6-73	Terminal 45 Output Min Scale	13-11	Comparator Operator
0-3* LCP Custom Readout	Slip Compensation Time Constant	4-54	Warning Reference Low	6-74	Terminal 45 Output Max Scale	13-12	Comparator Value
0-30 Custom Readout Unit	Resonance Dampening	4-55	Warning Reference High	6-9*	Analog/Digital Output 42	13-2*	Timers
0-31 Custom Readout Min Value	Resonance Dampening Time Constant	4-56	Warning Feedback Low	6-90	Terminal 42 Mode	13-20	SL Controller Timer
0-32 Custom Readout Max Value	Min. Current at Low Speed	4-57	Warning Feedback High	6-92	Terminal 42 Analog Output	13-4*	Logic Rules
0-37 Display Text 1	Start Adjustments	4-6*	Missing Motor Phase Function	6-91	Terminal 42 Digital Output	13-40	Logic Rule Boolean 1
0-38 Display Text 2	Start Delay	4-61	Speed Bypass	6-92	Terminal 42 Output	13-41	Logic Rule Boolean 1
0-39 Display Text 3	Start Function	4-63	Bypass Speed From [Hz]	6-93	Terminal 42 Output Min Scale	13-42	Logic Rule Boolean 2
0-40 [Hand on] Key on LCP	Flying Start	4-64	Bypass Speed To [Hz]	6-94	Terminal 42 Output Max Scale	13-43	Logic Rule Boolean 2
0-42 [Auto on] Key on LCP	Stop Adjustments	4-66	Semi-Auto Bypass Set-up	6-96	Terminal 42 Output Bus Control	13-44	Logic Rule Boolean 3
0-44 [Off/Reset] Key on LCP	Function at Stop	5-3**	Digital In/Out	6-98	Drive Type	13-5*	States
0-5* Copy/Save	Motor Temperature	5-00	Digital I/O mode	8-8*	Comm. and Options	13-51	SL Controller Event
0-50 LCP Copy	Motor Thermal Protection	5-03	Digital Input Mode	8-0*	General Settings	13-52	SL Controller Action
0-51 Set-up Copy	Thermistor Source	5-10	Digital Input 29 Mode	8-01	Control Site	14-3**	Special Functions
0-6* Password	Brakes	5-1*	Digital Inputs	8-02	Control Source	14-0*	Inverter Switching
0-60 Main Menu Password	DC-Brake	5-11	Terminal 18 Digital Input	8-03	Control Timeout Time	14-01	Switching Frequency
1-0* Load and Motor	DC Hold/Motor Preheat Current	5-12	Terminal 19 Digital Input	8-04	Control Timeout Function	14-03	Overmodulation
1-0* General Settings	DC Brake Current	5-13	Terminal 27 Digital Input	8-3*	FC Port Settings	14-08	Damping Gain Factor
1-00 Configuration Mode	DC Braking Time	5-20	Terminal 29 Digital Input	8-30	Protocol	14-1*	Mains On/Off
1-01 Motor Control Principle	DC Brake Cut In Speed	5-34	On Delay, Digital Output	8-31	Address	14-10	Mains Failure
1-03 Torque Characteristics	Parking Current	5-35	Off Delay, Digital Output	8-32	Baud Rate	14-12	Function at Mains Imbalance
1-06 Clockwise Direction	Parking Time	5-4*	Relays	8-33	Parity / Stop Bits	14-2*	Reset Functions
1-1* Motor Selection	Brake Energy Funct.	5-40	On Delay, Relay	8-35	Minimum Response Delay	14-20	Reset Mode
1-10 Motor Construction	Brake Function	5-41	On Delay, Relay	8-36	Maximum Response Delay	14-21	Automatic Restart Time
1-14 Damping Gain	AC Brake, Max current	5-42	Off Delay, Relay	8-37	Maximum Inter-char delay	14-22	Operation Mode
1-15 Low Speed Filter Time Const	Over-voltage Control	5-5*	Pulse Input	8-4*	FC MC protocol set	14-23	Typecode Setting
1-16 High Speed Filter Time Const	Reference / Ramps	5-50	Term. 29 Low Frequency	8-43	PCD Read Configuration	14-27	Action At Inverter Fault
1-17 Voltage filter time const	Reference Limits	5-51	Term. 29 High Frequency	8-5*	Digital/Bus	14-28	Production Settings
1-2* Motor Data	Minimum Reference	5-52	Term. 29 Low Ref./Feedb. Value	8-50	Coasting Select	14-29	Service Code
1-20 Motor Power	Maximum Reference	5-53	Term. 29 High Ref./Feedb. Value	8-51	Quick Stop Select	14-4*	Energy Optimising
1-22 Motor Voltage	Reference 1 Source	5-9*	Bus Controlled	8-52	DC Brake Select	14-40	VT Level
1-23 Motor Frequency	Reference 2 Source	6-3**	Analog In/Out	8-53	Start Select	14-41	AE0 Minimum Magnetisation
1-24 Motor Current	Reference 3 Source	6-00	Analog I/O Mode	8-54	Reversing Select	14-5*	Environment
1-25 Motor Nominal Speed	Ramp 1	6-01	Live Zero Timeout Time	8-55	Set-up Select	14-50	RFI Filter
1-26 Motor Cont. Rated Torque	Ramp 1 Ramp Up Time	6-10	Live Zero Timeout Function	8-56	Preset Reference Select	14-51	DC-Link Voltage Compensation
1-29 Automatic Motor Adaptation (AMA)	Ramp 1 Ramp Down Time	6-11	Terminal 53 Low Voltage	8-7*	BACnet	14-52	Fan Control
1-3* Adv. Motor Data	Ramp 2	6-12	Terminal 53 High Voltage	8-70	BACnet Device Instance	14-53	Fan Monitor
1-30 Stator Resistance (Rs)	Ramp 2 Ramp Up Time	6-13	Terminal 53 Low Current	8-72	MS/TP Max Masters	14-55	Output Filter
1-33 Stator Leakage Reactance (Xl)	Ramp 2 Ramp Down Time	6-14	Terminal 53 High Current	8-73	MS/TP Max Info Frames	14-6*	Auto Derate
1-35 Main Reactance (Xh)	Other Ramps	6-15	Terminal 53 Low Voltage	8-74	"I am" Service	14-63	Min Switch Frequency
1-37 d-axis Inductance (Ld)	Quick Stop Ramp Time	6-16	Terminal 53 High Voltage	8-8*	Initialisation Password	15-3**	Drive Information
1-39 Motor Poles	Limits / Warnings	6-20	Terminal 54 Low Voltage	8-80	Bus Message Count	15-00	Operating Hours
1-4* Adv. Motor Data II	Motor Limits	6-21	Terminal 54 High Voltage	8-81	Bus Error Count	15-01	Running Hours
1-40 Back EMF at 1000 RPM				8-82	Slave Messages Rcvd	15-02	kWh Counter
				8-83	Slave Error Count	15-03	Power Up's
				8-84	Slave Messages Sent	15-04	Over Temp's
				8-85	Slave Timeout Errors	15-05	Over Volt's
				8-88	Reset FC port Diagnostics	15-06	Reset kWh Counter

15-07	Reset Running Hours Counter	16-79	Analog Output AO45	38-20	MOC_TestUS16
15-3*	Alarm Log	16-8*	Fieldbus & FC Port	38-21	MOC_TestS16
15-30	Alarm Log: Error Code	16-86	FC Port: REF 1	38-23	TestMocFunctions
15-31	InternalFaultReason	16-9*	Diagnosis Readouts	38-24	DC Link Power Measurement
15-4*	Drive Identification	16-90	Alarm Word	38-25	CheckSum
15-40	FC Type	16-91	Alarm Word 2	38-30	Analog Input 53 (%)
15-41	Power Section	16-92	Warning Word	38-31	Analog Input 54 (%)
15-42	Voltage	16-93	Warning Word 2	38-32	Input Reference 1
15-43	Software Version	16-94	Ext. Status Word	38-33	Input Reference 2
15-44	Ordered TypeCode	16-95	Ext. Status Word 2	38-34	Input Reference Setting
15-46	Drive Ordering No	18-**	Info & Readouts	38-35	Feedback (%)
15-47	Power Card Ordering No	18-1*	Fire Mode Log	38-36	Fault Code
15-48	LCP ID No	18-10	FireMode LogEvent	38-37	Control Word
15-49	SW ID Control Card	20-**	Drive Closed Loop	38-38	ResetCountersControl
15-50	SW ID Power Card	20-0*	Feedback	38-39	Active Setup For BACnet
15-51	Drive Serial Number	20-00	Feedback 1 Source	38-40	Name Of Analog Value 1 For BACnet
15-53	Power Card Serial Number	20-01	Feedback 1 Conversion	38-41	Name Of Analog Value 3 For BACnet
15-9*	Parameter Info	20-8*	PI Basic Settings	38-42	Name Of Analog Value 5 For BACnet
15-92	Defined Parameters	20-81	PI Normal/ Inverse Control	38-43	Name Of Analog Value 6 For BACnet
15-97	Application Type	20-83	PI Start Speed [Hz]	38-44	Name Of Binary Value 1 For BACnet
15-98	Drive Identification	20-84	On Reference Bandwidth	38-45	Name Of Binary Value 2 For BACnet
16-**	Data Readouts	20-9*	PI Controller	38-46	Name Of Binary Value 3 For BACnet
16-0*	General Status	20-91	PI Anti Windup	38-47	Name Of Binary Value 4 For BACnet
16-00	Control Word	20-93	PI Proportional Gain	38-48	Name Of Binary Value 5 For BACnet
16-01	Reference [Unit]	20-94	PI Integral Time	38-49	Name Of Binary Value 6 For BACnet
16-02	Reference [%]	20-97	PI Feed Forward Factor	38-50	Name Of Binary Value 21 For BACnet
16-03	Status Word	22-**	Appl. Functions	38-51	Name Of Binary Value 22 For BACnet
16-05	Main Actual Value [%]	22-4*	Sleep Mode	38-52	Name Of Binary Value 33 For BACnet
16-09	Custom Readout	22-40	Minimum Run Time	38-53	Bus Feedback 1 Conversion
16-1*	Motor Status	22-41	Minimum Sleep Time	38-54	Run Stop Bus Control
16-10	Power [kW]	22-43	Wake-Up Speed [Hz]	38-58	Inverter ETR counter
16-11	Power [hp]	22-44	Wake-Up Ref./FB Diff	38-59	Rectifier ETR counter
16-12	Motor Voltage	22-45	Setpoint Boost	38-60	DB_ErrorWarnings
16-13	Frequency	22-46	Maximum Boost Time	38-61	Extended Alarm Word
16-14	Motor current	22-47	Sleep Speed [Hz]	38-69	AMA_DebugS32
16-15	Frequency [%]	22-6*	Broken Belt Detection	38-74	AOCDebug0
16-18	Motor Thermal	22-60	Broken Belt Function	38-75	AOCDebug1
16-3*	Drive Status	22-61	Broken Belt Torque	38-76	AO42_FixedMode
16-30	DC Link Voltage	22-62	Broken Belt Delay	38-77	AO42_FixedValue
16-34	Heatsink Temp.	24-**	Appl. Functions 2	38-78	DL_TestCounters
16-35	Inverter Thermal	24-0*	Fire Mode	38-79	Protect Func. Counter
16-36	Inv. Nom. Current	24-00	FM Function	38-80	Highest Lowest Couple
16-37	Inv. Max. Current	24-05	FM Preset Reference	38-81	DB_SendDebugCmd
16-38	SL Controller State	24-09	FM Alarm Handling	38-82	MaxTaskRunningTime
16-5*	Ref. & Feeds	24-1*	Drive Bypass	38-83	DebugInformation
16-50	External Reference	24-10	Drive Bypass Function	38-85	DB_OptionSelector
16-52	Feedback[Unit]	24-11	Drive Bypass Delay Time	38-86	EEPROM_Address
16-6*	Inputs & Outputs	38-**	Debug only - see PNU 1429 (service code) also	38-87	EEPROM_Value
16-60	Digital Input	38-0*	All debug parameters	38-88	Logger Time Remain
16-61	Terminal 53 Setting	38-00	TestMonitorMode	38-90	LCP FC-Protocol select
16-62	Analogue Input AI53	38-01	Version And Stack	38-91	Motor Power Internal
16-63	Terminal 54 Setting	38-02	Protocol SW version	38-92	Motor Voltage Internal
16-64	Analog Input AI54	38-06	LCPEdit Set-up	38-93	Motor Frequency Internal
16-65	Analog Output AO42 [mA]	38-07	EEPROMdataVers	38-94	Lsigma
16-66	Digital Output	38-08	PowerDataVariantID	38-95	DB_SimulateAlarmWarningExStatus
16-67	Pulse Input #29 [Hz]	38-09	AMA Retry	38-96	Data Logger Password
16-71	Relay Output [bin]	38-10	DAC selection	38-97	Data Logging Period
16-72	Counter A	38-12	DAC scale	38-98	Signal to Debug
16-73	Counter B			38-99	Signed Debug Info

40- Debug only - Backup**
40-0* Debug parameters backup
 40-00 TestMonitorMode_Backup

1.6 Warnings and Alarms

Fault number	Alarm/Warning Bit Number	Fault text	Warning	Alarm	Trip locked	Cause of problem
2	16	Live zero error	X	X		Signal on terminal 53 or 54 is less than 50% of value set in 6-10 Terminal 53 Low Voltage, 6-12 Terminal 53 Low Current, 6-20 Terminal 54 Low Voltage or 6-22 Terminal 54 Low Current. See also parameter group 6-0*
4	14	Mains ph. loss	X	X	X	Missing phase on supply side or too high voltage imbalance. Check supply voltage. See <i>14-12 Function at Mains Imbalance</i>
7	11	DC over volt	X	X		Intermediate circuit voltage exceeds limit.
8	10	DC under volt	X	X		Intermediate circuit voltage drops below "voltage warning low" limit.
9	9	Inverter overload	X	X		More than 100% load for too long.
10	8	Motor ETR over	X	X		Motor is too hot due to more than 100% load for too long. See <i>1-90 Motor Thermal Protection</i>
11	7	Motor th over	X	X		Thermistor or thermistor connection is disconnected. See <i>1-90 Motor Thermal Protection</i> .
13	5	Over Current	X	X	X	Inverter peak current limit is exceeded.
14	2	Earth Fault		X	X	Discharge from output phases to ground.
16	12	Short Circuit		X	X	Short-circuit in motor or on motor terminals.
17	4	Ctrl. word TO	X	X		No communication to frequency converter. See parameter group 8-0*
24	50	Fan Fault	X	X		The fan is not working (Only on 400 V 30-90 kW units).
30	19	U phase loss		X	X	Motor phase U is missing. Check the phase. See <i>4-58 Missing Motor Phase Function</i> .
31	20	V phase loss		X	X	Motor phase V is missing. Check the phase. See <i>4-58 Missing Motor Phase Function</i> .
32	21	W phase loss		X	X	Motor phase W is missing. Check the phase. See <i>4-58 Missing Motor Phase Function</i> .
38	17	Internal fault		X	X	Contact the local Danfoss supplier.
44	28	Earth Fault		X	X	Discharge from output phases to ground.
47	23	Control Voltage Fault	X	X	X	24 V DC may be overloaded.
48	25	VDD1 Supply Low		X	X	Control voltage low. Contact the local Danfoss supplier
50		Calibration failed		X		Contact the local Danfoss supplier.
51	15	Unom,Inom		X		The setting of motor voltage, motor current and motor power is presumably wrong. Check the settings.
52		low Inom		X		The motor current is too low. Check the settings.
53		big motor		X		The motor is too big for the to be carried out
54		small mot		X		The motor is too small for the to be carried out
55		par. range		X		The parameter values found from the motor are outside acceptable range
56		user interrupt		X		The has been interrupted by the user

Fault number	Alarm/Warning Bit Number	Fault text	Warning	Alarm	Trip locked	Cause of problem
57		timeout		X		Try to start the again a number of times, until the is carried out. NOTE Repeated runs may heat the motor to a level where the resistance Rs and Rr are increased. In most cases, however, this is not critical
58		internal	X	X		Contact the local Danfoss supplier.
59	25	Current limit	X			The current is higher than the value in 4-18 <i>Current Limit</i>
60	44	External Interlock		X		External interlock has been activated. To resume normal operation, apply 24 V DC to the terminal programmed for external interlock and reset the frequency converter (via serial communication, digital I/O, or by pressing reset button on keypad).
66	26	Heat sink Temperature Low	X			This warning is based on the temperature sensor in the IGBT module (Only on 400 V 30-90 kW units).
69	1	Pwr. Card Temp	X	X	X	The temperature sensor on the power card is either too hot or too cold.
79		Illegal power section configuration	X	X		Internal fault. Contact the local Danfoss supplier.
80	29	Drive initialised		X		All parameter settings are initialized to default settings.
87	47	Auto DC Braking	X			The drive is auto DC braking
95	40	Broken Belt	X	X		Torque is below the torque level set for no load, indicating a broken belt. See parameter group 22-6*.
126		Motor Rotating		X		High back-emf voltage. Stop the motor of the PM motor.
200		Fire Mode	X			Fire mode has been activated
202		Fire Mode Limits Exceeded	X			Fire Mode has suppressed one or more warranty voiding alarms
250		New sparepart		X	X	The power or switch mode power supply has been exchanged. (Only on 400 V 30-90 kW units). Contact the local Danfoss supplier
251		New Typecode		X	X	The frequency converter has a new type code (Only on 400 V 30-90 kW units). Contact the local Danfoss supplier.

Table 1.29

1.7 General Specifications

1.7.1 Mains Supply 3x200-240 V AC



Frequency converter	PK2 5	PK3 7	PK7 5	P1K 5	P2K2	P3K7	P5K5	P7K5	P11K	P15K	P18K	P22K	P30K	P37K	P45K	
Typical shaft output [kW]	0.25	0.37	0.75	1.5	2.2	3.7	5.5	7.5	11.0	15.0	18.5	22.0	30.0	37.0	45.0	
Typical shaft output [hp]	0.33	0.5	1.0	2.0	3.0	5.0	7.5	10.0	15.0	20.0	25.0	30.0	40.0	50.0	60.0	
IP20 frame	H1	H1	H1	H1	H2	H3	H4	H4	H5	H6	H6	H7	H7	H8	H8	
Max. cable size in terminals (mains, motor) [mm ² /AWG]	4/10	4/10	4/10	4/10	4/10	4/10	16/6	16/6	16/6	35/2	35/2	50/1	50/1	95/0	120/(4/0)	
Output current																
40 °C ambient temperature																
 130BB632.10	Continuous (3x200-240 V) [A]	1.5	2.2	4.2	6.8	9.6	15.2	22.0	28.0	42.0	59.4	74.8	88.0	115.0	143.0	170.0
	Intermittent (3x200-240 V) [A]	1.7	2.4	4.6	7.5	10.6	16.7	24.2	30.8	46.2	65.3	82.3	96.8	126.5	157.3	187.0
Max. input current																
 130BB633.10	Continuous (3x200-240 V) [A]	1.1	1.6	2.8	5.6	8.6/7.2	14.1/12.0	21.0/18.0	28.3/24.0	41.0/38.2	52.7	65.0	76.0	103.7	127.9	153.0
	Intermittent (3x200-240 V) [A]	1.2	1.8	3.1	6.2	9.5/7.9	15.5/13.2	23.1/19.8	31.1/26.4	45.1/42.0	58.0	71.5	83.7	114.1	140.7	168.3
Max. mains fuses See 1.3.6 Fuses																
Estimated power loss [W], Best case/typical ¹⁾		12/14	15/18	21/26	48/60	80/102	97/120	182/204	229/268	369/386	512	697	879	1149	1390	1500
Weight enclosure IP20 [kg]		2.	2.0	2.0	2.1	3.4	4.5	7.9	7.9	9.5	24.5	24.5	36.0	36.0	51.0	51.0
Efficiency [%], Best case/Typical ¹⁾		97.0 / 96.5	97.3 / 96.8	98.0 / 97.6	97.6 / 97.0	97.1/96.3	97.9/97.4	97.3/97.0	98.5/97.1	97.2/97.1	97.0	97.1	96.8	97.1	97.1	97.3
Output current																
50 °C ambient temperature																
Continuous (3x200-240 V) [A]		1.5	1.9	3.5	6.8	9.6	13.0	19.8	23.0	33.0	53.5	66.6	79.2	103.5	128.7	153.0
Intermittent (3x200-240 V) [A]		1.7	2.1	3.9	7.5	10.6	14.3	21.8	25.3	36.3	58.9	73.3	87.1	113.9	141.6	168.3

Table 1.30

1) At rated load conditions

1.7.2 Mains Supply 3x380-480 V AC



Frequency converter	PK37	PK75	P1K5	P2K2	P3K0	P4K0	P5K5	P7K5	P11K	P15K	P18K	P22K	P30K	P37K	P45K	P55K	P75K	P90K	
Typical shaft output [kW]	0.37	0.75	1.5	2.2	3.0	4.0	5.5	7.5	11.0	15.0	18.5	22.0	30.0	37.0	45.0	55.0	75.0	90.0	
Typical shaft output [hp]	0.5	1.0	2.0	3.0	4.0	5.0	7.5	10.0	15.0	20.0	25.0	30.0	40.0	50.0	60.0	70.0	100.0	125.0	
IP20 frame	H1	H1	H1	H2	H2	H2	H3	H3	H4	H4	H5	H5	H6	H6	H6	H7	H7	H8	
Max. cable size in terminals (mains, motor) [mm ² /AWG]	4/10	4/10	4/10	4/10	4/10	4/10	4/10	4/10	16/6	16/6	16/6	16/6	35/2	35/2	35/2	50/1	95/0	120/250MCM	
Output current																			
40 °C ambient temperature																			
	Continuous (3x380-440 V) [A]	1.2	2.2	3.7	5.3	7.2	9.0	12.0	15.5	23.0	31.0	37.0	42.5	61.0	73.0	90.0	106.0	147.0	177.0
	Intermittent (3x380-440 V) [A]	1.3	2.4	4.1	5.8	7.9	9.9	13.2	17.1	25.3	34.0	40.7	46.8	67.1	80.3	99.0	116.0	161.0	194.0
	Continuous (3x440-480 V) [A]	1.1	2.1	3.4	4.8	6.3	8.2	11.0	14.0	21.0	27.0	34.0	40.0	52.0	65.0	80.0	105.0	130.0	160.0
	Intermittent (3x440-480 V) [A]	1.2	2.3	3.7	5.3	6.9	9.0	12.1	15.4	23.1	29.7	37.4	44.0	57.2	71.5	88.0	115.0	143.0	176.0
Max. input current																			
	Continuous (3x380-440 V) [A]	1.2	2.1	3.5	4.7	6.3	8.3	11.2	15.1	22.1	29.9	35.2	41.5	57.0	70.0	84.0	103.0	140.0	166.0
	Intermittent (3x380-440 V) [A]	1.3	2.3	3.9	5.2	6.9	9.1	12.3	16.6	24.3	32.9	38.7	45.7	62.7	77.0	92.4	113.0	154.0	182.0
	Continuous (3x440-480 V) [A]	1.0	1.8	2.9	3.9	5.3	6.8	9.4	12.6	18.4	24.7	29.3	34.6	49.2	60.6	72.5	88.6	120.9	142.7
	Intermittent (3x440-480 V) [A]	1.1	2.0	3.2	4.3	5.8	7.5	10.3	13.9	20.2	27.2	32.2	38.1	54.1	66.7	79.8	97.5	132.9	157.0
See 1.3.6 Fuses																			

Table 1.31

Frequency converter	PK37	PK75	P1K5	P2K2	P3K0	P4K0	P5K5	P7K5	P11K	P15K	P18K	P22K	P30K	P37K	P45K	P55K	P75K	P90K
Estimated power loss [W], Best case/typical ¹⁾	13/15	16/21	46/57	46/58	66/83	95/118	104/131	159/198	248/274	353/379	412/456	475/523	733	922	1067	1133	1733	2141
Weight enclosure IP20 [kg]	2.0	2.0	2.1	3.3	3.3	3.4	4.3	4.5	7.9	7.9	9.5	9.5	24.5	24.5	24.5	36.0	36.0	51.0
Efficiency [%], Best case/Typical 1	97.8/97.3	98.0/97.6	97.7/97.2	98.3/97.9	98.2/97.8	98.0/97.6	98.4/98.0	98.2/97.8	98.1/97.9	98.0/97.8	98.1/97.9	98.1/97.9	97.8	97.7	98	98.2	97.8	97.9
Output current																		
50 °C ambient temperature																		
Continuous (3x380-440 V) [A]	1.04	1.93	3.7	4.85	6.3	8.4	10.9	14.0	20.9	28.0	34.1	38.0	48.8	58.4	72.0	74.2	102.9	123.9
Intermittent (3x380-440 V) [A]	1.1	2.1	4.07	5.4	6.9	9.2	12.0	15.4	23.0	30.8	37.5	41.8	53.7	64.2	79.2	81.6	113.2	136.3
Continuous (3x440-480 V) [A]	1.0	1.8	3.4	4.4	5.5	7.5	10.0	12.6	19.1	24.0	31.3	35.0	41.6	52.0	64.0	73.5	91.0	112.0
Intermittent (3x440-480 V) [A]	1.1	2.0	3.7	4.8	6.1	8.3	11.0	13.9	21.0	26.4	34.4	38.5	45.8	57.2	70.4	80.9	100.1	123.2

Table 1.32

1.7.3 Mains Supply 3x380-480 V AC

Frequency converter	PK75	P1K5	P2K2	P3K0	P4K0	P5K5	P7K5	P11K	P15K	P18K	P18K	P11K	P15K	P18K	P22K	P30K	P37K	P45K	P55K	P75K	P90K
Typical shaft output [kW]	0.75	1.5	2.2	3.0	4.0	5.5	7.5	11	15	18.5	18.5	11	15	18.5	22.0	30.0	37.0	45.0	55.0	75.0	90.0
Typical shaft output [hp]	1.0	2.0	3.0	4.0	5.0	7.5	10.0	15	20	25	25	15.0	20	25	30.0	40.0	50.0	60.0	70.0	100.0	125.0
IP54 frame	I2	I2	I2	I2	I2	I3	I3	I4	I4	I4	I4	I4	I4	I4	I6	I6	I6	I7	I7	I8	I8
Max. cable size in terminals (mains, motor) [mm ² /AWG]	4/10	4/10	4/10	4/10	4/10	4/10	4/10	16/6	16/6	16/6	16/6	16/6	16/6	16/6	35/2	35/2	35/2	50/1	50/1	95/ (3/0)	120/ (4/0)
Output current	40 °C ambient temperature																				
Continuous (3x380-440 V) [A]	2.2	3.7	5.3	7.2	9.0	12.0	15.5	23.0	31.0	37.0	37.0	24	32	37.5	44.0	61.0	73.0	90.0	106.0	147.0	177.0
	2.4	4.1	5.8	7.9	9.9	13.2	17.1	25.3	34.0	40.7	40.7	26.2	35.2	41.3	48.4	67.1	80.3	99.0	116.6	161.7	194.7
	2.1	3.4	4.8	6.3	8.2	11.0	14.0	21.0	27.0	34.0	34.0	21	27	34	40.0	52.0	65.0	80.0	105.0	130.0	160.0
	2.3	3.7	5.3	6.9	9.0	12.1	15.4	23.1	29.7	37.4	37.4	23.1	29.7	37.4	44.0	57.2	71.5	88.0	115.5	143.0	176.0
Max. input current	2.1	3.5	4.7	6.3	8.3	11.2	15.1	22.1	29.9	35.2	35.2	22	29	34	41.8	57.0	70.3	84.2	102.9	140.3	165.6
	2.3	3.9	5.2	6.9	9.1	12.3	16.6	24.3	32.9	38.7	38.7	24.2	31.9	37.3	46.0	62.7	77.4	92.6	113.1	154.3	182.2
	1.8	2.9	3.9	5.3	6.8	9.4	12.6	18.4	24.7	29.3	29.3	19	25	31	36.0	49.2	60.6	72.5	88.6	120.9	142.7
	2.0	3.2	4.3	5.8	7.5	10.3	13.9	20.2	27.2	32.2	32.2	20.9	27.5	34.1	39.6	54.1	66.7	79.8	97.5	132.9	157.0
Max. mains fuses	See 1.3.6 Fuses																				

Table 1.33

Frequency converter	PK75	P1K5	PK2K2	PK3K	PK4K	PK5K	PK7K	P11K	P15K	P18K	PK11	PK15	P18K	P22K	P30K	P37K	P45K	P55K	P75K	P90K
Estimated power loss [W], Best case/typical ¹⁾	21/ 16	46/ 57	46/ 58	66/ 83	95/ 118	104/ 131	159/ 198	248/ 274	353/ 379	412/ 456	242	330	396	496	734	995	840	1099	1520	1781
Weight enclosure IP54 [kg]	5.3	5.3	5.3	5.3	5.3	7.2	7.2	13.8	13.8	13.8	23	23	23	27	27	27	45	45	65	65
Efficiency [%], Best case/Typical 1	98.0/ 97.6	97.7/ 97.2	98.3/ 97.9	98.2/ 97.8	98.0/ 97.6	98.4/ 98.0	98.2/ 97.8	98.1/ 97.9	98.0/ 97.8	98.1/ 97.9	98.0	98.0	98.0	98.0	97.8	97.6	98.3	98.2	98.1	98.3
Output current																				
50 °C ambient temperature																				
Continuous (3x380-440 V) [A]	1.93	3.7	4.85	6.3	7.5	10.9	14.0	20.9	28.0	33.0	19.2	25.6	30	35.2	48.8	58.4	63.0	74.2	102.9	123.9
Intermittent (3x380-440 V) [A]	2.1	4.07	5.4	6.9	9.2	12.0	15.4	23.0	30.8	36.3	21.2	28.2	33	38.7	53.9	64.2	69.3	81.6	113.2	136.3
Continuous (3x440-480 V) [A]	1.8	3.4	4.4	5.5	6.8	10.0	12.6	19.1	24.0	30.0	16.8	21.6	27.2	32.0	41.6	52.0	56.0	73.5	91.0	112.0
Intermittent (3x440-480 V) [A]	2.0	3.7	4.8	6.1	8.3	11.0	13.9	21.0	26.4	33.0	18.5	23.8	30	35.2	45.8	57.2	61.6	80.9	100.1	123.2

Table 1.34

1.7.4 Mains Supply 3x525-600 V AC



Frequency converter	P2K2	P3K0	P3K7	P5K5	P7K5	P11K	P15K	P18K	P22K	P30K	P37K	P45K	P55K	P75K	P90K	
Typical shaft output [kW]	2.2	3.0	3.7	5.5	7.5	11.0	15.0	18.5	22.0	30.0	37	45.0	55.0	75.0	90.0	
Typical shaft output [hp]	3.0	4.0	5.0	7.5	10.0	15.0	20.0	25.0	30.0	40.0	50.0	60.0	70.0	100.0	125.0	
IP20 frame	H9	H9	H9	H9	H9	H10	H10	H6	H6	H6	H7	H7	H7	H8	H8	
Max. cable size in terminals (mains, motor) [mm ² /AWG]	4/10	4/10	4/10	4/10	4/10	10/8	10/8	35/2	35/2	35/2	50/1	50/1	50/1	95/0	120/(4/0)	
Output current																
 130BB632.10	40 °C ambient temperature															
	Continuous (3x525-550 V) [A]	4.1	5.2	6.4	9.5	11.5	19.0	23.0	28.0	36.0	43.0	54.0	65.0	87.0	105.0	137.0
	Intermittent (3x525-550 V) [A]	4.5	5.7	7.0	10.5	12.7	20.9	25.3	30.8	39.6	47.3	59.4	71.5	95.7	115.5	150.7
	Continuous (3x551-600 V) [A]	3.9	4.9	6.1	9.0	11.0	18.0	22.0	27.0	34.0	41.0	52.0	62.0	83.0	100.0	131.0
	Intermittent (3x551-600 V) [A]	4.3	5.4	6.7	9.9	12.1	19.8	24.2	29.7	37.4	45.1	57.2	68.2	91.3	110.0	144.1
Max. input current																
 130BB633.10	Continuous (3x525-550 V) [A]	3.7	5.1	5.0	8.7	11.9	16.5	22.5	27.0	33.1	45.1	54.7	66.5	81.3	109.0	130.9
	Intermittent (3x525-550 V) [A]	4.1	5.6	6.5	9.6	13.1	18.2	24.8	29.7	36.4	49.6	60.1	73.1	89.4	119.9	143.9
	Continuous (3x551-600 V) [A]	3.5	4.8	5.6	8.3	11.4	15.7	21.4	25.7	31.5	42.9	52.0	63.3	77.4	103.8	124.5
	Intermittent (3x551-600 V) [A]	3.9	5.3	6.2	9.2	12.5	17.3	23.6	28.3	34.6	47.2	57.2	69.6	85.1	114.2	137.0
Max. mains fuses	See 1.3.6 Fuses															
Estimated power loss [W], Best case/typical ¹⁾	65	90	110	132	180	216	294	385	458	542	597	727	1092	1380	1658	
Weight enclosure IP54 [kg]	6.6	6.6	6.6	6.6	6.6	11.5	11.5	24.5	24.5	24.5	36.0	36.0	36.0	51.0	51.0	
Efficiency [%], Best case/Typical 1	97.9	97	97.9	98.1	98.1	98.4	98.4	98.4	98.4	98.5	98.5	98.7	98.5	98.5	98.5	
Output current																
	50 °C ambient temperature															
	Continuous (3x525-550 V) [A]	2.9	3.6	4.5	6.7	8.1	13.3	16.1	19.6	25.2	30.1	37.8	45.5	60.9	73.5	95.9
	Intermittent (3x525-550 V) [A]	3.2	4.0	4.9	7.4	8.9	14.6	17.7	21.6	27.7	33.1	41.6	50.0	67.0	80.9	105.5
	Continuous (3x551-600 V) [A]	2.7	3.4	4.3	6.3	7.7	12.6	15.4	18.9	23.8	28.7	36.4	43.3	58.1	70.0	91.7
Intermittent (3x551-600 V) [A]	3.0	3.7	4.7	6.9	8.5	13.9	16.9	20.8	26.2	31.6	40.0	47.7	63.9	77.0	100.9	

Table 1.35

1.7.5 EMC Test Results

The following test results have been obtained using a system with a frequency converter, a screened control cable, a control box with potentiometer, as well as a motor screened cable.

RFI Filter Type	Conduct emission. Maximum shielded cable length [m]						Radiated emission			
	Industrial environment				Housing, trades and light industries		Industrial environment		Housing, trades and light industries	
	EN 55011 Class A2		EN 55011 Class A1		EN 55011 Class B		EN 55011 Class A1		EN 55011 Class B	
	Without external filter	With external filter	Without external filter	With external filter	Without external filter	With external filter	Without external filter	With external filter	Without external filter	With external filter
H4 RFI filter (Class A1)										
0.25-11 kW 3x200-240 V IP20			25	50		20	Yes	Yes		No
0.37-22 kW 3x380-480 V IP20			25	50		20	Yes	Yes		No
H2 RFI filter (Class A2)										
1.5-45 kW 3x200-240 V IP20	25						No		No	
30-90 kW 3x380-480 V IP20	25						No		No	
0.75-18.5 kW 3x380-480 V IP54	25						Yes			
22-90 kW 3x380-480 V IP54	25						No		No	
H3 RFI filter (Class A1/B)										
1.5-45 kW 3x200-240 V IP20			50		20		Yes		No	
30-90 kW 3x380-480 V IP20			50		20		Yes		No	
0.75-18.5 kW 3x380-480 V IP54			25		10		Yes			
22-90 kW 3x380-480 V IP54			50		10		Yes		No	

Table 1.36

Protection and features

- Electronic thermal motor protection motor protection against overload.
- Temperature monitoring of the heatsink ensures that the frequency converter trips in case of overtemperature.
- The frequency converter is protected against short-circuits between motor terminals U, V, W.
- If a motor phase is missing, the frequency converter trips and issues an alarm.
- If a mains phase is missing, the frequency converter trips or issues a warning (depending on the load).
- Monitoring of the intermediate circuit voltage ensures that the frequency converter trips if the intermediate circuit voltage is too low or too high.
- The frequency converter is protected against earth faults on motor terminals U, V, W.

Mains supply (L1, L2, L3)

Supply voltage	200-240 V ±10%
Supply voltage	380-480 V ±10%
Supply voltage	525-600 V ±10%
Supply frequency	50/60 Hz
Max. imbalance temporary between mains phases	3.0% of rated supply voltage
True Power Factor (λ)	≥ 0.9 nominal at rated load
Displacement Power Factor (cosφ) near unity	(>0.98)
Switching on the input supply L1, L2, L3 (power-ups) enclosure frame H1-H5, I2, I3, I4	Max. 2 times/min.
Switching on the input supply L1, L2, L3 (power-ups) enclosure frame H6-H8, I6-I8	Max. 1 time/min.
Environment according to EN 60664-1	overvoltage category III/pollution degree 2
The unit is suitable for use on a circuit capable of delivering not more than 100.000 RMS symmetrical Amperes, 240/480 V maximum.	

Motor output (U, V, W)

Output voltage	0-100% of supply voltage
Output frequency	0-200 Hz (VVC ^{plus}), 0-400 Hz (u/f)
Switching on output	Unlimited
Ramp times	0.05-3600 s

Cable lengths and cross sections

Max. motor cable length, screened/armoured (EMC correct installation)	See 1.7.5 EMC Test Results
Max. motor cable length, unscreened/unarmoured	50 m
Max. cross section to motor, mains*	
Cross section DC terminals for filter feedback on enclosure frame H1-H3, I2, I3, I4	4 mm ² /11 AWG
Cross section DC terminals for filter feedback on enclosure frame H4-H5	16 mm ² /6 AWG
Maximum cross section to control terminals, rigid wire	2.5 mm ² /14 AWG
Maximum cross section to control terminals, flexible cable	2.5 mm ² /14 AWG
Minimum cross section to control terminals	0.05 mm ² /30 AWG

*See 1.7.2 Mains Supply 3x380-480 V AC for more information

Digital inputs

Programmable digital inputs	4
Terminal number	18, 19, 27, 29
Logic	PNP or NPN
Voltage level	0-24 V DC
Voltage level, logic '0' PNP	<5 V DC
Voltage level, logic '1' PNP	>10 V DC
Voltage level, logic '0' NPN	>19 V DC
Voltage level, logic '1' NPN	<14 V DC
Maximum voltage on input	28 V DC
Input resistance, R _i	Approx. 4 k
Digital input 29 as thermistor input	Fault: >2.9 kΩ and no fault: <800 Ω

Analog inputs

Number of analog inputs	2
Terminal number	53, 54
Terminal 53 mode	Parameter 6-19: 1=voltage, 0=current
Terminal 54 mode	Parameter 6-29: 1=voltage, 0=current
Voltage level	0-10 V
Input resistance, R_i	approx. 10 k Ω
Max. voltage	20 V
Current level	0/4 to 20 mA (scalable)
Input resistance, R_i	<500 Ω
Max. current	29 mA

Analog output

Number of programmable analog outputs	2
Terminal number	42, 45 ¹⁾
Current range at analog output	0/4-20 mA
Max. load to common at analog output	500 Ω
Max. voltage at analog output	17 V
Accuracy on analog output	Max. error: 0.4% of full scale
Resolution on analog output	10 bit

1) Terminal 42 and 45 can also be programmed as digital outputs.

Digital output

Number of digital outputs	2
Terminal number	42, 45 ¹⁾
Voltage level at digital output	17 V
Max. output current at digital output	20 mA
Max. load at digital output	1 k Ω

1) Terminals 42 and 45 can also be programmed as analog output.

Control card, RS-485 serial communication

Terminal number	68 (P, TX+, RX+), 69 (N, TX-, RX-)
Terminal number	61 Common for terminals 68 and 69

Control card, 24 V DC output

Terminal number	12
Max. load enclosure frame H1-H8, I2-I8	80 mA

Relay output

Programmable relay output	2
Relay 01 and 02	01-03 (NC), 01-02 (NO), 04-06 (NC), 04-05 (NO)
Max. terminal load (AC-1) ¹⁾ on 01-02/04-05 (NO) (Resistive load)	250 V AC, 3 A
Max. terminal load (AC-15) ¹⁾ on 01-02/04-05 (NO) (Inductive load @ $\cos\phi$ 0.4)	250 V AC, 0.2 A
Max. terminal load (DC-1) ¹⁾ on 01-02/04-05 (NO) (Resistive load)	30 V DC, 2 A
Max. terminal load (DC-13) ¹⁾ on 01-02/04-05 (NO) (Inductive load)	24 V DC, 0.1 A
Max. terminal load (AC-1) ¹⁾ on 01-03/04-06 (NC) (Resistive load)	250 V AC, 3 A
Max. terminal load (AC-15) ¹⁾ on 01-03/04-06 (NC) (Inductive load @ $\cos\phi$ 0.4)	250 V AC, 0.2 A
Max. terminal load (DC-1) ¹⁾ on 01-03/04-06 (NC) (Resistive load)	30 V DC, 2 A
Min. terminal load on 01-03 (NC), 01-02 (NO) 24 V DC 10 mA, 24 V AC 20 mA	
Environment according to EN 60664-1	Overvoltage category III/pollution degree 2

1) IEC 60947 parts 4 and 5.

Control card, 10 V DC output

Terminal number	50
Output voltage	10.5 V \pm 0.5 V
Max. load	25 mA

All inputs, outputs, circuits, DC supplies and relay contacts are galvanically isolated from the supply voltage (PELV) and other high-voltage terminals.

Surroundings

Enclosure	IP20
Enclosure kit available	IP21, TYPE 1
Vibration test	1.0 g
Max. relative humidity	5%-95% (IEC 60721-3-3; Class 3K3 (non-condensing) during operation
Aggressive environment (IEC 60721-3-3), coated (standard) frame H1-H5	Class 3C3
Aggressive environment (IEC 60721-3-3), non-coated frame H6-H10	Class 3C2
Aggressive environment (IEC 60721-3-3), coated (optional) frame H6-H10	Class 3C3
Test method according to IEC 60068-2-43 H2S (10 days)	
Ambient temperature	See max. output current at 40/50 °C in the tables mains supply

Derating for high ambient temperature, see 1.7.6 Surroundings

Minimum ambient temperature during full-scale operation	0 °C
Minimum ambient temperature at reduced performance, enclosure frame H1-H5	-20 °C
Minimum ambient temperature at reduced performance, enclosure frame H6-H10	-10 °C
Temperature during storage/transport	-30 to +65/70 °C
Maximum altitude above sea level without derating	1000 m
Maximum altitude above sea level with derating	3000 m
Derating for high altitude, see 1.7.6 Surroundings	
Safety standards	EN/IEC 61800-5-1, UL 508C
EMC standards, Emission	EN 61800-3, EN 61000-6-3/4, EN 55011, IEC 61800-3
EMC standards, Immunity	EN 61800-3, EN 61000-3-12, EN 61000-6-1/2, EN 61000-4-2, EN 61000-4-3, EN 61000-4-4, EN 61000-4-5, EN 61000-4-6

1.8 Special Conditions

1.8.1 Derating for Ambient Temperature and Switching Frequency

The ambient temperature measured over 24 hours should be at least 5°C lower than the max. ambient temperature. If the frequency converter is operated at high ambient temperature, the continuous output current should be decreased. For derating curve, see VLT® HVAC Basic Design Guide MG18C.

1.8.2 Derating for Low Air Pressure

The cooling capability of air is decreased at low air pressure. For altitudes above 2000 m, contact Danfoss regarding PELV. Below 1000 m altitude no de-rating is necessary, but above 1000 m the ambient temperature or the maximum output current should be decreased. Decrease the output by 1% per 100 m altitude above 1000 m or reduce the max. ambient temperature by 1° per 200 m.

1.9 Options for VLT® HVAC Basic Drive FC 101

For options, see the VLT® HVAC Basic Design Guide MG18C.

1.10 MCT 10 Support

MCT 10 information is available at: www.danfoss.com/BusinessAreas/DrivesSolutions/fc101driveupdates



www.danfoss.com/drives

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.

