


\*\* - Circuit will be removed if external power supply considered  
Verbindung wird entfernt, wenn externe Spannungsversorgung angelegt wird

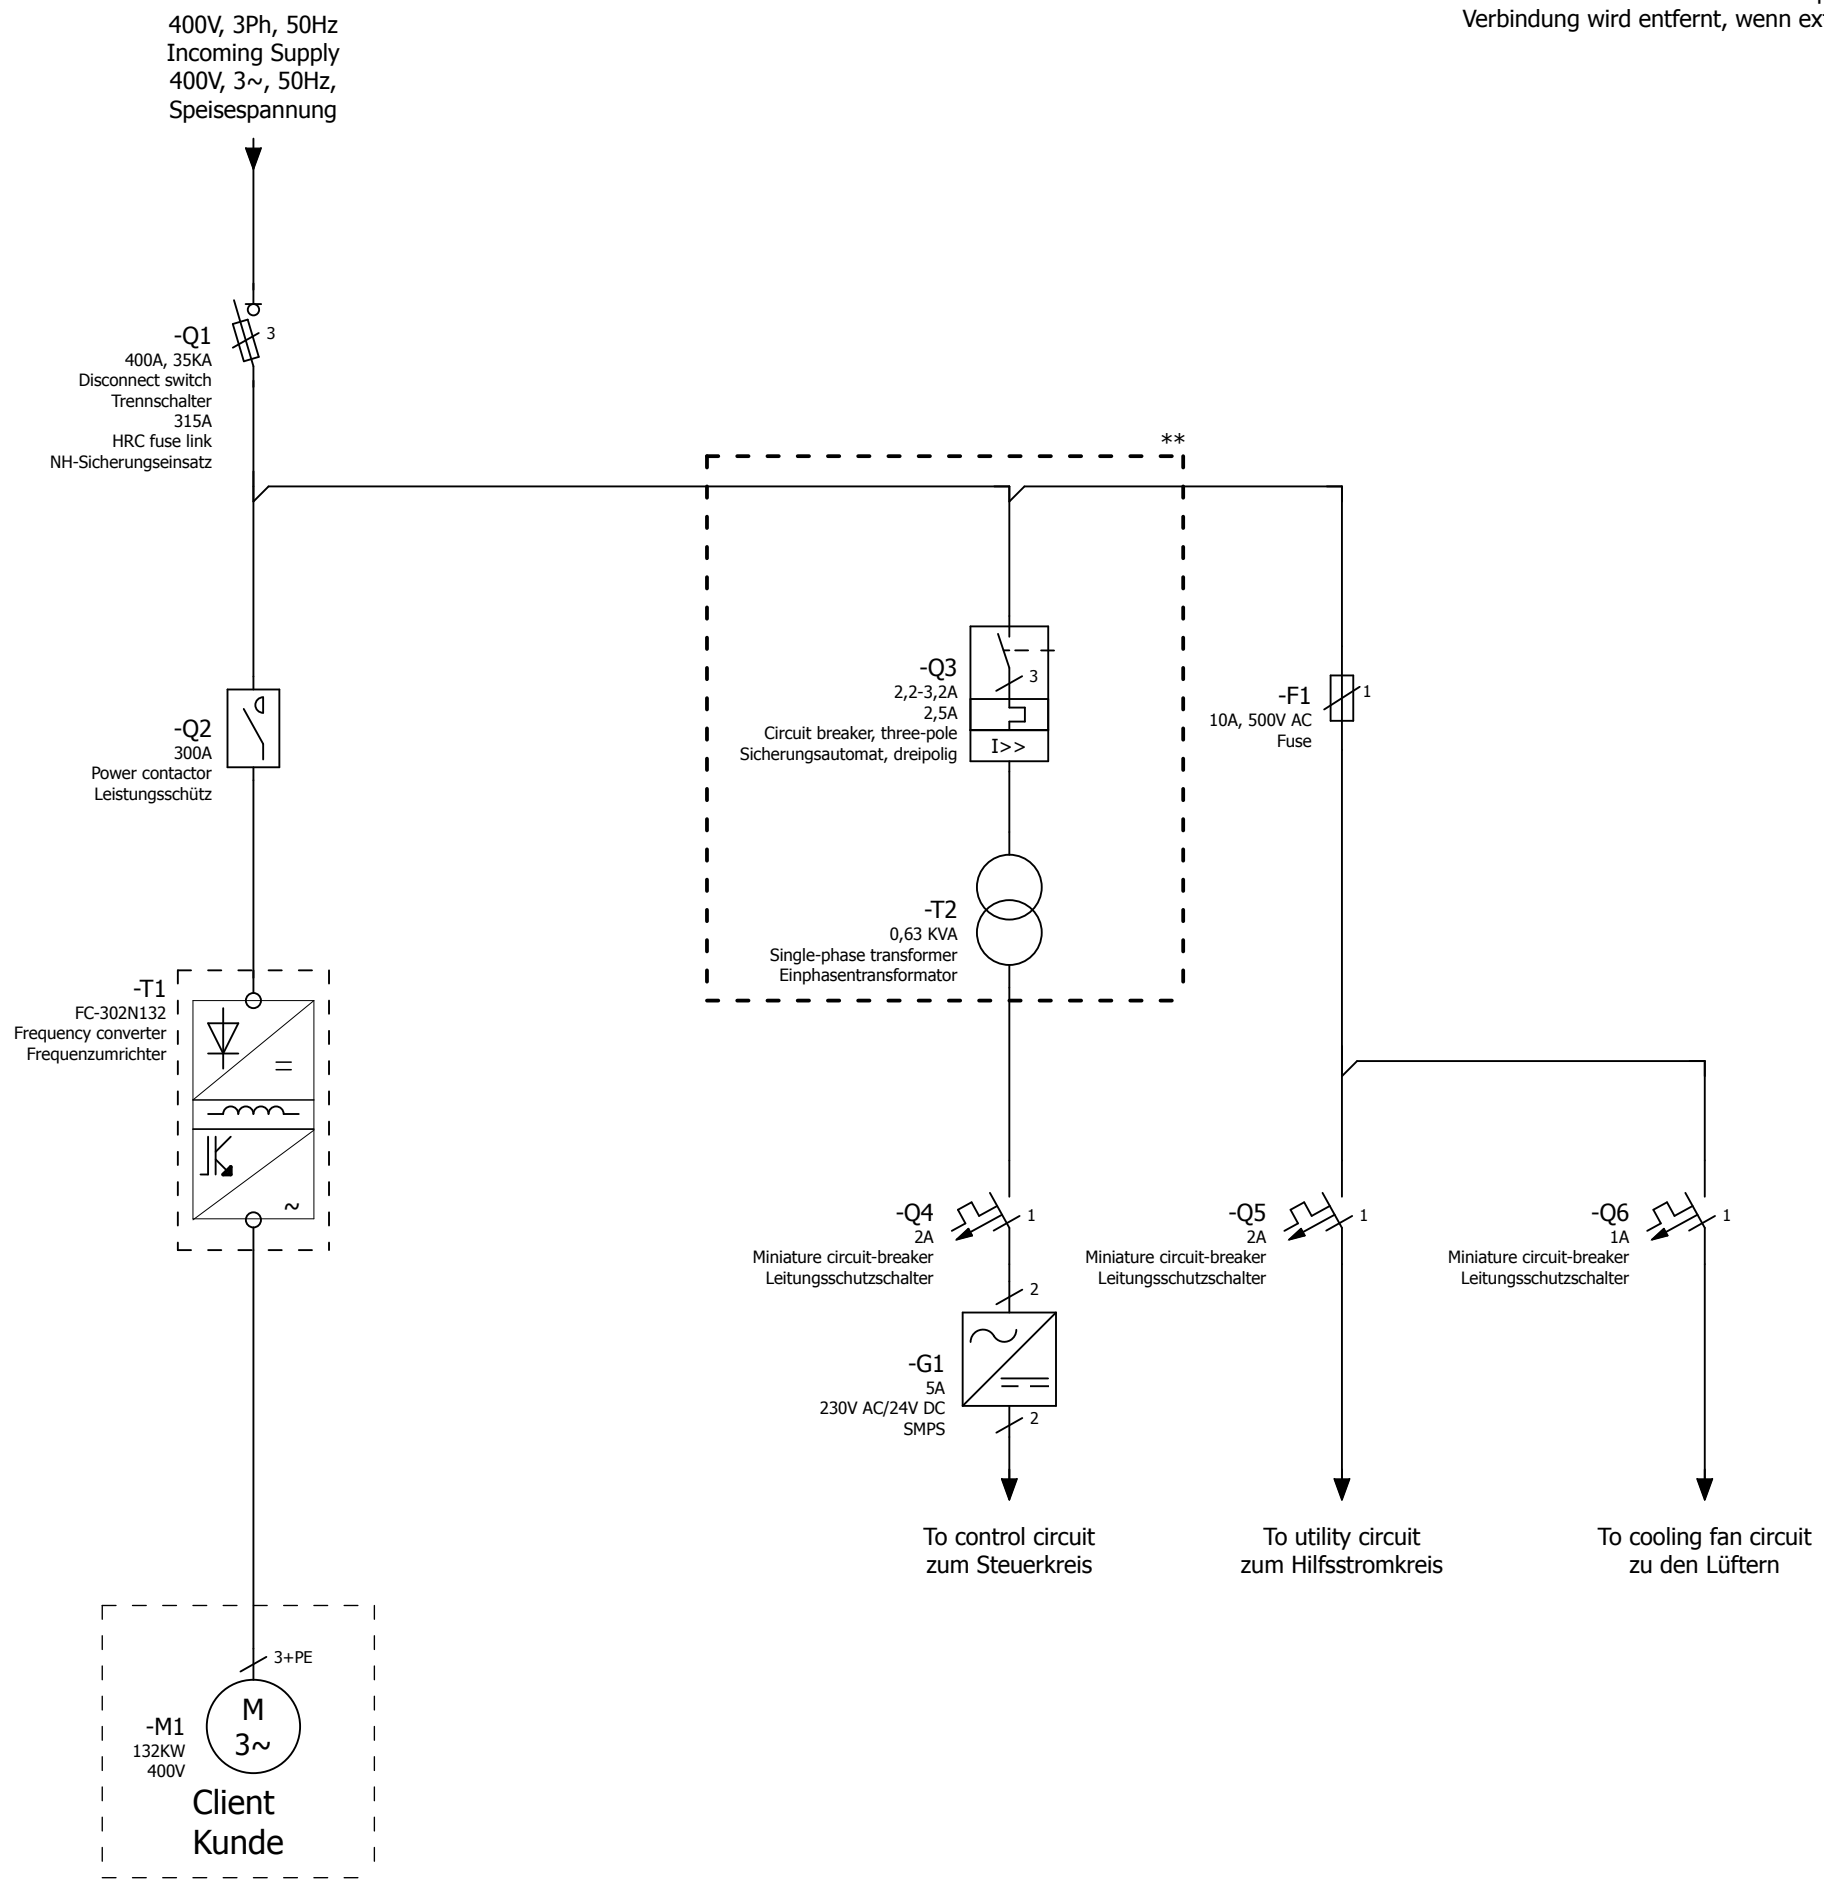

=REPORT+CONNECTION LIST/3

Date	9/30/2013	Commission	132KW VFD Panel	Danfoss GmbH		FILE-NAME: LOGOB300.jpg Size 300px x 116px	Project Number	= FC302	Page	2
Ed.	----	Project description	132KW VFD Panel	VLT Drives EMA, Carl-Legien Strasse 8			Page description	Schematic single-line Schaltplan einpolig	-----	+ N132KW 24V
Appr.	----	Contactor+Fuse+Disconnect switch	Schütz+Sicherung+Trennschalter	63073 Offenbach, Germany			SAP NO	Manufacturer no	Page	34
Modification	Date	Name	Contr.	----						