



\*\* - Circuit will be removed if external power supply considered  
Verbindung wird entfernt, wenn externe Spannungsversorgung angelegt wird

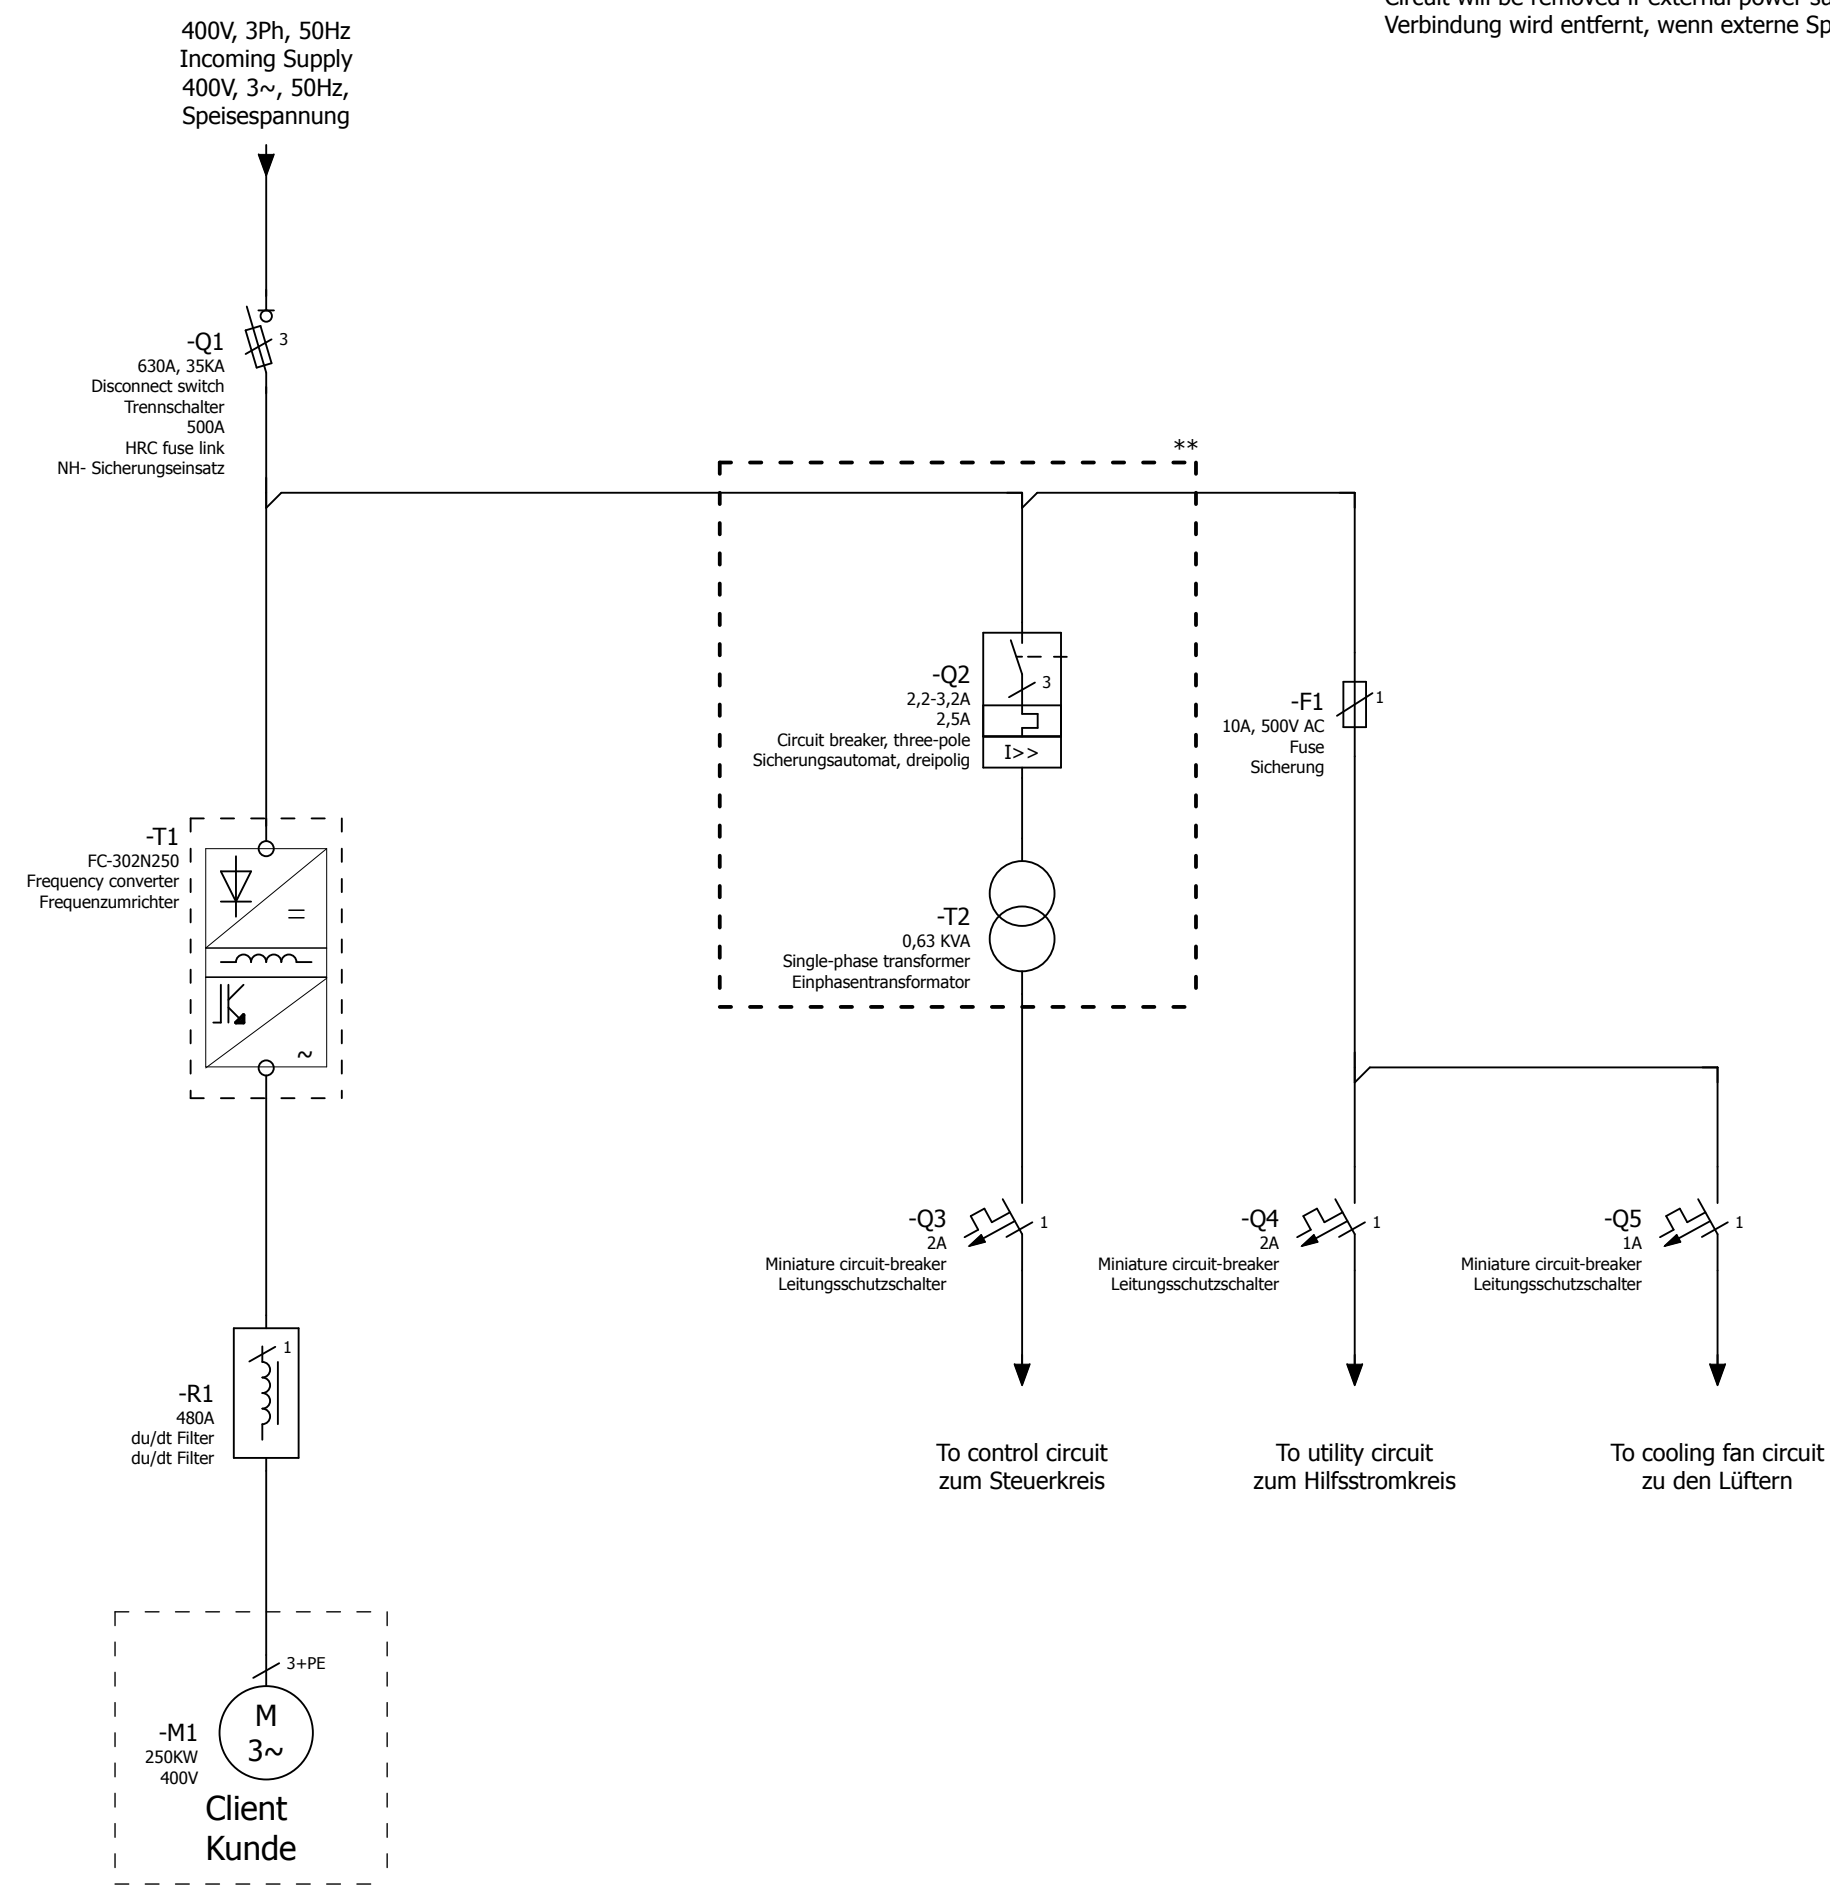

=REPORT+CONNECTION LIST/4

Date		9/30/2013	Commission		Danfoss GmbH		FILE-NAME: LOGOB300.jpg Size 300px x 116px	Project Number	= FC302	Page	2
Ed.		----	Project description		VLT Drives EMA, Carl-Legien Strasse 8			Page description	-----	+ N250KW 230V	1
Appr.		----	Disconnect switch+Fuse+du/dt Filter		63073 Offenbach, Germany	Schematic single-line	SAP NO	Manufacturer no	34		
Modification	Date	Name	Contr.	----	Trennschalter+Sicherung+du/dt Filter	Schaltplan einpolig					