

REVISION	VERSION
DRAWING	

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES. TOLERANCE:

X ± 0.1
 XX ± 0.03
 XXX ± 0.005

FINISH ✓

ANGLES ± 2.0° HOLE DIA = +

CONFORMS TO ASME Y14.5M-1994.

TRANE

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE

DRAWN BY: DK TRANE DATE: 03/28/11

DO NOT SCALE PRINT

THIRD ANGLE PROJECTION

177R0345 SHEET 1 OF 1 REV 001

DWG.SUBMITTAL,P4,NONBYPASS,TRANE

CLEARANCE REQUIREMENT FOR AIR FLOW COOLING:




THE UNIT MUST BE INSTALLED VERTICALLY WITH THE MINIMUM CLEARANCE OF 7.87" [200mm] ON THE BOTTOM AND 1.50" [38.1mm] ON EITHER SIDE FOR UNIT COOLING.

D

C

B

A

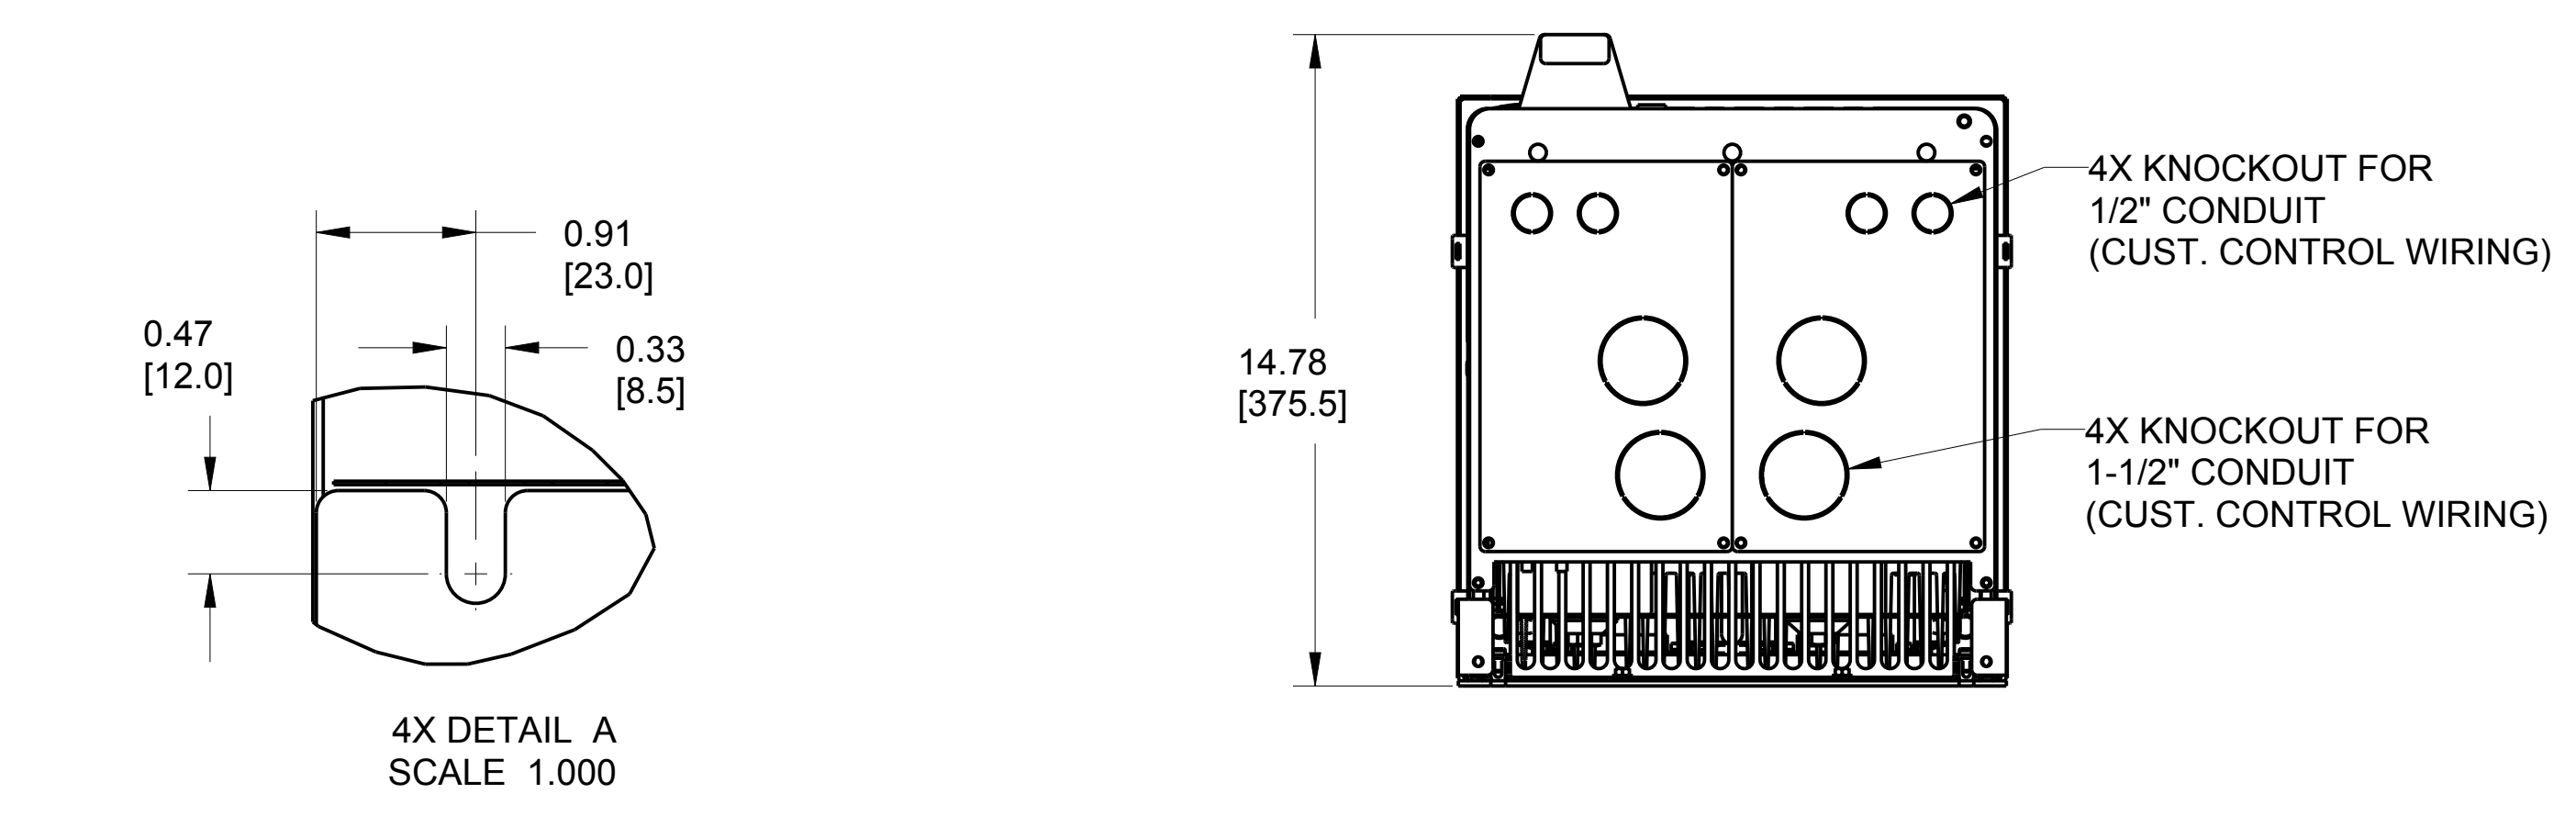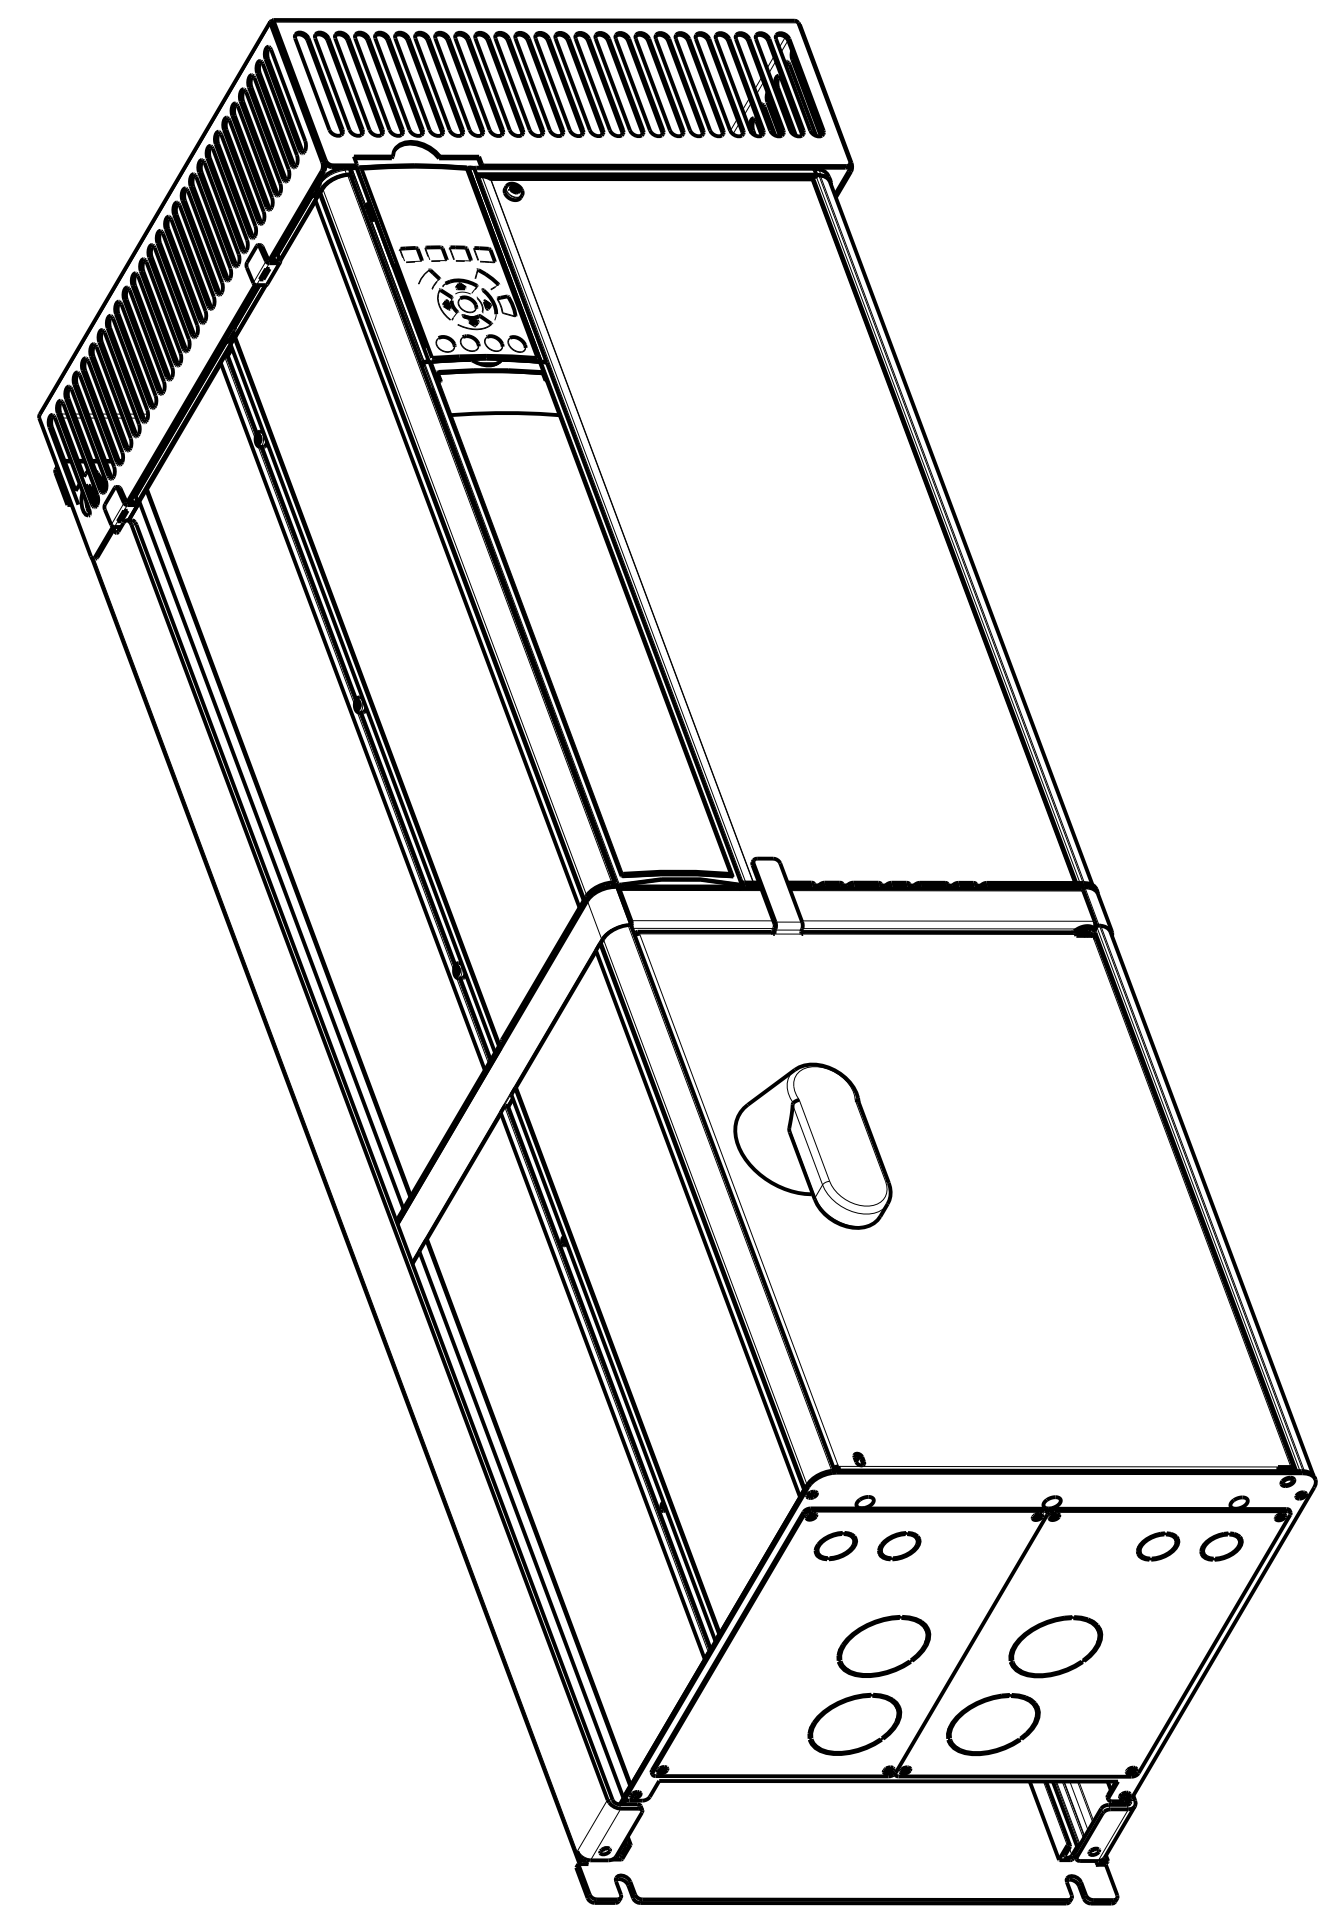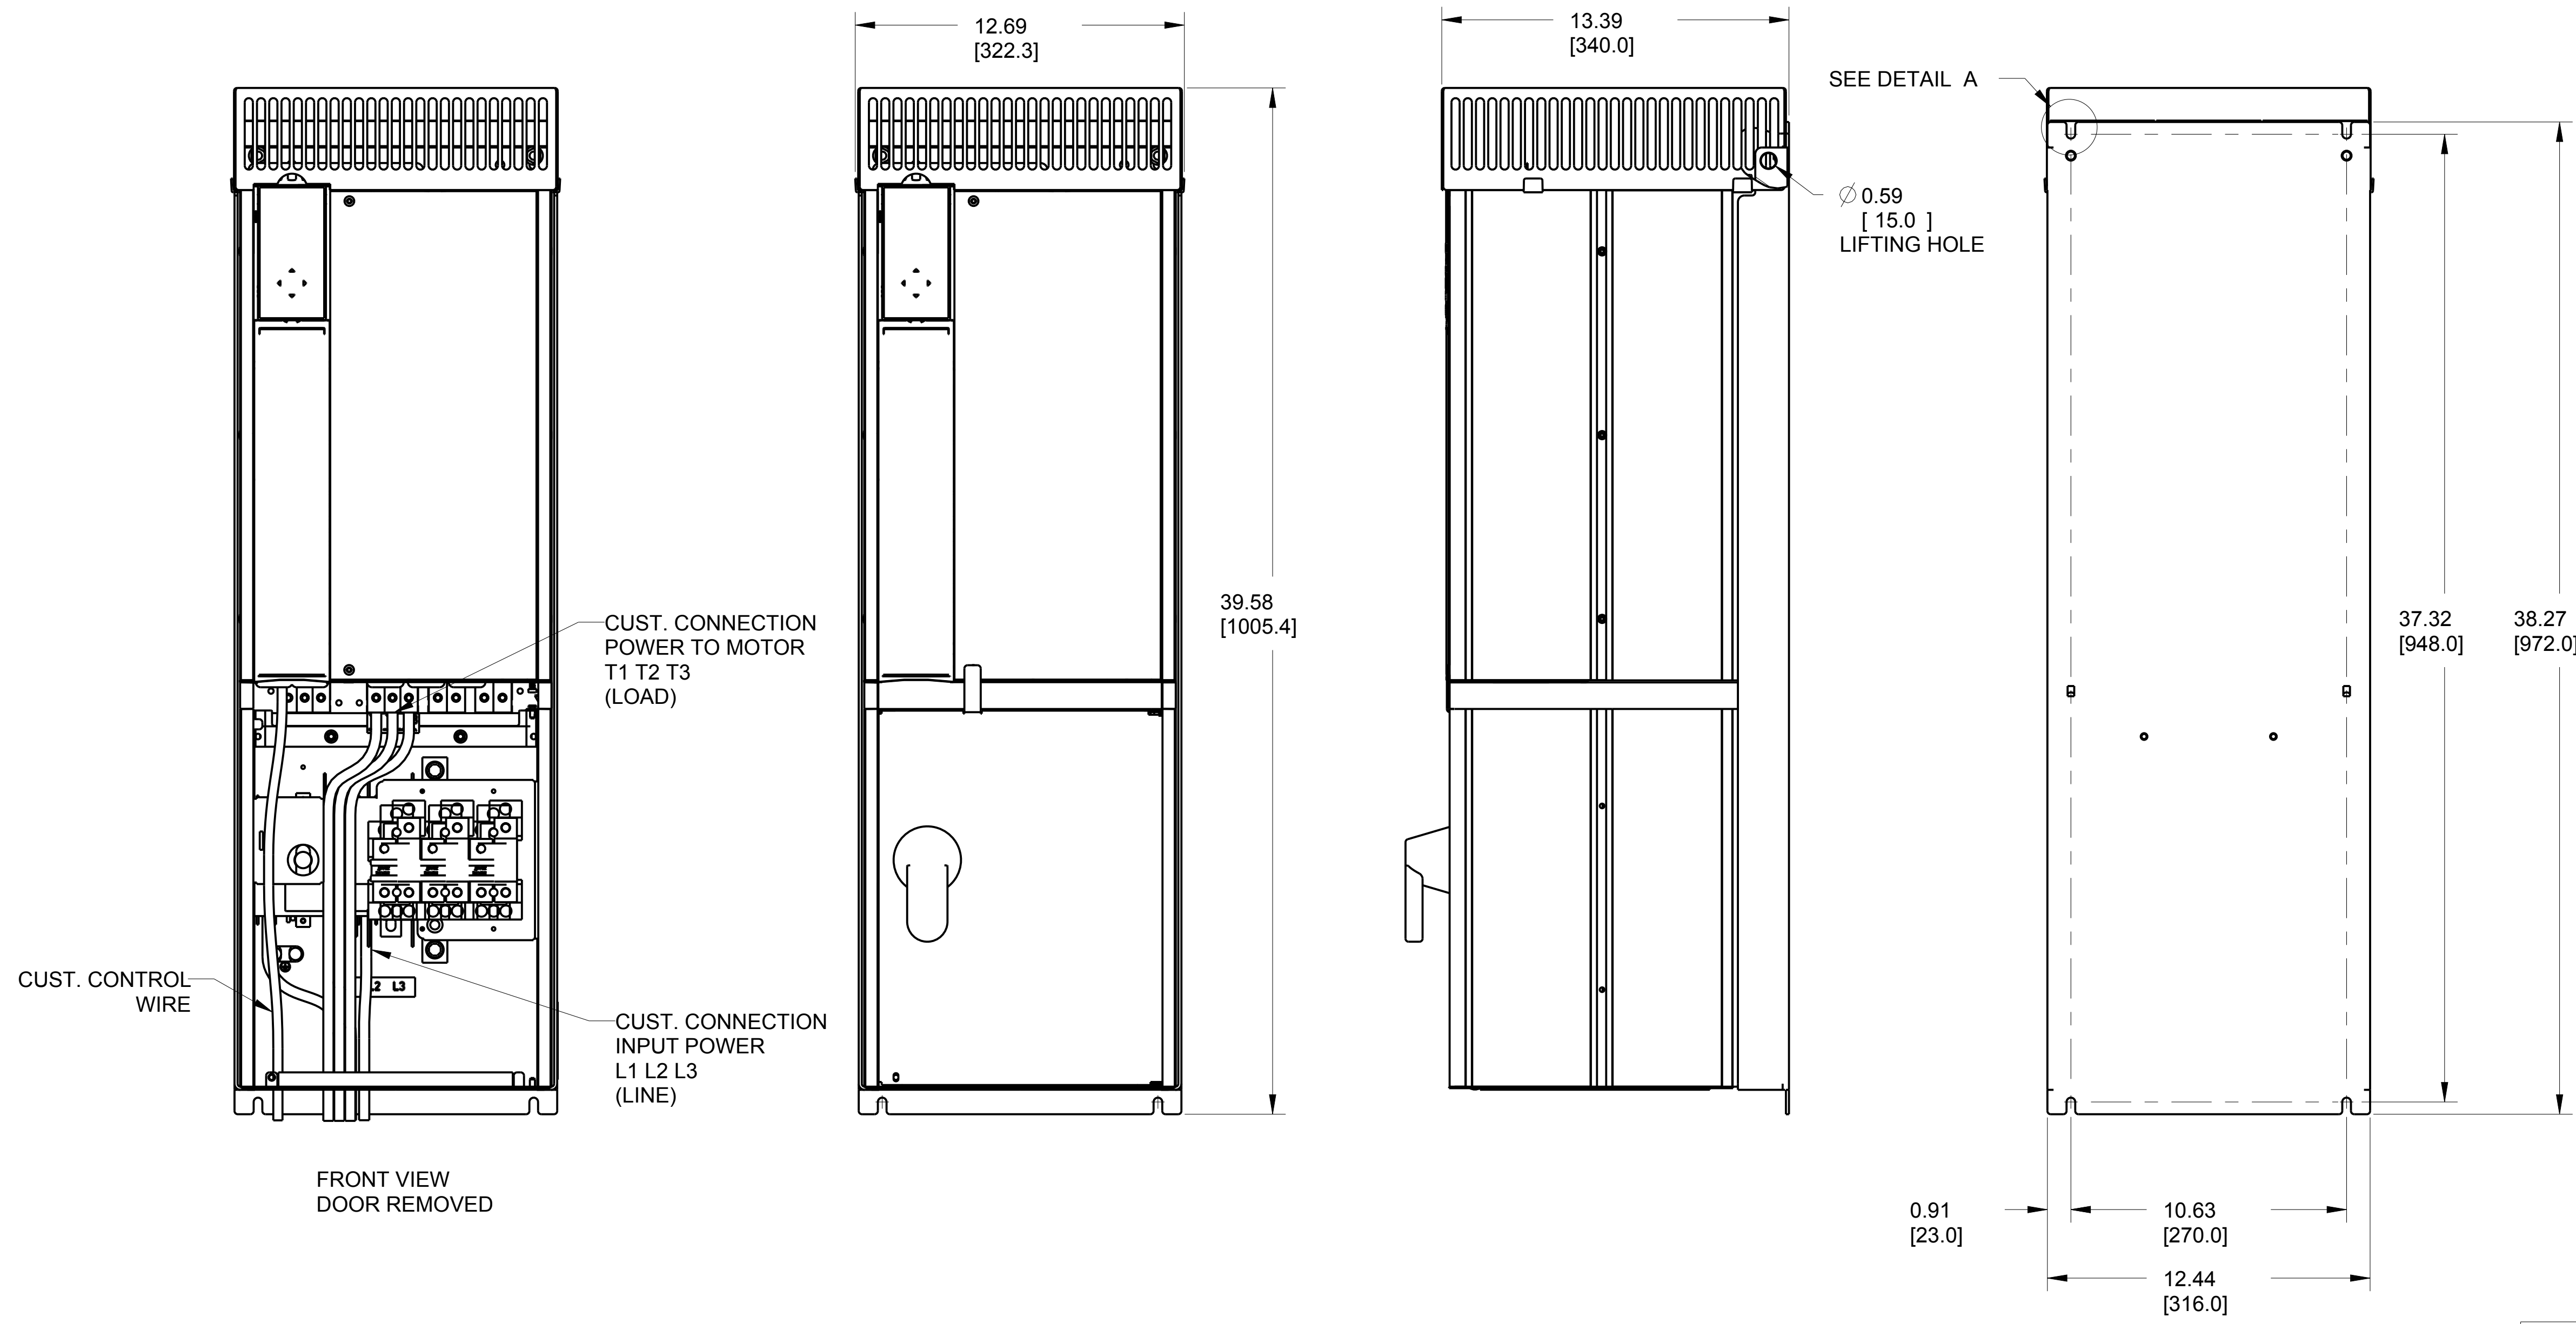

FRAME SIZE P4		
VOLTAGE	HP	KW
208	30	22
	40	30
230	30	22
	40	30
460	60	45
	75	55
575	60	45
	75	55