WIRE COLOR SCHEME TERMINAL IDENTIFICATION BLACK - LINE VOLTAGE RED - AC CONTROL - DRIVE TERMINAL WHITE - AC GROUNDED - CUSTOMER TERMINAL CIRCUIT CONDUCTOR BLUE - DC CONTROL GREEN - CHASSIS GROUND EARTH GROUND EARTH GROUND GRN / \neg * AC MOTOR OL 4T1 (L1) M2 (T1) 2T1 *CUSTOMER (U1) (U2) 4L1 F16A 5L1 L1/R/91 _L1_(L1)___(T1) BLK 2L1 VLT (L1)_{XX}_T1_ INPUT SUPPLIED T1/U/96 (V1) (V2) 4L2 |F16B| 5L2 |L2/S/92 POWER ADJUSTABLE FREQUENCY BLK 2L2 4T2 (L2) (T2) (L2) T2 _ _ _ _ BRANCH L2 (L2) (T2) T2/V/97 3 PH, 480V, (W1) (W2) 4L3 ||F16B|| 5L3 ||L2/5/92 || (W1) (W2) 4L3 ||F16C|| 5L3 ||L3/T/93 || DRIVE CIRCUIT L3 (L3) (T3) BLK 2L3 4T3 (L3) (T3) PROTECTION T3/W/98 (AFD) 60Hz (SEE NOTE 3) INPUT DRIVE INPUT FUSES MAIN DISCONNECT REACTOR (L1) (T1) (L2) (T2) EARTH GROUND GRN (L3) (T3) 163 RED X2 100 WHT F12 115VAC 250V CR6 165 (12) 5 (11) TS1 HEATER (SET: 65° F) CR6 167 (9) (5) (2) FAN 1 (SET: 80° F) (23) (24) TB2 TS1 FAN 2

TO SHEET 2

WARNING!

THE FOLLOWING TABLE LISTS THE PARAMETERS THAT ARE SET DIFFERENT FROM THE DRIVE DEFAULT SETTINGS. ADDITIONAL PARAMETER SETTINGS MAY BE REQUIRED FOR YOUR APPLICATION.

1. * INDICATES COMPONENTS NOT SUPPLIED BY MANUFACTURER.

- REFER TO THE INSTALLATION AND OPERATION MANUAL FOR DRIVE FUNCTIONS AND PARAMETER SETTINGS.
- 3. BRANCH CIRCUIT PROTECTION, INPUT POWER AND MOTOR WIRING MUST BE SELECTED IN ACCORDANCE WITH THE N.E.C., ANY APPLICATION LOCAL CODES AND THE LOAD CURRENT RATING.
- 4. REPLACE JUMPER 'J1' WITH NORMALLY CLOSED SAFETY INTERLOCK CONTACT AS NECESSARY. CONTACT MUST BE RATED 1/4 HP @ 120VAC MINIMUM.
- 5. PANEL MAY REQUIRE DERATING, CONSULT DRIVE MANUAL OR FACTORY FOR FOLLOWING CONDITIONS: 5.1. HIGHER SWITCHING FREQUENCY THAN DRIVE DEFAULT

TO SHEET 2

- HIGHER THAN PANEL LISTED AMBIENT TEMPERATURES
- 5.3. ELEVATION ABOVE 3300 FEET (1000 METERS)
- 5.4. LONG MOTOR LEAD LENGTHS

DRIVE PARAMETER SETTINGS

PARAMETER #	PARAMETER # NAME		VALUE
0-02	MOTOR SPEED UNIT	1	HZ
0-03	REGIONAL SETTINGS	1	NORTH AMERICA
1-03	TORQUE CHAR.	3	AUTO ENERGY OPTIM VT
5-02	TERMINAL 29 TYPE	1	OUTPUT
5-31	TERMINAL 29	5	RUNNING
14-20	RESET MODE	13	INFINITE AUTO REST

В			- NOTICE - THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF DANFOSS DRIVES.	DRN	NAME	NE	EMA 3R,480V,2C			- Lu
А	SP10119	11/10	IT IS LOANED BY DANFOSS DRIVES SUBJECT TO THE CONDITIONS THAT IT AND THE INFORMATION EMBODIED THEREIN SHALL BE USED ONLY FOR RECORD AND REFERENCE PURPOSES. SHALL NOT BE USED OR CAUSED TO BE USED	DIM		•	N DISC, DRIVE FU			Janjoos
DR	SP10076	09/10	IN ANY WAY PREJUDICIAL TO THE INTERESTS OF DANFOSS DRIVES, SHALL	APR	L	,JIVI 0 I,IP	R,SINGLE MOTOR,	Z FAN	T = =	
REV	ECN	DATE	NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE WITHOUT THE DIRECT WRITTEN PERMISSION OF DANFOSS DRIVES AND SHALL BE RETURNED UPON REQUEST.	D TM	MODEL	VLT	PAGE <u>1</u> OF <u>2</u>	SIZE	DWG 18	5B1269

WIRE COLOR SCHEME
BLACK — LINE VOLTAGE
RED — AC CONTROL
WHITE — AC GROUNDED

WHITE — AC GROUNDED CIRCUIT CONDUCTOR BLUE — DC CONTROL GREEN — CHASSIS GROUND

TERMINAL IDENTIFCATION

X - DRIVE TERMINAL


CUSTOMER TERMINAL


CUSTOMER DRY CONTACT RATINGS

RELAY	CONTACT RATING		
CR1, CR6	5A @ 120VAC 1/10 HP @ 120VAC		
M2, M3	10A @ 120/240VAC		

CONTACT SEQUENCE CHART FOR S1 X INDICATES CONTACT CLOSED

X INDICATES CONTACT CLUSED				
POSITION				
CONTACT	DRIVE	OFF	BYPASS	
13-14			Χ	
23-24	Χ			

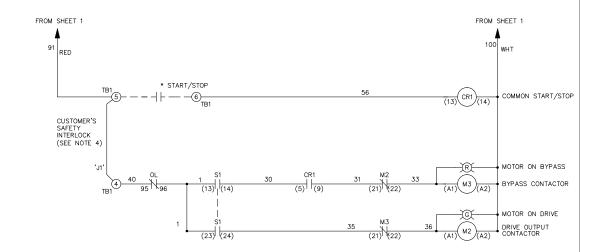

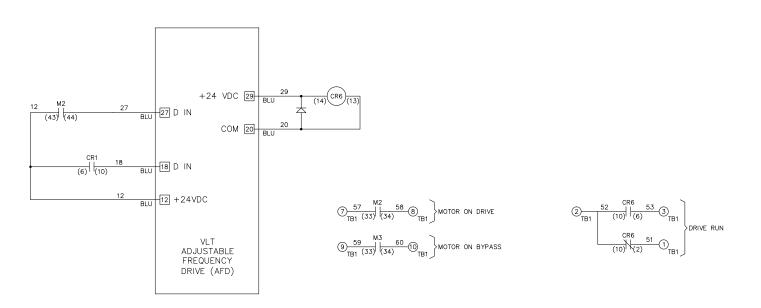

В		
Α	SP10119	11/10
DR	SP10076	09/10
REV	ECN	DATE

- NOTICE
THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF DANFOSS DRIVES.
IT IS LOANED BY DANFOSS DRIVES SUBJECT TO THE CONDITIONS THAT IT AND
THE INFORMATION EMBODIED THEREIN SHALL BE USED ONLY FOR RECORD
AND REFERENCE PURPOSSES, SHALL NOT BE USED OR CAUSED TO BE USED
IN ANY WAY PREJUDICAL TO THE INTERESTS OF DANFOSS DRIVES, SHALL
NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART, OR DISCLOSED
TO ANYONE WITHOUT THE DIRECT WRITTEN PERMISSION OF DANFOSS DRIVES
AND SHALL BE RETURNED UPON REQUEST.

)	DRN	D TM
	400	

DTM

NAME NEMA 3R,480V,2C ,MAIN DISC, DRIVE FUSE ,3MB1,IR,SINGLE MOTOR,2 FAN



MODEL

VLT

PAGE <u>2</u> OF <u>2</u>

 $A \mid DWG$

OWG 185B1269